

NFPA[®]

53

**Recommended Practice on
Materials, Equipment, and
Systems Used in Oxygen-Enriched
Atmospheres**

2016



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® DOCUMENTS

NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA DOCUMENTS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that NFPA Standards may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendment and any Errata then in effect.

In order to determine whether an NFPA Standard has been amended through the issuance of Tentative Interim Amendments or corrected by Errata, visit the Document Information Pages on NFPA’s website. The Document Information Pages provide up-to-date, document specific information including any issued Tentative Interim Amendments and Errata.

To access the Document Information Page for a specific NFPA Standard, go to <http://www.nfpa.org/docinfo> to choose from the list of NFPA Standards or use the search feature on the right to select the NFPA Standard number (e.g., NFPA 101). The Document Information page includes postings of all existing Tentative Interim Amendments and Errata. It also includes the option to register for an “Alert” feature to receive an automatic email notification when new updates and other information are posted regarding the document.

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/freeaccess.

Copyright © 2015 National Fire Protection Association®. All Rights Reserved.

NFPA®53

Recommended Practice on

Materials, Equipment, and Systems Used in Oxygen-Enriched Atmospheres

2016 Edition

This edition of NFPA 53, *Recommended Practice on Materials, Equipment, and Systems Used in Oxygen-Enriched Atmospheres*, was prepared by the Committee on Oxygen-Enriched Atmospheres. It was issued by the Standards Council on November 14, 2015, with an effective date of December 4, 2015, and supersedes all previous editions.

This edition of NFPA 53 was approved as an American National Standard on December 4, 2015.

Origin and Development of NFPA 53

Development of NFPA 53 was initiated in 1965 largely as a result of interest in the area of oxygen-enriched atmospheres by the aerospace industry and medical personnel/researchers, who expressed a need for a single source of general data on the hazards of oxygen-enriched atmospheres.

The first edition was published in 1969 under NFPA procedures that did not require Association meeting action for NFPA documents. A second edition was formally adopted under NFPA procedures at the NFPA Annual Meeting in 1974. Subsequent editions were adopted in 1979, 1985, 1990, and 1994.

The 1994 edition reflected a complete review of the contents of the document and incorporated much new information gained by research at the National Aeronautics and Space Administration from 1984 to 1994.

The 1999 edition changed the document from a guide to a recommended practice. Also, some minor changes were made to the definitions of *oxygen-enriched atmosphere* and *ignition temperature*.

The 2004 edition of the recommended practice underwent editorial revisions to meet the NFPA *Manual of Style* and included only minor editorial changes.

The 2011 edition reconfirmed the provisions as they were written in the 2004 edition.

The 2016 edition adds heat of combustion and auto-ignition temperature data to the expanded table of nonmetallic materials for oxygen service. In addition, new fire experience reports have been added to Annex D.

Technical Committee on Oxygen-Enriched Atmospheres

Richard C. Barry, *Chair*
Healogics, FL [U]

Alain Colson, Air Liquide S.A., France [M]

Jolene E. Cormier, Baylor Medical Center, TX [U]

Sean Dee, Exponent, IL [SE]

Kim Phillips Dunleavy, Dunleavy Technical Services Inc., Canada [M]

Sean Faughnan, East Orange General Hospital, NJ [U]

Jack D. Fry, Los Angeles Fire Department, CA [E]

Craig H. Kampmier, Swansea Fire Department, MA [E]

Joseph Million, Praxair, NY [M]

Barry E. Newton, Wendell Hull & Associates, Inc., NM [SE]

Keisa Rosales, Jacobs Technology Inc., NM [SE]

Jerrold Sameth, Compressed Gas Association, Inc., NJ [IM]
Rep. Compressed Gas Association

Myles Tenbroeck, American Cylinder and Safety, AR [M]

Frederick Williams, U.S. Naval Research Laboratory, DC [SE]

Alternates

Walter Joslyn, CDA Technical Institute, FL [U]
(Alt. to Richard C. Barry)

Robert Nelson, Los Angeles Fire Department, CA [E]
(Alt. to Jack D. Fry)

James White, Praxair, NY [M]
(Alt. to Joseph Million)

Laura E. Montville, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the fire and explosion hazards that may exist in oxygen-enriched atmospheres. The Committee will correlate its work with the Committee on Health Care Facilities and other related NFPA committees as required.

Contents

Chapter 1 Administration	53- 4	7.4 Personnel Qualifications.	53- 9
1.1 Scope.	53- 4	7.5 Oxygen Transmission.	53- 9
1.2 Purpose.	53- 4	7.6 Shutoff.	53- 9
1.3 Application.	53- 4	7.7 Electrical Equipment.	53- 9
1.4 Interpretations.	53- 4	7.8 Cleaning for Oxygen Service.	53- 9
Chapter 2 Referenced Publications	53- 4	7.9 Combustibles.	53- 10
2.1 General.	53- 4	7.10 Applicable Standards.	53- 10
2.2 NFPA Publications.	53- 4	Chapter 8 Fire Extinguishment	53- 10
2.3 Other Publications.	53- 4	8.1 Oxygen Supply.	53- 10
2.4 References for Extracts in Recommendations Sections.	53- 5	8.2 Extinguishing Systems.	53- 10
Chapter 3 Definitions	53- 5	8.3 Fixed Systems.	53- 10
3.1 General.	53- 5	8.4 Water Hose.	53- 10
3.2 NFPA Official Definitions.	53- 5	8.5 Diluents.	53- 10
3.3 General Definitions.	53- 5	8.6 Limiting Fire Spread.	53- 10
Chapter 4 Types of Systems Used in Oxygen-Enriched Atmospheres	53- 6	8.7 Nontoxic Agents.	53- 10
4.1 General.	53- 6	8.8 Wetting.	53- 10
Chapter 5 Materials Selection	53- 7	8.9 Instructions and Drills.	53- 10
5.1 General.	53- 7	Annex A Explanatory Material	53- 10
5.2 Nonmetals.	53- 7	Annex B Training and Education	53- 14
5.3 Metals.	53- 7	Annex C Utilization of Oxygen-Enriched Atmospheres	53- 15
Chapter 6 Component Selection	53- 7	Annex D Fire Experience	53- 19
6.1 Material Recommendations.	53- 7	Annex E Fundamentals of Ignition and Combustion in Oxygen-Enriched Atmospheres	53- 30
6.2 General Design Recommendations.	53- 7	Annex F Materials for Use in Oxygen-Enriched Atmospheres	53- 35
6.3 Specific Component Design Guidelines.	53- 7	Annex G Informational References	53- 56
6.4 Components.	53- 8	Index	53- 58
Chapter 7 System Design	53- 9		
7.1 Design Considerations.	53- 9		
7.2 Worst-Case Conditions.	53- 9		
7.3 Fire-Stopping Techniques.	53- 9		

NFPA 53

Recommended Practice on

Materials, Equipment, and Systems Used in
Oxygen-Enriched Atmospheres

2016 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Documents." They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with any TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by any TIAs or Errata, please consult the National Fire Codes® Subscription Service or visit the Document Information (DocInfo) pages on the NFPA website at www.nfpa.org/docinfo. In addition to TIAs and Errata, the DocInfo pages also include the option to sign up for Alerts for each document and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in the recommendations sections of this document are given in Chapter 2 and those for extracts in the informational sections are given in Annex G. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text should be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex G.

Chapter 1 Administration

1.1 Scope. This document establishes recommended minimum criteria for the safe use of oxygen (liquid/gaseous) and the design of systems for use in oxygen and oxygen-enriched atmospheres (OEAs).

1.2 Purpose. The purpose of this recommended practice is to provide information for the selection of materials, components, and design criteria that can be used safely in oxygen and OEAs.

1.3 Application. This recommended practice is applicable to the selection of materials and components, and to the design of new systems associated with OEAs. Such applications include, but are not limited to, gas and compressed air

supplies, spaceflight operations, industrial processes, welding applications, self-contained breathing apparatus (SCBA), self-contained underwater breathing apparatus (SCUBA), medical applications (including home assisted-breathing apparatus), underwater tunneling and caisson work, and commercial and military aviation.

1.4 Interpretations. The National Fire Protection Association does not approve, inspect, or certify any installation, procedure, equipment, or material. With respect to this recommended practice, and to fire and associated hazards in OEAs, its role is limited solely to an advisory capacity. The acceptability of a particular material, component, or system for use in an OEA is solely a matter between the user and the provider. However, to assist in the determination of such acceptability, the National Fire Protection Association has established interpretation procedures. These procedures are outlined in the NFPA Regulations Governing Committee Projects.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this recommended practice and should be considered part of the recommendations of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 51, *Standard for the Design and Installation of Oxygen–Fuel Gas Systems for Welding, Cutting, and Allied Processes*, 2013 edition.

NFPA 55, *Compressed Gases and Cryogenic Fluids Code*, 2013 edition.

NFPA 70®, *National Electrical Code*®, 2014 edition.

NFPA 90A, *Standard for the Installation of Air-Conditioning and Ventilating Systems*, 2015 edition.

NFPA 91, *Standard for Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Noncombustible Particulate Solids*, 2015 edition.

NFPA 99, *Health Care Facilities Code*, 2015 edition.

NFPA 99B, *Standard for Hypobaric Facilities*, 2015 edition.

NFPA 496, *Standard for Purged and Pressurized Enclosures for Electrical Equipment*, 2013 edition.

2.3 Other Publications.

2.3.1 API Publications. American Petroleum Institute, 1220 L Street, NW, Washington, DC 20005-4070.

API 620, *Design and Construction of Large, Welded, Low-Pressure Storage Tanks*, 2013.

2.3.2 ASME Publications. American Society of Mechanical Engineers, Three Park Avenue, New York, NY 10016-5990.

ASME B31.3, *Process Piping*, 2012.

ASME B31.5, *Refrigeration Piping and Heat Transfer Components*, 2013.

ASME B31.8, *Gas Transmission and Distribution Piping Systems*, 2012.

ASME Boiler and Pressure Vessel Code, 2013.

2.3.3 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151-2923.

CGA G-4, *Oxygen*, 2008.

CGA P-1, *Safe Handling of Compressed Gases in Containers*, 2008.

CGA S-1.1, *Pressure Relief Device Standards — Part 1 — Cylinders for Compressed Gases*, 2011.

CGA S-1.2, *Pressure Relief Device Standards — Part 2 — Cargo and Portable Tanks for Compressed Gases*, 2009.

CGA S-1.3, *Pressure Relief Device Standards — Part 3 — Stationary Storage Containers for Compressed Gases*, 2008.

2.3.4 U.S. Government Publications. U.S. Government Printing Office, Washington, DC 20402.

Title 49, Code of Federal Regulations, Part 173.301, “General Requirements for Shipment of Compressed Gases in Cylinders and Spherical Pressure Vessels,” 2013.

Title 49, Code of Federal Regulations, Part 173.302, “Charging of Cylinders with Non-Liquefied Compressed Gases,” 2013.

Title 49, Code of Federal Regulations, Part 173.337, “Nitric Oxide,” 2013.

Title 49, Code of Federal Regulations, Part 178.37, “Specification 3AA and 3AAX Seamless Steel Cylinders,” 2013.

Title 49, Code of Federal Regulations, Part 178.45, “Specification 3T Seamless Steel Cylinders,” 2013.

2.3.5 Other Publications.

Merriam-Webster’s Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

Phillips, B.R., “Resonance Tube Ignition of Metals,” Ph.D. Thesis, University of Toledo, Toledo, OH, 1975.

Pressure-Relieving Systems for Marine Cargo Bulk Liquid Containers, National Academy of Sciences, Washington, DC, 1973.

Schmidt, H. W.; and Forney, D. F. “ASRDI Oxygen Technology Survey, Volume IX: Oxygen Systems Engineering Review.” NASA SP 3090, NASA, Washington, DC, 1975.

2.4 References for Extracts in Recommendations Sections.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2013 edition.

NFPA 921, *Guide for Fire and Explosion Investigations*, 2014 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter apply to the terms used in this recommended practice. Where terms are not defined in this chapter or within another chapter, they should be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster’s Collegiate Dictionary*, 11th edition, is the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3* Code. A standard that is an extensive compilation of provisions covering broad subject matter or that is suitable for adoption into law independently of other codes and standards.

3.2.4 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.5* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.6 Recommended Practice. A document that is similar in content and structure to a code or standard but that contains only nonmandatory provisions using the word “should” to indicate recommendations in the body of the text.

3.2.7 Should. Indicates a recommendation or that which is advised but not required.

3.2.8 Standard. An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

3.3.1 Activation Energy. The minimum energy that colliding fuel and oxygen molecules must possess to permit chemical interaction.

3.3.2 Autoignition or Autogenous Ignition Temperature. See 3.3.18, Ignition Temperature.

3.3.3 Combustible Material. A material capable of undergoing combustion.

3.3.4 Combustion. A chemical process of oxidation that occurs at a rate fast enough to produce heat and usually light in the form of either a glow or flame.

3.3.5 Concentration. The ratio of the amount of one constituent of a homogeneous mixture to the total amount of all constituents in the mixture.

3.3.6 Contaminant. A foreign or unwanted substance that can have deleterious effects on system operation, life, or reliability.

3.3.7 Deflagration. Propagation of a combustion zone at a velocity that is less than the speed of sound in the unreacted medium. [68, 2013]

3.3.8 Detonation. Propagation of a combustion zone at a velocity that is greater than the speed of sound in the unreacted medium. [68, 2013]

3.3.9 Diluent. A gas used to dilute or reduce the concentration of oxygen.

3.3.10 Fire. A rapid oxidation process, which is a chemical reaction resulting in the evolution of light and heat in varying intensities. [921, 2014]

3.3.11 Flame Propagation Rate. The velocity with which the combustion front travels through a body of gas, measured as the highest gas velocity at which stable combustion can be maintained, and the velocity at which combustion travels over the surface of a solid or liquid.

3.3.12 Flammable. A combustible that is capable of easily being ignited and rapidly consumed by fire. Flammables may be solids, liquids, or gases exhibiting these qualities.

3.3.13 Flammable Limits. The minimum and maximum concentration of fuel vapor or gas in a fuel vapor or gas/gaseous oxidant mixture (usually expressed as percent by volume) defining the concentration range (flammable or explosive range) over which propagation of flame will occur on contact with an ignition source. The minimum concentration is known as the lower flammable limit (LFL) or the lower explosive limit (LEL). The maximum concentration is known as the upper flammable limit (UFL) or the upper explosive limit (UEL).

3.3.14 Flash Point. The minimum temperature of a liquid or solid at which it gives off vapor sufficient to form an ignitable mixture with a gaseous oxidant (i.e., oxygen) near the surface of the liquid or solid under specified environmental conditions.

3.3.15 Fuel. Any material that will maintain combustion under specified environmental conditions.

3.3.16 Hyperbaric. Pressure greater than ambient.

3.3.17 Hypobaric. Pressure less than ambient.

3.3.18* Ignition Temperature. The minimum temperature required to initiate or cause self-sustaining combustion independently of the heating or heated element under specified environmental conditions. Ignition temperatures are commonly reported as the autoignition temperature, autoignition temperature (AIT), or spontaneous ignition temperature (SIT).

3.3.19 Lower Flammable Limit or Lower Explosive Limit. See 3.3.13, Flammable Limits.

3.3.20* Minimum Ignition Energy. The minimum energy required to ignite a flammable mixture; usually the minimum energy of an electric spark or arc expressed in joules.

3.3.21 Mixture.

3.3.21.1 Lean Mixture. A fuel and oxidizer mixture having less than the stoichiometric concentration of fuel.

3.3.21.2 Rich Mixture. A fuel and oxidizer mixture having more than the stoichiometric concentration of fuel.

3.3.21.3 Stoichiometric Mixture. A balanced mixture of fuel and oxidizer such that no excess of either remains after combustion.

3.3.22* Oxidant. An oxygen-bearing chemical compound that supports combustion.

3.3.23 Oxidation. Reaction with oxygen either in the form of the element or in the form of one of its compounds.

3.3.24 Oxygen. A chemical element that, at normal atmospheric temperatures and pressures, exists as a colorless, odorless, and tasteless gas and comprises about 21 percent by volume of the earth's atmosphere.

3.3.25 Oxygen-Enriched Atmosphere (OEA). An atmosphere in which the concentration of oxygen exceeds 21 percent by volume or its partial pressure exceeds 21.3 kPa (160 torr).

3.3.26* Pressure. The force per unit of area. Values in this recommended practice are based on the unit of pressure derived from the International System of Units (SI), which is the pascal (Pa) or newton per square meter (N/m²).

3.3.26.1 Absolute Pressure. The total pressure being measured that equals gauge pressure plus atmospheric pressure.

3.3.26.2 Gauge Pressure. Pressure measured with reference to atmospheric pressure that equals absolute pressure minus atmospheric pressure.

3.3.27 Spontaneous Ignition Temperature. See 3.3.18, Ignition Temperature.

3.3.28 Upper Flammable Limit or Upper Explosive Limit. See 3.3.13, Flammable Limits.

3.3.29 Worst-Case. The maximum concentration, pressure, temperature, or flow-rate that can occur with a reasonable single-point failure or upset.

Chapter 4 Types of Systems Used in Oxygen-Enriched Atmospheres

4.1 General. Mechanical and electrical systems that can be found in oxygen-enriched atmospheres (OEAs) include the following:

- (1) Air conditioning: Heating, cooling, humidity control, purification, filtering, fresh air supply, and forced circulation
- (2) Hydraulic services (water and hydraulic fluids): Acceptable hydraulic fluids (chemically inert in oxygen), water supply and waste piping, valves, temperature controls, pressure regulators, fire extinguishment
- (3) Compressed air supply: Compressor, cylinder manifold for emergency use, pressure controls, and piping system from supply source to use location
- (4) Gas supply: Uses of gas in OEAs are as follows:
 - (a) Cylinders of compressed gases, such as oxygen, nitrous oxide, nitrogen, helium, and natural air, for human breathing
 - (b) Anesthetic vaporizers such as halothane, enflurane, and isoflurane
 - (c) Cylinder storage, cylinder fastenings in storage or in manifold assemblies, piping and fittings with check valves, flow valves, pressure regulators as required for safe transmission of gas from cylinder to termi-

- nal at use site, and hose and hose connections at use site for attaching dispensing equipment
- (d) Inhalation devices, such as face masks and endotracheal tubes, for connecting to dispensing equipment and for supplying air or gaseous mixtures to humans or animals for breathing
 - (5) Suction apparatus: Vacuum pump with controls, piping system from pump to use site, pickup hose, and attachments and shutoff valves
 - (6) Electrical-main and emergency systems: Conduit and conduit-fitting sealing compound, insulated conductors, convenience outlets, switches, overcurrent protective devices (fuses, circuit breakers, and relays), temperature-indicating and control devices (thermostats and thermistors), lighting (luminaires, lamps, conductors, and switches), electronic monitoring devices (oscilloscope, blood pressure and heart rate, and temperature and high-low alarms), medical instruments (defibrillator and recorders), clocks, elapsed time indicators, chamber temperature indicators, and pressure control devices
 - (7) Communication systems: Telephone or intercommunication systems; microphone with speaker (receiver) for communication with others in other compartments of chamber, with monitor outside of chamberport, or with others at remote stations; and television and radio

Chapter 5 Materials Selection

5.1* General.

5.1.1* The rate of flame propagation and ignition susceptibility of materials of construction should be prime considerations in the promotion of safe design of systems associated with oxygen-enriched environments.

5.1.2 The oxygen compatibility characteristics of all materials involved in oxygen-enriched environments should be carefully and completely evaluated under end-use conditions.

5.1.2.1 Accelerated (time-temperature concentration) oxygen deterioration and degradation (by high-energy and ionizing radiation) tests for service durability also should be conducted for overall evaluation.

5.1.3 When selecting materials for oxygen service, situational or configurational flammability should be evaluated.

5.2 Nonmetals.

5.2.1* The use of nonmetals in oxygen systems should be limited, and their quantity and exposure to oxygen should be minimized.

5.2.2* When selecting materials, application-specific material tests and configurations should be considered.

5.2.3* When selecting a material for oxygen systems, its ability to undergo specific cleaning procedures to remove contaminants, particles, and combustible materials, without damage, should be considered.

5.2.4 When selecting nonmetals for high-pressure oxygen systems, the material's susceptibility to ignition and the possible ignition sources in the system at the use pressures should be given equal consideration with the structural requirements.

5.2.4.1 Criteria for selection of a material for oxygen service should also include the following:

- (1) Few reactions when tested by mechanical impact
- (2) A high autoignition temperature (AIT)
- (3) A low heat of combustion
- (4) A high oxygen index
- (5) A low flame temperature
- (6) A low burn rate
- (7) A low flame propagation rate

5.3 Metals.

5.3.1 Selection of the proper metals in an oxygen system should be coupled with good design practice to minimize the hazards of ignition and combustion of the metal.

5.3.2* The oxide coating of a metal should be considered when selecting it.

5.3.3* The use of aluminum alloys in lines, valves, and other components should be avoided whenever possible.

5.3.4* High-pressure oxygen systems fabricated from aluminum should be designed with extreme care to eliminate particles. Filters should be fabricated of materials less ignitable than aluminum.

5.3.5 Systems that use large areas of aluminum alloys in oxygen storage tanks should be designed to ensure that aluminum particles cannot cause ignition of other metallic materials downstream from the aluminum.

5.3.6 The use of cadmium, beryllium, magnesium, mercury, and titanium metals in oxygen systems should be restricted.

5.3.7* The ignitibility of other metals and alloys in high-pressure oxygen systems and their ability to propagate fire after ignition should be compared to the flammability properties of the common structural materials described in 5.3.6 before determining how suitable they are for use in high-pressure oxygen systems.

5.3.8 The use of nickel, copper, and their alloys is preferred in oxygen systems.

Chapter 6 Component Selection

6.1 Material Recommendations.

6.1.1 Designers of equipment for oxygen use should thoroughly understand the reactivity of selected materials in oxygen-enriched environments.

6.1.2 The designer should attempt to avoid using flammable materials; however, many materials that are flammable at operating conditions can be used safely in some applications by carefully avoiding ignition sources.

6.1.3 The designer should not compromise safety to reduce material costs.

6.2* General Design Recommendations. Designs should consider system dynamics, component interactions, and operational constraints in addition to component design requirements to prevent conditions leading to fires in OEAs.

6.3 Specific Component Design Guidelines. Oxygen system designers should incorporate the following criteria into the guidelines:

- (1)* Minimize the amount of organic, nonmetallic materials and their exposure to oxygen flow

- (2)* Limit gaseous oxygen pressurization rates
- (3)* Limit gaseous oxygen flow velocities
- (4)* Minimize mechanical impact
- (5)* Minimize frictional heating in oxygen
- (6)* Minimize ignition from particle impact
- (7)* Eliminate burrs and avoid sharp edges
- (8)* Minimize use-generated particles during manufacture, assembly, and operation
- (9)* Avoid rotating valve stems and sealing configurations that require rotation on assembly
- (10)* Minimize electrical arcing
- (11)* Avoid blind passages
- (12)* Avoid crevices for particle entrapment and resonant cavities (Phillips)
- (13) Design dynamic seals to minimize particle generation and to minimize coefficients of friction and surface finishes, and choose seal configurations to minimize particle generation that can cause particle impact ignitions
- (14)* Limit fluid-induced vibrations (over all operating ranges)
- (15)* Consider the effects of single-point seal failures
- (16)* Eliminate rotation of seals and rotation against seats
- (17)* Avoid thin walls
- (18)* Be cautious of single-barrier failures
- (19)* Allow sufficient seal squeeze to avoid O-ring extrusion
- (20)* Use metal-to-metal seals in some cases
- (21) Consider the effects of long-term operation, including the following:
 - (a)* Permanent deformation (cold flow) of seals
 - (b)* Seal extrusion (avoid extrusion-generated particles)
 - (c)* High-temperature excessive oxidation of copper
- (22) Design equipment so that power losses, control pressure leakage, or other loss of actuation sources return the equipment to a fail-safe position to protect personnel and property in an accident
- (23)* Consider the effects of thermal expansion

6.4 Components.

6.4.1 Valves.

6.4.1.1 All valves should be accessible for operation and maintenance and should be protected from accidental damage.

6.4.1.2 Valves in gaseous oxygen distribution systems should be kept to a minimum and should be of good quality.

6.4.1.2.1 All valve materials must be suitable for oxygen.

6.4.1.2.2 Stems, packing glands, and other parts vital to proper valve operation should be made of materials that will not readily corrode.

6.4.1.3 Isolation valves should operate either fully open or fully closed and not in a throttling or regulating mode.

6.4.1.4 Where required, a bypass should be provided around isolation valves. The bypass should be made of suitable materials. If remotely operated bypass valves are used, the valves should be fail-safe in case of power loss and should close on a system emergency shutdown signal.

6.4.2 Pressure-Relief Devices and Piping.

6.4.2.1 Relief valves or rupture disks should be installed on tanks, lines, and component systems to prevent overpressurization.

6.4.2.1.1 The capacity of a pressure-relief device should be equal to that of all the vessel and piping systems it is to protect.

6.4.2.1.2 These devices should be reliable and the settings secured against accidental alteration.

6.4.2.2 Relief valves and similar devices should not be considered secondary and passive components in the test hardware design.

6.4.2.2.1 It should be assumed that the valves will function at some point in time.

6.4.2.2.2 Personnel safety and hardware damage should be primary design considerations.

6.4.2.3 Relief valves should be functionally tested to verify that design requirements are satisfied, including testing in both the static and dynamic states.

6.4.2.4 Relief valve riser pipes on high-pressure oxygen systems should be analyzed for resonant tuning. Piping lengths should be changed if resonant tuning is determined.

6.4.2.5 All sections of the pipeline system should be adequately protected by pressure-relief devices and should have an adequate manual vent valve to allow for blowdown and purging.

6.4.2.5.1 All components in any oxygen system that should be permitted to be removed for inspection, maintenance, or replacement should be provided with a vent valve for blowdown and purging.

6.4.2.5.2 Safety valves, vent valves, and associated piping should be constructed of compatible materials.

6.4.2.5.3 Downstream relief devices and any vent lines should be built from the most ignition-resistant materials available and should be positioned in remote locations or isolated from personnel by barriers or shields.

6.4.2.6* Piping, tubing, and fittings should be suitable for the intended oxygen service.

6.4.2.7 Safety devices should be checked before use to prevent possible installation of incorrect pressure-rated devices.

6.4.2.8 The minimum relieving capacities of the safety devices should be as determined by the flow formulas in applicable codes and specifications (for example, Schmidt and Forney, and National Academy of Sciences).

6.4.2.8.1 Safety relief valves and frangible disks should be designed and installed in accordance with applicable codes and specifications (for example, CGA S-1.2).

6.4.2.9 Flexible Piping and Tubing.

6.4.2.9.1 Proper restraining cables and anchoring cables should be required for flexible hose.

6.4.2.9.2 Stainless steel tubing, which can be formed into loops to provide enough flexibility for easy hookup, should be an acceptable practice.

6.4.2.9.3* Flexible metal tube or pipe such as bellows sections should also be acceptable.

6.4.2.9.4* Polytetrafluoroethylene-lined flexible hose can be used if particular care is exercised to ensure that pneumatic impact ignitions cannot occur.

Chapter 7 System Design

7.1 Design Considerations. In the design of systems associated with OEAs, the following should be considered:

- (1) Characteristics of construction materials include ignition susceptibility, flame spread rate, and smoke development
- (2) Risks of fire initiation include ignition sources such as heat from compression of gases, friction, mechanical impact, and electrical arc or spark
- (3) Presence of potential energy sources, such as compressed gases
- (4) Removal or elimination of foreign materials or contaminants
- (5) Physical environment surrounding the system
- (6) Personnel safety

7.2 Worst-Case Conditions. The characteristics of all materials to be used in OEAs should be evaluated for use under worst-case conditions, such as maximum pressure, temperature, and flow.

7.3 Fire-Stopping Techniques. When designing an oxygen-enriched system, fire-stopping techniques should be used where appropriate to minimize ignition potential and fire spread. These techniques include the following:

- (1) Avoidance of mass concentration of combustible materials near potential heat or ignition sources
- (2) Spatial separation and configuration to minimize or eliminate flame propagation paths
- (3) Thermal damping by judicious placement of fire-resistant heat-sink masses
- (4) Flashover barriers
- (5) Sealed packaging, such as inerted compartments and fire-resistant encapsulation
- (6) Automatic fire detection and suppression such as infrared thermography, fire detectors, and fixed suppression systems

7.4* Personnel Qualifications. The design of an oxygen-enriched system should only be undertaken by qualified personnel.

7.5 Oxygen Transmission. Systems used in the transmission of oxygen should be cleaned prior to use and on a routine basis to remove contaminants.

7.6* Shutoff. A manual emergency oxygen shutoff that is accessible should be provided.

7.7 Electrical Equipment.

7.7.1* No electrical equipment should be installed or used in OEAs unless approved for use at the maximum proposed pressure and oxygen concentration.

7.7.1.1 Electrical equipment should be provided with noncombustible insulation to confine any burning of the insulation within the enclosure, unless the equipment is of construction that has been found, through testing, at the maximum pressure

and the oxygen concentration encountered in the chamber or system.

7.7.2* Fixed electrical equipment within an OEA should comply with the requirements of Article 500, Class I, Division 1, *NFPA 70*, and, in addition, equipment installed therein should be approved for use in the specific hazardous atmospheres at the maximum proposed pressure and oxygen concentration.

7.7.3 All electrical wiring installed in a system or chamber should comply with the requirements of the *NEC*, Article 500, Class I, Division 1.

7.7.3.1 The boxes and fittings should be approved for use in the specific hazardous atmospheres at the maximum pressure and oxygen concentration of the chamber or system.

7.7.4 Raintight fittings, boxes, and equipment should be used if such devices could be exposed to the water from a sprinkler or water spray system that is protecting the chamber in the event of a fire in the vicinity of the chamber while it is in operation.

7.7.5 All electrical circuits contained within the chamber or system should be supplied from an isolated electrical system, fed from isolation transformers located outside the chamber or system, and equipped with a line isolation monitor with appropriate signal lamps. This indicator should be capable of sensing single or balanced capacitive-resistive faults as well as leakage of current to ground.

7.7.6 Electrical wiring in high concentrations of gas oxygen should be encased in hermetically sealed conduits or conduits inerted with helium or nitrogen gas.

7.7.6.1 The instruments, switches, flow sensors, and electrical devices should be designed in modular structure, hermetically sealed, and inerted with nitrogen or helium gas.

7.8* Cleaning for Oxygen Service.

7.8.1* All hardware that is exposed to OEAs should be cleaned to remove contaminants.

7.8.2* The solvent or detergent should not leave a residual material on the cleaned surface.

7.8.3* A typical cleaning criterion for industrial gaseous oxygen systems specifies that the remaining organics should not exceed 500 mg/m² (1×10^{-4} lb/ft²) of oxygen-contacted surfaces.

7.8.4* Verification of cleanliness should be accomplished by one or more of the following methods:

- (1) Direct visual inspection with white light
- (2) Direct visual inspection with ultraviolet (UV) or black light
- (3) Inspection of a wipe sample using a clean, lint-free cotton or linen cloth or a piece of white filter paper examined under white or UV light
- (4) Solvent extraction to determine the level of extractable contaminants that includes nonvolatile residue analysis, volume of residue analysis, and spectroscopic technique
- (5) Aqueous cleaning and verification processes

7.8.5* Cleaned parts should be placed in sealed noncontaminating bags, or sealed with plugs in the case of long piping runs, and labeled "Cleaned for Oxygen Service."

7.8.5.1 Cleaned parts should not be handled with bare hands.

7.9* Combustibles. It is highly recommended that every possible effort be made to restrict the quantity of combustibles permitted within the system, vessel, chamber, surrounding physical environment (including interior surface finishes, such as paints, plastic coverings, and acoustical, thermal, and electrical insulation), coverings and housings of servicing apparatus, and instrumentation employed inside the system or chamber.

7.10 Applicable Standards.

7.10.1 Design and construction of housing vessels and chambers should be in accordance with the applicable provisions of the currently established practices described in the following documents:

- (1) ASME Boiler and Pressure Vessel Code, Section VII
- (2)* NFPA 99, Chapter 14
- (3) NFPA 99B
- (4) API 620, *Design and Construction of Large, Welded, Low-Pressure Storage Tanks*
- (5) CGA pamphlets as follows:
 - (a) CGA P-1, *Safe Handling of Compressed Gases in Containers*
 - (b) CGA S-1.1, *Pressure Relief Device Standards — Part 1 — Cylinders for Compressed Gases*
 - (c) CGA S-1.2, *Pressure Relief Device Standards — Part 2 — Cargo and Portable Tanks for Compressed Gases*
 - (d) CGA S-1.3, *Pressure Relief Device Standards — Part 3 — Stationary Storage Containers for Compressed Gases*

7.10.2 Oxygen storage, piping, and uses should be in accordance with the following standards:

- (1) NFPA 51
- (2) NFPA 55
- (3)* Hospital requirements in NFPA 99, as well as Chapter 5 and Chapter 11.
- (4) CGA G-4, *Oxygen*
- (5) ASME B31.3, *Process Piping*
- (6) ASME B31.5, *Refrigeration Piping and Heat Transfer Components*
- (7) ASME B31.8, *Gas Transmission and Distribution Piping Systems*
- (8) U.S. Code of Federal Regulations as follows:
 - (a) 49 CFR 173.301
 - (b) 49 CFR 173.302
 - (c) 49 CFR 173.337
 - (d) 49 CFR 178.37
 - (e) 49 CFR 178.45

7.10.3 Electrical equipment and instruments should be in accordance with the following standards:

- (1) NFPA 70, Articles 500, 501, and 517
- (2)* NFPA 99, Chapter 6 and Chapter 10
- (3) NFPA 496

7.10.4 Air-conditioning and ventilating systems should be in accordance with the following standards:

- (1) NFPA 90A
- (2) NFPA 91

Chapter 8 Fire Extinguishment

8.1 Oxygen Supply. The oxygen supply should be discontinued in the event of a fire.

8.2* Extinguishing Systems.

8.2.1 Due to the rapid flame spread in OEAs, fire-extinguishing systems should be capable of fast automatic actuation by fire detectors as well as by manual actuation.

8.2.2 Automatic actuation should occur in less than 1 second of detection of flame.

8.2.3 Manual actuation of the fire-extinguishing system should be provided.

8.3 Fixed Systems. Fixed systems should utilize an extinguishing agent acceptable for use on fires in OEA.

8.4 Water Hose. In addition to an automatic, fixed extinguishing system in occupied areas, a manually operated water hose not less than 19 mm ($\frac{3}{4}$ in.) inside diameter, and with an effective nozzle pressure of not less than 345 kPa (50 psi) above the ambient pressure, should be available.

8.5 Diluents. In unoccupied areas, diluents (e.g., carbon dioxide, nitrogen) can be used.

8.6* Limiting Fire Spread. Fire protection measures should be concentrated on limiting the spread of fire from involved components to other portions of the system.

8.7 Nontoxic Agents. Fire-extinguishing agents should be inherently nontoxic and should not produce significant amounts of toxic breakdown products when used.

8.8* Wetting. Where the combustible is present in more than one layer, all layers should be wetted by the water.

8.9 Instructions and Drills.

8.9.1 All personnel working in a space containing an OEA should be instructed in the special hazards involved, and the differences between fire in an OEA and fire in ordinary air should be emphasized.

8.9.2 Each person working in an OEA system should be assigned a specific fire emergency duty.

8.9.3 Other personnel working in associated monitoring areas should likewise be instructed and assigned specific duties appropriate to a fire emergency.

8.9.4 The instruction should be augmented by frequent drills so that proper action can be taken immediately upon the occurrence of a hazardous condition.

8.9.5 Such instruction and drill should be so comprehensive and specific that no time is lost in decision-making or considering alternative procedures. (*See Annex B.*)

Annex A Explanatory Material

Annex A is not a part of the recommendations of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such

standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.3 Code. The decision to designate a standard as a “code” is based on such factors as the size and scope of the document, its intended use and form of adoption, and whether it contains substantial enforcement and administrative provisions.

A.3.2.5 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.18 Ignition Temperature. Spontaneous ignition temperature (SIT) should not be confused with temperatures associated with the spontaneous heating or combustion phenomenon that certain highly oxidizer-receptive materials undergo.

A.3.3.20 Minimum Ignition Energy. The minimum ignition energy is different for different flammable mixtures and varies with the concentration, temperature, and pressure, as well as the geometry and material, of the sparking or arcing electrodes.

A.3.3.22 Oxidant. Examples of oxidants include nitrous oxide, nitric oxide, and chlorates.

A.3.3.26 Pressure. A newton is that force that causes a mass of 1 kilogram to accelerate 1 meter per second.

One atmosphere (atm) = 33 feet of water (39.2°F) = 14.7 pounds per square inch (psi) = 760 millimeters of mercury (mm Hg) (0°C) = 760 torr = 101,325 newtons per square meter (N/m²) = 101,325 pascals (Pa).

A.5.1 See Annex F for additional guidance.

A.5.1.1 Other considerations include the deterioration stability as well as the careful assessment of any potential ignition sources capable of initiating combustion in such atmospheres.

A.5.2.1 Nonmetals are more susceptible to ignition than metals (most nonmetals are flammable in oxygen at 1 atm or greater). In many instances, failures of metallic components

are caused by a polymer ignition, which provides sufficient energy for the metal to ignite.

A.5.2.2 Materials in an oxygen environment below their auto-ignition temperature (AIT) do not ignite without an ignition source. The rate of energy input has to exceed the rate of heat dissipation before ignition can occur. Ignition temperature is dependent on the property of the material, the configuration, the environment (temperature, pressure, oxygen concentration, and fuel characteristics), and the dynamic conditions for flow systems.

Nonmetals, such as polymers, generally ignite at lower temperatures and pressures than metals; nonmetals can burn at oxygen pressures lower than 7 kPa (absolute pressure of 1 psi). The primary concern with nonmetals in oxygen systems is that, if ignited, they might cause damage to the oxygen system or injury to persons in the vicinity. Damage that might result includes propagation of the fire to metallic components, loss of function arising from system leaks, and toxic combustion and pyrolysis products entering the oxygen system.

In general, bulk metals are not easily ignited. When ignited, however, burning metals can cause more damage than burning nonmetals because of their higher flame temperatures and because they usually produce liquid combustion products that spread fires readily. Also, metals comprise the major system components, such as valve bodies and pressure vessels, so that when they ignite and burn, oxygen is released to the surrounding areas in an explosive manner.

A.5.2.3 For more information, see ASTM G93 and CGA G-4.1.

A.5.3.2 The resistance to ignition for metals can be enhanced by a protective oxide coating on the metal surface.

A.5.3.3 Aluminum alloys in high-pressure oxygen ignite easily, burn rapidly, and have very high heats of combustion. Aluminum is easily ignited by friction because the wear destroys its protective oxide layer; therefore, aluminum should not be used in systems where frictional heating is possible.

A.5.3.4 Nickel, silver, bronze, or Monel[®] alloys are recommended, although Monel wire meshes are known to be flammable in elevated-pressure oxygen environments, (Stoltzfus, Lowrie, and Gunaji). Aluminum alloys are more suitable for static components at low oxygen flow rates, such as oxygen storage tanks, than for components with internal movement and variable flow rates, such as valves and regulators.

A.5.3.7 Many other metals and alloys exist that have mechanical properties suited to applications in high-pressure oxygen systems. New alloys are continually being developed, and some are being designed that resist ignition and do not support self-sustained combustion in high-pressure oxygen systems.

A.6.2 The use of ignition- and burn-resistant materials for components in oxygen systems will not eliminate fires in OEAs. For more information, see ASTM G63, ASTM G88, and ASTM G94.

A.6.3(1) Organic, nonmetallic materials exposed to oxygen flow can be readily heated through rapid compression of the gas (Shelley, Christianson, and Stoltzfus, 1993) or readily ignited through kindling-chain reactions. Minimizing organic, nonmetallic materials' exposure by shielding with surrounding metals can significantly reduce ignition hazards.

A.6.3(2) Organic, nonmetallic materials, such as seals, coatings, and lubricants, are susceptible to ignition from heating caused by rapid pressurization. For example, Teflon[®]-lined flexible hose are sensitive to this ignition mode, and, therefore, their use with rapid pressurization applications is discouraged (Janoff et al., 1989). Pressurization rates of valve and regulator actuators should be minimized. In some applications, use of flow-metering devices is prudent for manually actuated valves, especially for quarter-turn ball valves.

A.6.3(3) Limiting flow velocities minimizes erosion problems and reduces the risk of particle-impact ignitions. Although each material and configuration combination needs to be reviewed individually, fluid velocities above 30.5 m/sec (100 ft/sec) should receive special attention, especially at flow restrictions (Williams, Benz, and McIlroy, 1988; Benz, Williams, and Armstrong, 1986; and CGA G-4).

A.6.3(4) Mechanical impact can cause ignition of contaminants and organic, nonmetallic materials. Relief valves, shutoff valves, regulators, and subminiature parts especially should be reviewed for this hazard.

A.6.3(5) Frictional heating, such as heating that occurs with bearings, pistons, and pump impellers, can cause ignitions (Dees and Peterson). Any contamination near the heated region can also be ignited. Frictional heating hazards can be reduced by carefully controlling surface finishes, coefficients of friction, alignment, and flow-induced cooling. Frictional heating has also been found to ignite materials in cryogenic applications.

A.6.3(6) The risk of particle impact ignitions can be reduced if potential impact surfaces are designed with shallow impact angles to reduce the kinetic energy absorbed by the impact surface upon impact (Christianson and Plante, 1989).

A.6.3(7) Burrs and sharp edges on equipment provide ignition sources for particle impact and the ingredients for kindling-chain combustion propagation (Christianson and Plante, 1989). Removal of this material is standard shop practice and is essential to avoid oxygen-enriched ignitions.

A.6.3(8) These particles could be a source of particle impact ignition. Designs should have provisions to minimize particle generation through the normal operation of valve stems, pistons, and other moving parts. Bearings, bushings, and configurations can be used to keep particles away from oxygen-wetted regions. Additionally, proper assembly, cleaning, and maintenance practices should minimize contamination.

A.6.3(9) Rotating valve stems and seals can gall and generate particles.

A.6.3(10) Electrical arcs in oxygen-enriched environments can lead to heating and subsequent ignition.

A.6.3(11) Long, narrow passages or blind passages are difficult to clean and to inspect for cleanliness. Additionally, these passages can provide a location for particles to accumulate during operation of the equipment. This contamination can make the equipment susceptible to particle impact, rapid compression, and resonant cavity ignitions.

A.6.3(12) Cavities, especially those formed at the intersection of mating parts in assemblies, create a location where contamination can accumulate and increase ignition risks, as in blind passages.

A.6.3(14) Vibrations can cause fretting, galling, impacting, and particle generation in components and systems. Check valve chatter and valve poppet oscillations are examples of this phenomenon. Particle accumulations will increase the risk of particle-impact ignitions.

A.6.3(15) Seals will degrade with time and use. Eventually, they can be expected to fail to seal the contained fluid. When this happens, the effects of an oxygen-enriched external environment, high-velocity leakage, and loss of mechanical integrity must be addressed.

A.6.3(16) Sealed parts that require rotation at assembly, such as O-rings on threaded shafts, can generate particles that can migrate into the flow stream. Particle generation also occurs in ball valves where operation of the valve rotates a ball on a nonmetallic seat.

A related phenomenon that can be described as feathering occurs when valve stems are rotated against some nonmetallic seats. Because of the mechanical properties of some nonmetallic materials, a thin, featherlike projection of material is extruded from the seat. The feathered material is more ignitable than the seat itself.

Nonmetallic materials subject to feathering should be used with caution for seals and seats in rotating configurations. Ball valves are not recommended for oxygen systems because of their tendency to generate particles and their fast opening times, which creates rapid pressurization of systems.

A.6.3(17) The walls between inner cavities or passageways and the outer surface of component housings can become so thin that stress concentrations result when pressure is introduced. Because geometries both inside and outside can be complex, it might not be obvious from drawings or even from direct inspection that such thin, highly stressed areas exist. If such walls become too thin, they might rupture under pressure loading. The energy released by the rupture can raise the temperature in the rupture zone. The failed section can expose bare, jagged metal that can oxidize rapidly and heat enough to ignite and burn.

A.6.3(18) A single-barrier failure is defined as a leak in which only the primary containment structure is breached. Such a leak introduces oxygen into a region not normally exposed to oxygen. The materials or configuration of parts in this region might not be compatible with high-pressure oxygen.

Any situation in which a single barrier can fail should be analyzed during the design phase. The single-barrier failure analysis might consist of an engineering evaluation of the configuration, including an analysis of the compatibility of materials exposed by the failure with the high-pressure oxygen. The purpose of the analysis should be to determine if a barrier failure is credible and if exposure of incompatible materials can create a hazard. If the hazard cannot be assessed adequately by analysis, a configurational test can be performed.

A.6.3(19) Standard manufacturers' dimensions and tolerances should be incorporated into designs unless an unusual overriding design constraint demands the change. Additionally, the dimensions of all parts in the valve assembly should be carefully inspected. Ideally, adequate gland size should be provided in the initial design.

A.6.3(20) Polymeric materials cannot be used as seals in valves that control the flow of hot oxygen because they lose sealing properties, ignite easily, and wear rapidly.

High pressures and high flow rates can produce side loads and oscillations on the poppet seal that can cause metal deterioration by fretting or galling. (Galling is the more severe condition, because it involves smearing and transferring material from one surface to another.) Fretting and galling can cause several problems in oxygen systems. The valve poppet might seize, resulting in loss of function. The frictional heat of the fretting or galling can lead to ignition of the valve. The particles generated by the fretting or galling can cause malfunction or ignition of another component downstream.

Where possible, the valve poppet should be designed for symmetrical flow so that no oscillatory side loads are created. The symmetrical flow centers the poppet in the bore and maintains design clearances between the poppet and bore surfaces.

For gaseous systems, it might be possible to reduce the volumetric flow rate, and thus the magnitude of oscillations and side loads, by installing an orifice. The orifice should be downstream of the poppet to minimize the pressure differential across the poppet. It is also possible to flexure-mount the poppet in the bore and to incorporate labyrinth seal grooves in the poppet surface.

To minimize the possibility of ignition, poppet and bore materials should be relatively resistant to ignition caused by frictional heating. Both can be hardened by nitriding or a similar process to minimize material loss by fretting or galling.

A.6.3(21)(a) Cold flow is a concern, especially for organic, nonmetallic materials with little resiliency. With applied loads, these materials permanently deform, usually resulting in sealing loss.

A.6.3(21)(b) Generally, seals with low hardnesses tend to provide better sealing. However, the softer seals will not withstand high temperatures and pressures. When such seals fail, they often extrude, generating particles. Pressure and thermal reversal cycles can also result in seal extrusion. Although silicone seals are not recommended, they can be found in existing oxygen systems. If found, careful examination during maintenance procedures is recommended. Excessive cross-linking of silicone elastomers in oxygen environments can occur, leading to embrittlement and degradation.

A.6.3(21)(c) Copper is often used for oxygen seals. It can provide a very reliable seal; however, at extremely high temperatures, the copper oxide that forms on exposed surfaces can dislodge from the substrate. The oxide is then likely to become a source of particles.

A.6.3(23) Buckling can create component failures.

A.6.4.2.6 Materials are described in Chapter 5 and Annex F. Systems built entirely of suitable materials can still develop the following problems if the pressurized gas flow is either started or stopped abruptly:

- (1) Abruptly starting or stopping pressurized gas flow can result in compression heating at elbows, dead ends, and valves. The resulting temperature rise can be sufficient to ignite all polymeric materials commonly used in gaseous oxygen systems.
- (2) Mechanical shock to the system can dislodge solid particles. If these particles are caught up in the flow and

impinge on a surface, hot spots will result that can cause ignition.

A.6.4.2.9.3 All-metal bellows are difficult to clean and cleaning fluids cannot be completely rinsed off, leading to corrosion.

A.6.4.2.9.4 The risks can be minimized if procedures are written so as to avoid operator error, and to incorporate a long, nonignitable metallic housing at the downstream end of the flexible hose in the design.

A.7.4 See Annex B for information on the training and education of personnel.

A.7.6 An automatic shutoff can also be provided.

A.7.7.1 Most metals burn freely in OEAs (see F.3.4), depending on the concentration and pressure of the oxygen. Electrical contacts likewise can burn away and initiate fires of the nearby insulation or materials unless proven by tests to be suitable for the particular pressure and oxygen concentration in the chamber or system. Apparatus and circuits that have been found to be safe in ordinary atmospheric conditions are not necessarily safe in oxygen concentrations or pressures higher than those of ordinary atmospheres. It is therefore necessary that equipment and circuits be tested for safe use at the maximum pressure and oxygen concentration as well as for the materials that might be in proximity to the electrical equipment or circuits.

A.7.7.2 Because there are no flexible cords available with noncombustible insulation, it is essential for safe operation that portable equipment be used in OEA only if required for life safety and under rigorously controlled conditions.

A.7.8 See ASTM G93.

A.7.8.1 Of particular importance is the removal of lint, dust, and organic matter such as oil and grease. The latter includes fingerprints. These contaminants are ignited relatively easily in oxygen and OEAs and could result in an explosion or a fire. A fire could, in turn, ignite the oxygen container or piping. (A list of ignition mechanisms is found in E.3.1.4 and F.3.2.6.)

A.7.8.2 A variety of cleaning methods is used in practice, including caustic or acid solutions, steam (with or without detergents), hot water (with or without detergents), solvents (with or without vapor-degreasing equipment), supercritical fluids, electropolishing, and sand or shot blasting. The method selected depends on the equipment available, foreign materials present, undesirable side reactions (e.g., acid attack of metals and solvent attack of nonmetals), level of cleanliness desired, ability to dispose of spent cleaning agents, worker exposure to the cleaning agents, and other factors.

A.7.8.3 The level of cleanliness required typically increases with the pressure of gaseous oxygen, and the required level of cleanliness is always high in liquid oxygen systems. Some organizations, including the U.S. military and the National Aeronautics and Space Administration (NASA), use criteria that are more stringent.

A.7.8.4 The reported level of residual organics can be misleading because it is an average level for the surface examined. The organic level actually might be concentrated in one area.

A.7.8.5 Shapes such as those of bellows tubing, Bourdon tubes in pressure gauges, small-diameter piping, dead-legs in piping, crevices in mated pipe threads, and so forth are difficult to clean. Explosions from residual cleaning agents have occurred

within products having these shapes. It is always advisable to fully disassemble components for cleaning, because this mitigates the hazard of remaining solvent. Adequate rinsing and drying time are important.

A.7.9 Total elimination of combustible materials is the ideal objective, though it might not be totally achieved in practice. Combustibles used on exterior support systems or units, such as ventilating, air-conditioning purification, or filter media, as well as auxiliary power and air-oxygen supplies, and any components associated therewith, including hydraulic fluids, gaskets, packing and joint compounds, and lubricants, should be regarded as potential fuels, until otherwise determined by suitable tests.

A.7.10.1(2) In NFPA 99, Chapter 14 covers hyperbaric facilities.

A.7.10.2(3) In NFPA 99, Chapter 5 covers gas and vacuum systems and Chapter 11 covers gas equipment. Hospital requirements were previously covered by NFPA 99, Chapter 13, in the 2005 edition, but have been dispersed throughout other chapters of the code in more recent editions.

A.7.10.3(2) In NFPA 99, Chapter 6 covers electrical systems and Chapter 10 covers electrical equipment.

A.8.2 Fire-extinguishing systems for use in OEAs face many requirements in addition to those required for conventional systems because of ignition susceptibility, increased flame spread rate and burning intensity, and the flammability of normally flame-resistant materials. Therefore, fire-extinguishing agents have to act rapidly to be effective. To protect occupants and real property, they should be inherently nontoxic and should not produce toxic or corrosive decomposition products. In general, these new requirements cannot be satisfied by the simple extension of traditional extinguishment techniques. Emergency personnel should receive special instruction and training, and special extinguishing agents and systems should be selected.

Water has shown to be an effective extinguishing agent in OEA when applied in sufficient quantities. Water at a spray density of 50 L/min/m² (1¼ gpm/ft²) applied for 2 minutes will extinguish cloth burning in 100 percent oxygen at atmospheric pressure. The application method of the water is all-important. Water extinguishing systems should be carefully designed such that all protected space is covered by the minimum spray density and that water is distributed to a depth sufficient to extinguish stratified fires in nonhomogeneous materials — for example, layers of cloth in clothing. New technology in the use of high-expansion, water-based foams has resulted in improved extinguishing properties. However, the applicability of this agent to each particular candidate system should be carefully evaluated with regard to the available space, required time, and application methods. More data has become available on the use of low-expansion foam and dry chemical extinguishing agents in normal atmospheres, but their applicability in OEAs is still unknown.

A.8.6 Because of the explosive nature of fires involving metals in pressurized oxygen systems, fire-extinguishing systems have little effect. For oxygen-enriched fires at atmospheric pressure involving metals (e.g., shop turnings), the fire will burn more intensely in an OEA. Fire-extinguishing systems need to react rapidly and effectively (Topscott et al.).

A.8.8 It has been noted that the underlayer of two layers of cloth can continue to burn even though the outer layer has been wetted and extinguished.

Annex B Training and Education

This annex is not a part of the recommendations of this NFPA document but is included for informational purposes only.

B.1 Training. Personnel should be properly trained in the use of oxygen and oxygen systems and be familiar with the following specific areas.

B.1.1 Personnel who handle and use oxygen or design equipment for oxygen systems must be familiar with its pertinent physical, chemical, and hazardous properties. Personnel should know what materials are compatible with oxygen and the cleanliness requirements of oxygen systems. They should also be qualified to recognize system limitations and how to respond properly to all foreseeable failure modes.

B.1.2 Personnel should be thoroughly familiar with the use and care of protective and safety equipment and with first aid techniques.

B.1.3 Operators should be trained in the selection of proper equipment for handling liquid oxygen and gaseous oxygen and in the procedures for handling spills and leaks and disposing of oxygen. Personnel involved in design and operations should adhere to accepted standards and guidelines and comply with established regulatory codes.

B.2 Education. To aid in the education of designers, the ASTM Committee G-04 has developed a standards technology training course, “Controlling Fire Hazards in Oxygen Handling Systems,” which is accompanied by the course textbook *Fire Hazards in Oxygen Systems*. This course was developed by committee members from oxygen manufacturers, government agencies, equipment suppliers, and users. The course is based on the experience of committee individuals and their respective organizations. Course content was derived from all of the following documents:

- (1) CGA G-4.1, *Cleaning Equipment for Oxygen Service*
- (2) CGA G-4.4, *Industrial Practices for Gaseous Oxygen Transmission and Distribution Piping Systems*
- (3) CGA Video AV-8, “Characteristics and Safe Handling of Cryogenic Liquid Gaseous Oxygen”
- (4) CGA P-14, *Accident Prevention in Oxygen-Rich and Oxygen-Deficient Atmospheres*
- (5) CGA E-2, *Hose Line Check Valve Standards for Welding and Cutting*
- (6) EIGA 33/06/E, *Cleaning of Equipment for Oxygen Service*
- (7) EIGA 5/75/E, *Code of Practice for Supply Equipment and Pipeline Distributing Non-Flammable Gases and Vacuum Services for Medical Purposes*
- (8) EIGA 6/77, *Oxygen Fuel Gas Cutting Machine Safety*
- (9) EIGA 8/76/E, *Prevention of Accidents Arising from Enrichment or Deficiency of Oxygen in the Atmosphere*
- (10) EIGA 12/80/E, *Pipelines Distributing Gases and Vacuum Services to Medical Laboratories*
- (11) EIGA 10/09/E, *Reciprocating Compressors for Oxygen Service*
- (12) EIGA 27/82/E, *Turbo Compressors for Oxygen Service, Code of Practice*
- (13) NFPA 51
- (14) NFPA 53
- (15) NFPA 55

- (16) NFPA 99
- (17) ASTM G63, *Standard Guide for Evaluating Nonmetallic Materials for Oxygen Service*
- (18) ASTM G88, *Standard Guide for Designing Systems for Oxygen Service*
- (19) ASTM G93, *Standard Practice for Cleaning Methods and Cleanliness Levels for Material and Equipment Used in Oxygen-Enriched Environments*
- (20) ASTM G94, *Standard Guide for Evaluating Metals for Oxygen Service*
- (21) ASTM G128, *Guide for the Control of Hazards and Risks in Oxygen-Enriched Atmospheres*

Annex C Utilization of Oxygen-Enriched Atmospheres

This annex is not a part of the recommendations of this NFPA document but is included for informational purposes only.

C.1 General.

C.1.1 Oxygen is a clear, colorless, odorless, and tasteless gas comprising about 21 percent of the atmosphere of the earth. It supports combustion and is necessary for plant and animal life. The concentration of oxygen available in the atmosphere generally is sufficient for human needs during normal conditions of health and for most combustion applications. However, in the treatment of disease, in special types of fuel combustion, and in some chemical processes, an OEA is necessary. In addition, OEAs are employed for life support in closed environmental systems. This annex describes some of these applications as a basis for considering the extent of application of OEAs, the fire hazards associated with their use, and the methods used for eliminating or controlling those hazards.

C.1.2 The degree of fire hazard of an OEA varies with the concentration of oxygen present, the diluent gas, and the total pressure. An OEA is defined as any atmosphere in which the concentration of oxygen exceeds 21 percent by volume or the partial pressure of oxygen exceeds 21.3 kPa (160 torr). Other oxidants include nitrous oxide, nitric oxide, and chlorates. In most commonly encountered OEAs, an increased fire hazard is produced by the increased partial pressure of oxygen (e.g., in

an atmosphere of compressed air) or by the absence of the diluting effect of an inert gas (e.g., in pure oxygen at a pressure $\frac{1}{5}$ atm). An OEA does not, however, by definition produce an increased fire hazard. Certain OEAs can exhibit combustion-supporting properties similar to ambient air, whereas others are incapable of supporting the combustion of normally flammable materials (a decreased fire hazard). The latter case can frequently arise under hyperbaric conditions when the volumetric percentage of oxygen is significantly reduced in a nitrogen or helium mixture, even though the partial pressure of oxygen is equal to or greater than 21.3 kPa (160 torr). For example, a 4 percent oxygen mixture in nitrogen or helium at a total pressure of 12 atm will not support the combustion of paper even though the partial pressure of oxygen is 48.6 kPa (365 torr). A similar condition (i.e., a reduced fire hazard) can exist at very low hypobaric pressure, even though the volumetric percentage of oxygen is significantly high.

C.1.2.1 Table C.1.2.1 compares units of pressure to altitude above or depth below sea level. It also shows the partial pressure of oxygen in a rarefied or compressed-air atmosphere.

C.1.2.2 Figure C.1.2.2(a) and Figure C.1.2.2(b) depict three combustion zones for vertical filter paper strips in hyperbaric mixtures of oxygen-nitrogen and oxygen-helium, respectively. Those combinations of oxygen concentrations and total pressure lying above the 0.21 atm oxygen partial pressure isobar (lower dashed line) are, by definition, OEAs, but they could be located in any of three zones: complete combustion, incomplete combustion, or noncombustion.


C.1.3 OEAs routinely exist or are utilized intentionally in medical practice, industry, underwater tunneling and caisson work, space and deep-sea exploration, hyperbaric chambers, and commercial and military aviation. Such atmospheres are inherent to oxygen processing, transporting, and storage facilities. OEAs can develop inadvertently at any time when oxygen or compressed air is transported, stored, or utilized.

Table C.1.2.1 Partial Pressure of Oxygen in a Rarefied or Compressed-Air Atmosphere

Total Absolute Pressure				Altitude Above or Depth Below Sea Level		Partial Pressure of Oxygen if Atmosphere Is Air	Concentration of Oxygen if Partial Pressure of Oxygen Is 160 torr
				Air or Sea Water			
Atm	torr	psi	kPa	m	ft	torr*	% by Volume
$\frac{1}{5}$	152	2.9	20	11,735	38,500	32	100.0†
$\frac{1}{3}$	253	4.9	33.8	8,832	27,500	53	62.7†
$\frac{1}{2}$	380	7.3	50.3	5,486	18,000	80	42.8†
$\frac{2}{3}$	506	9.8	67.6	3,353	11,000	106	31.3†
1	760	14.7	101.4	Sea level	—	160	20.9
2	1,520	29.4	202.7	-10	-33	320†	10.5
3	2,280	44.1	304.1	-20	-66	480†	6.9
4	3,040	58.8	405.4	-30	-99	640†	5.2
5	3,800	73.5	506.8	-40	-132	800†	4.2


* This column shows the increased available oxygen in compressed-air atmospheres.

† Oxygen-enriched atmosphere.

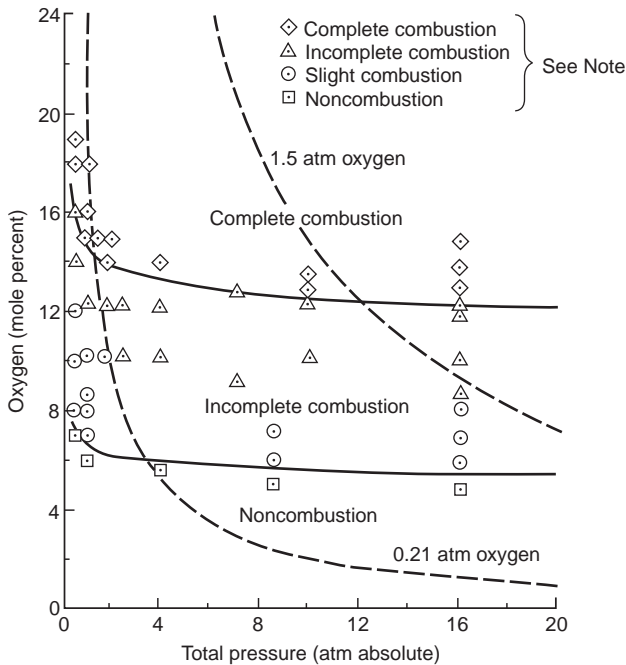

Note: **Complete Combustion:** The filter paper strip burns completely.
Incomplete Combustion: The filter paper strip burns for a length greater than 1 cm (2.54 in.) from a resistance wire igniter, but the flame extinguishes itself before the strip is completely consumed.
Slight Combustion: The filter paper strip flames or smolders, but does not burn more than 1 cm (2.54 in.) from the resistance wire igniter.
Noncombustion: No ignition.

FIGURE C.1.2.2(a) Illustration of Varying Degrees of Combustion in an Oxygen-Nitrogen Oxygen-Enriched Atmosphere. (Courtesy of *Journal of Fire and Flammability*.)

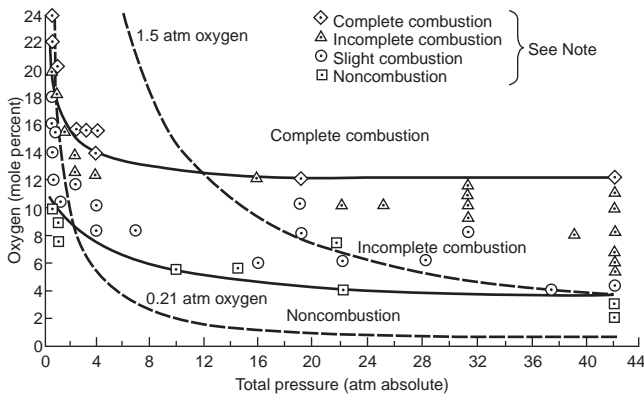

Note: **Complete Combustion:** The filter paper strip burns completely.
Incomplete Combustion: The filter paper strip burns for a length greater than 1 cm (2.54 in.) from a resistance wire igniter, but the flame extinguishes itself before the strip is completely consumed.
Slight Combustion: The filter paper strip flames or smolders, but does not burn more than 1 cm (2.54 in.) from the resistance wire igniter.
Noncombustion: No ignition.

FIGURE C.1.2.2(b) Illustration of Varying Degrees of Combustion in an Oxygen-Helium Oxygen-Enriched Atmosphere. (Courtesy of *Journal of Fire and Flammability*.)

C.1.4 Oxygen is stored either in its liquid state or as a compressed gas. Compressed-gas storage pressures are variable and can be as high as 52 MPa (gauge pressure of 7500 psi). The density of oxygen in such conditions is high, and the fire hazard within pressure-containing components greatly increases.

C.1.4.1 Liquid oxygen is the most concentrated common source of oxygen. Contamination of liquid oxygen with most organic substances often renders the mixture subject to violent explosion.

C.1.4.2 Most common textile materials, including clothing, that become contaminated with oxygen are susceptible to rapid combustion. However, certain specialized materials, such as glass fabric, are not susceptible to combustion in OEAs. Other special materials burn less rapidly than common textiles in OEAs. (See Annex F.)

C.1.4.3 Whenever liquid oxygen is exposed to materials at ambient temperatures, rapid warming and evaporation of the liquid take place. OEAs are created around and within the materials upon which the liquid is spilled.

C.1.5 Nitrous oxide, a stable, nontoxic oxide of nitrogen, is widely employed for medical and industrial uses. As a gas, nitrous oxide is useful as a mild anesthetic agent. It also is used as a combustion-enhancing agent in racing vehicles. In industry, nitrous oxide is used as a propellant for a variety of aerosol products. It is used as a liquid refrigerant for the rapid freezing of certain food products.

It should be noted that an OEA can develop in situations in which nitrous oxide is employed.

C.1.6 The use of other oxidants, such as chlorine, chlorates, nitric oxide, and ozone, can result in enhanced combustion. Appropriate safety literature, such as material safety data sheets, should be reviewed before using these oxidants.

C.2 Processing, Transport, Storage, and Dispensing of Oxygen.

C.2.1 Preparation of oxygen conventionally involves the compression of air, followed by cooling and re-expansion, a cycle that is repeated until the temperature of the air falls below the oxygen's critical temperature, causing it to liquefy. Fractional distillation of the liquid air then separates its various gaseous components. The oxygen is collected and can be stored as a compressed gas or as a liquid. Oxygen is also separated from air by adsorption and membrane-based systems.

C.2.2 Oxygen is transported to the consuming facility as a compressed gas or as a liquid, or it is transmitted by pipeline. NFPA 55 covers these applications.

C.2.2.1 Transport of liquid oxygen to the site of the consuming facility is usually in cryogenic tank trucks. Spillage of liquid oxygen during transport or during transfer from the tank can create OEAs.

C.2.3 When gaseous oxygen is dispensed at the consuming facility, it is drawn from the storage container(s) through pressure-reducing regulators and interconnecting piping.

C.2.4 Leakage or venting of oxygen from any storage or dispensing equipment can create an OEA. (See C.8.1.)

C.2.5 Contamination of any pressure-containing component of an oxygen storage or dispensing system with any flammable or

combustible substance, such as oil, grease, solvents, dust, lint, or any organic substance, can produce a serious fire or explosion hazard.

C.2.6 Consult NFPA 55 for the installation of storage systems.

C.3 Medical Applications.

C.3.1 OEAs have been associated with inhalation anesthesia since the development in 1887 of a gas anesthesia apparatus incorporating means of administering oxygen and nitrous oxide. The use of such a machine allows for both the anesthetization of patients and the often necessary administration of high-oxygen concentrations. The use of a flammable volatile liquid or gaseous inhalation anesthetic agent in such an atmosphere creates severe fire and explosion hazards. Prior to the formation of the NFPA Committee on Health Care Facilities, a significant number of fatalities and injuries resulted from operating room fires and explosions. Such incidents have been drastically reduced through widespread adherence to the provisions of NFPA 99.

The reduction in use of flammable anesthetics in operating rooms has allowed for increased use of potential ignition sources (electrosurgical units, lasers, etc.). Advances in materials science have also introduced polymers (endotracheal tube) and fabrics (drapes and gowns), some of which are flammable in air, but all of which are flammable in the OEA of operating rooms. Therefore, the operating room environment continues to present fire hazards.

C.3.2 Since the early 20th century, the therapeutic value of oxygen in the treatment of respiratory and allied disorders has been recognized by the medical profession. In consequence, inhalation therapy, including ventilator-support of patients, currently is widely practiced. Most hospitals of larger size are equipped with central oxygen-piping systems for use in patient care facilities throughout the hospital. Recognizing the potential hazards of OEAs created by such use, NFPA published NFPA 56F and NFPA 56B, both of which are now part of NFPA 99.

C.3.2.1 Because ambulatory patients as well as hospital patients might require respiratory therapy, some patients purchase or rent therapy equipment, oxygen cylinders, oxygen concentrators, and liquid oxygen containers for use in their homes. Thus, the medical applications of OEAs are not limited to locations within hospitals.

C.3.2.2 Chapter 14 of NFPA 99, 2005 edition, covers nonhospital use.

C.3.3 Ambulances, rescue squads, fire and police vehicles, and swimming pools are often equipped with oxygen for resuscitation and life-support purposes. Use of oxygen in such an enclosed space can create a hazardous OEA.

C.3.4 The medical profession uses hyperbaric chambers to allow supersaturation of patients with oxygen. The patient, with or without attendants, is placed in a hyperbaric chamber that is sealed and pressurized, sometimes to 4 atm absolute or greater. Generally, pressurization is accomplished with compressed air, and the patient breathes pure oxygen from a mask. However, in some single-occupant (patient only) chambers, the atmosphere is pure oxygen. Although there might be some flammability-inhibiting effect of the increased nitrogen present in compressed air, this effect is more than offset by the increased

partial pressure of the oxygen present (up to 5 atm). (*See Chapter 14 of NFPA 99 for more information on hyperbaric facilities.*)

A particularly hazardous OEA exists in a chamber pressurized with oxygen or in a compressed-air chamber with inadequate ventilation when pure oxygen is spilled from the therapy apparatus; therefore adherence to Chapter 14 of NFPA 99 is highly recommended.

C.4 Industrial Applications.

C.4.1 Oxygen, as an industrial gas, is in widespread use in a variety of industries. Furthermore, its use continues to increase in new applications where additional environmental or service conditions can place severe demands on equipment, materials, and systems. Elevated temperatures, high corrosivity, and reduced contamination levels are factors, in addition to flammability, that need to be considered, because they could limit the options of materials selection for oxygen services in advanced applications.

C.4.2 In the petrochemical industry, large quantities of oxygen are utilized for partial oxidation of gaseous and liquid organics and coal to prepare other products. These products include alcohols, aldehydes, and syngases. Elevated-temperature stability, corrosion resistance, and oxygen compatibility can limit use to certain alloys that are resistant to ignition and combustion in oxygen.

C.4.3 In the steel industry, oxygen is used to refine steel in the basic oxygen furnace as well as to lance molten steel in several operations. Oxygen-fuel burners are used to reheat ingots and slabs and to preheat ladles. Oxygen-fuel burners are also used in glass furnaces. Generally, materials selection issues and operating practices have been well defined in the steel industry.

C.4.4 In the metal fabrication industry, oxy-fuel burners are used to weld, cut, braze, silver-solder, and harden various metals. This work is done in large and small factories, automobile repair shops, and home workshops. NFPA 51 and NFPA 51B cover such applications.

C.4.5 In the mining industry, oxygen is used to refine copper, gold, and other metals by means of pressure oxidation processes, where sulphurous “refractory ores” are mined. Elevated temperatures and severe corrosivity place severe limitations on materials selection options.

C.4.6 Oxygen, as an alternative to air, is widely used for secondary treatment of both municipal and industrial wastewaters. Ozone from oxygen is sometimes used as an intermediate or for tertiary water treatment. Increased corrosivity might be experienced in certain wastewaters that contain both oxygen and ozone. Ozone will aggressively attack certain nonmetallics.

C.4.7 Further developments in hazardous waste disposal include incineration involving OEAs and wet oxidation where supercritical water is used to dissolve and oxidize hazardous species. Supercritical wet oxidation is a particularly challenging environment for structural materials because it involves high temperatures, high pressures, and corrosive species.

C.4.8 Ultra-high purity (UHP) oxygen is used to manufacture microchips in the semiconductor industry. The need to eliminate contaminants to reduce chip defects results in ultraclean systems that reduce the tendency towards promoted ignition-combustion scenarios. However, the presence of UHP oxygen can increase the flammability hazard with certain metals and nonmetallics. Aluminum alloys are a prime example of materials that show a dramatic increase in flammability when exposed to UHP oxygen (99.999+ percent). (See F.3.4.4.)

C.4.9 The paper and pulp industry uses extensive amounts of oxygen in the bleaching and delignification processes as an alternative to chlorine. The use of ozone in this industry might also increase. Materials selection issues are similar to those encountered in various other processes where oxygen and aqueous environments are involved.

C.4.10 As a result of new technologies, the oxygen concentration of systems originally designed for air can be increased by a small percentage to increase efficiency. Such systems, which might not have been cleaned initially for oxygen service or designed with oxygen-compatible or combustion-resistant materials, would be unique. The systems should be treated on an individual basis with respect to issues such as cleaning, filtration, degree to which the oxygen levels are increased, and so forth.

C.4.11 Oxygen fireflooding is an example of a tertiary, enhanced oil recovery process that has been pilot tested. Oxygen is injected at high pressures into heavy oil deposits that cannot be recovered by primary or secondary oil recovery techniques. Downhole combustion of heavy oil results in high temperatures, high corrosivity when water is present, and increased oil mobility, allowing recovery at collection wells. Oxygen fireflooding requires careful system design and special operating procedures for the safe production of heavy oils.

C.4.12 In many applications, the motivation to use oxygen is driven by at least one of many factors, including the following:

- (1) Higher combustion temperatures
- (2) Higher purity gaseous product (no nitrogen from air)
- (3) Higher output from a given size reactor (often in conjunction with debottlenecking a process)
- (4) Higher conversion efficiency
- (5) Reduced combustion emissions (NO_x emissions can be reduced without the nitrogen from air)
- (6) Previously unobtainable production from mineral or oil deposits

Service environments might limit or eliminate the use of many materials that can be selected on the basis of combustion resistance in OEAs. Experimental programs might be needed to optimize materials selection and system design problems in advanced oxygen applications for safe operation.

C.4.13 Large users of oxygen are generally supplied by a pipeline from a nearby oxygen plant that uses cryogenic distillation. Smaller user requirements can be met by liquid oxygen that is transported by truck to a storage tank at the site, from a membrane or adsorption oxygen generator at the site, or from high-pressure cylinders. Requirements for system design, materials selection, cleaning, safe operation, and so forth are well established for oxygen supply systems.

C.5 Caisson Work and Underwater Tunneling. When driving a tunnel under or setting a foundation on a river bed, it might be necessary to seal off the work area with an airtight compartment and elevate the air pressure therein to prevent the pressure of the overlying water from inundating the compartment with mud or water. For every 10 m (33 ft) of depth of water outside the compartment, the pressure therein needs to be raised 1 atm to compensate (see Table C.1.2.1). An OEA exists within the compartment while it is pressurized.

C.6 Space and Deep-Sea Exploration.

C.6.1 Liquid oxygen is employed as the oxidizer in liquid propellant rockets, and gaseous oxygen is used in the breathing atmospheres of spacecraft and spacecraft simulators. OEAs also exist in certain deep-sea diving equipment.

C.6.2 Liquid-fueled rockets employ liquid oxygen as the oxidizing agent. OEAs can, and generally do, develop from blow off and leakage whenever the rocket is tanked or while it is standing in readiness.

C.6.3 The practice of using aviator breathing oxygen (ABO) for spacecraft life-support systems has been the normal practice in the past and might be required in the future for long-duration missions. Previous space programs, such as Gemini, Mercury, and Apollo, used an ABO atmosphere in life-support systems. An OEA is currently used in the space shuttle program. During normal operations, the orbiter oxygen concentration can reach as high as 25.9 percent oxygen due to calibration margins in the control and caution/warning systems. Prior to each extravehicular activity (EVA), the orbiter atmosphere is changed to a 30 percent oxygen atmosphere at 70.3 kPa (absolute pressure of 10.2 psi). This 30 percent oxygen atmosphere is used for 6 to 10 hours prior to the actual EVA to precondition the crew for the space suit environment of 34.5 kPa (absolute pressure of 5 psi) 100 percent ABO atmosphere.

C.6.3.1 The space station is designed to operate at 70.3 kPa (absolute pressure of 10.2 psi) with a 30 percent oxygen atmosphere until it is permanently manned. The current schedule is for the space station to be occupied only when a shuttle is docked for the first 5 to 6 years of operations. Once the space station is permanently occupied, it is expected to operate at 1 atm with up to 25 percent oxygen concentration. The space station will have a hyperbaric chamber to treat the bends, if necessary. This chamber will be operated at 4 atm at 21 percent oxygen concentration and used only in an emergency.

C.6.3.2 The oxygen concentration on the spacecraft can be increased by leakage in the primary oxygen supply system or the emergency oxygen system. This situation has occurred in the orbiter cabin several times over the years. A leak in one of the systems caused the cabin oxygen concentration to reach 35 percent for a few hours. Once the leaks were found and corrected, the oxygen concentration was reduced to normal limits within a short time.

C.6.4 Experimental and conventional deep-sea diving equipment, including pressure chambers, will contain an OEA if the partial pressure of oxygen exceeds 21.3 kPa (160 torr).

C.7 Commercial and Military Aviation.

C.7.1 All high-altitude commercial aircraft of moderate and large size are equipped with emergency oxygen breathing systems for use in case of failure of normal equipment. All military high-performance aircraft are equipped with similar systems for routine use. Pressure within the components of such a system range from 12,411 kPa to 15,169 kPa (gauge pressure of 1800 psi to 2200 psi) in storage cylinders and from 103 kPa to 483 kPa (gauge pressure of 15 psi to 70 psi) in the dispensing system.

C.7.1.1 Use of such a system during flight can result in the development of an OEA at the site or sites of such use. Where use is routine, as in military applications, proper personnel indoctrination and the exercise of proper precautions tend to mitigate the frequency of incidents. However, in commercial aircraft, safety demands that the “no smoking” provisions be rigidly enforced during system use.

C.7.2 OEAs can develop in or around aircraft during servicing of oxygen systems. Chapter 5 of NFPA 410 covers this application. In general, proper personnel indoctrination and the exercise of proper precautions tend to mitigate the frequency of incidents.

Contamination of an aircraft oxygen system with oil, grease, or any flammable or combustible substance will create a hazardous situation.

C.7.3 Oxygen is more soluble than nitrogen in aircraft fuel. If such fuel is exposed to air for a significant interval, enough oxygen can dissolve in the fuel and come out of the solution (as gaseous oxygen) during flight because of the decreased atmospheric pressure, to create a hazardous OEA.

C.8 Inadvertent Utilization.

C.8.1 An inadvertent OEA can be created due to use of improper design, malfunction, or improper use of oxygen storage or dispensing equipment. Leakage of oxygen from, or improper use of, such equipment can create an OEA, especially if the equipment is stored or used in a confined or poorly ventilated space. Such an atmosphere is especially dangerous because personnel might not be aware that oxygen enrichment exists.

C.8.1.1 An OEA can be created inadvertently by the use of oxygen to ventilate closed compartments, either intentionally or because of a mistaken belief that the terms “oxygen” and “air” are synonymous.

C.8.1.2 An OEA can develop inadvertently if an oxygen stream is employed in lieu of compressed air to clear sawdust or metallic chips from wood or metalworking equipment.

C.8.1.3 An OEA can be created inadvertently within insulation on piping and equipment containing materials at temperatures below the condensation temperature of oxygen (e.g., liquid hydrogen or nitrogen) if the oxygen in atmospheric air is condensed within the insulation.

C.8.1.4 An OEA can be created inadvertently within a vented storage vessel containing liquid air due to the preferential evaporation of nitrogen.

C.9 Reference. Dorr, V. A. “Fire Studies in Oxygen-Enriched Atmospheres.” *Journal of Fire and Flammability*, Vol. 1, 1970, pp. 91–106.

Annex D Fire Experience

This annex is not a part of the recommendations of this NFPA document but is included for informational purposes only.

D.1 Introduction.

D.1.1 This annex is a compilation of reports of fires and explosions involving both intentional and inadvertent OEAs that have been reported to NFPA.

D.1.2 This compilation is by no means a record of all such incidents that have occurred. Many incidents are not reported to NFPA or even to local authorities.

D.1.3 The purpose of this annex is to present examples that illustrate the common manner in which ostensibly diverse circumstances result in similar accidents. Because the sources of data vary, NFPA cannot guarantee the accuracy of the reports. However, each report has been subjected to expert review by the Committee on Fire Hazards in Oxygen-Enriched Atmospheres and is believed to be consistent with present theory.

D.2 Utilization of OEAs.

D.2.1 Oxygen Production, Transportation, and Transfer.

D.2.1.1 A reciprocating oxygen transfer pump, operating at 6895 kPa (gauge pressure of 1000 psi), had nitrogen seals in the crosshead section to prevent contamination of oxygen with lube oil from crankcase or crosshead areas. A seal(s) failed and there was an explosion within the pump, projecting parts as far as 91 m (300 ft). The loss estimate was \$20,000.

D.2.1.2 Explosion and fire occurred in the filter of high-pressure oxygen pump equipment. The equipment was used for charging inhalation and self-contained breathing equipment oxygen cylinders. It was concluded that the explosion was due to the presence and burning of an oxidizable material in the bottom of the filter. The oxidizable material might have been glycerine that was used for lubricating the pump.

D.2.1.3 An explosion, believed to have been initiated in a hydrocarbon buildup in the reboiler of an oxygen column, destroyed the column. The column, 30 m (99 ft) high and varying in diameter from 6.7 m to 11 m (22 ft to 36 ft), was insulated with a fine granular and noncombustible material. The adjacent insulation silo was also destroyed. The loss estimate was \$830,000.

D.2.1.4 Probably as the result of excess wear on Teflon® rider rings on a compressor piston rod, lubricating oil escaped into an oxygen cylinder, where ignition occurred. Steel and brass parts were consumed or damaged in the fire, while a sudden release of high-pressure oxygen out of the suction manifold and into the building caused steel walls to buckle or blow out. A deluge system protected a 373 kW (500 hp) synchronous motor. The loss estimate was \$125,000.

D.2.1.5 There have been several incidents involving vacuum-insulated liquid oxygen (LOX) tanks and pipelines in which palladium oxide getter packets used for vacuum maintenance have been implicated as an ignition source. The function of palladium oxide, as it is used in vacuum maintenance, is to react with off-gassed hydrogen to form water. Over a period of time, the palladium oxide can be reduced to finely divided palladium metal or palladium hydride.

If liquid oxygen is introduced suddenly into a vacuum by failure of a structural joint, the reduced palladium oxide might undergo an exotherm, which could ignite the superinsulation. A recommended solution is to make certain that palladium oxide is suitably encapsulated within a heat sink to ensure that the exotherm does not accelerate if liquid oxygen is inadvertently introduced into the vacuum space.

D.2.1.6 A seismic survey vessel was destroyed and three individuals were killed as a consequence of an incident involving a 7570.8 L (2000 gal) liquid oxygen tank carried on board the ship for seismic experiments. The investigation concluded that excessive force applied to a valve stem sheared the stem collar. The internal tank pressure was approximately 413.7 kPa (gauge pressure of 60 psi).

An oxygen cloud spread over the ship. There was no shortage of combustibles. Steel deck plates were embrittled and cracked. Several flashes preceded an explosion. The precise ignition source is unknown. During the post-accident investigation, questions were raised about the system maintenance, personnel awareness of oxygen hazards, and the absence of fail-safe backup shutoff valves. The loss estimate was \$1,250,000.

D.2.1.7 A 4921 L (1300 gal) aluminum LOX tank truck exploded shortly after a delivery to a customer's tank. Two individuals were killed. The explosion occurred shortly after one of the individuals reported that a submerged transfer pump was not working properly. Improper bearing lubrication and pump reversal due to improper maintenance procedures were possible causes of the pump failure. Approximately 3.6 kg (8 lb) of aluminum from the pump was consumed. All submerged pumps were removed from service and replaced with external pumps.

D.2.1.8 A LOX tank truck exploded after making a delivery to a hospital. Two individuals were killed. Approximately 73.5 kg (162 lb) of aluminum was consumed and contributed to the intensity of the explosion. The definitive cause of the accident was not firmly established. It is believed that various factors contributed to contaminant buildup. This buildup provided a kindling chain, causing further participation of aluminum in the scenario.

D.2.1.9 Ignition occurred in the electric-motor or the electric-motor bearing of a LOX transfer or the process pumps operated in the industry from very low pressure up to 10 MPa (absolute pressure of 1450 psi). Oxygen enrichment of the electric-motor itself or of the electric-motor-driven end bearing led to a "flash fire," and significant combustion of the electric-motor and the roller bearing.

A first root cause of the oxygen enrichment was due to an oxygen leak from the cold end across the seal system of the pump, due to a mechanical issue with the seal system (i.e., the mechanical seal, labyrinth seal, or dry gas seal).

A second root cause of ignition was due to the lubricant used for the electric-motor bearing.

Safeguards were installed to prevent oxygen enrichment of the electric-motor bearing. Appropriate instrumentation to detect oxygen leakage was installed (e.g., using pressure differential across the seal system and low-temperature detection). In addition, the electric-motor-bearing lubricant was selected based on the required mechanical properties and on the LOX pump manufacturer's instructions.

D.2.2 Medical.

D.2.2.1 Improper maintenance of a device used with oxygen led to this fire. A humidifier was used alongside a 2-year-old child's crib fitted with an oxygen tent. There were indications of low water in the humidifier, of failure of its thermal safety feature, and of fire originating in its blower, feeding on accumulated dust and lint. The flames were blown into the oxygen tent, where the little girl was burned to death.

D.2.2.2 A patient in a semiprivate room awoke and saw the oxygen tent on the other bed afire. He set off the alarm, but the patient in the tent could not be rescued before he died. Extensive investigation failed to positively reveal the source of ignition, but a cigarette butt was found on the bed table as well as the remains of a book of matches in the victim's bed.

D.2.2.3 A pressure regulator, which had been in service for some time, had just been disconnected from a cylinder and connected to another cylinder to maintain oxygen to an infant's incubator oxygen tent. When the cylinder valve was turned on, the regulator components ignited and rapid burn-through occurred. The infant was killed and five persons were injured in the resulting flash fire. Adiabatic compression ignition in the regulator was the probable cause of this fatal fire.

It should be noted that other well-documented cases suggest that shock, friction, or compression heating from the sudden opening of a high-pressure oxygen valve can cause ignition of valve or regulator components without intervention of foreign combustibles. Regulators should always be in the closed position (fully backed off) when opening valves on oxygen cylinders.

D.2.2.4 A tracheotomy was being performed on a 33-year-old ventilator-dependent woman with multiple medical problems. She was anesthetized with intravenous agents and ventilated with 100 percent oxygen via a polyvinyl chloride (PVC) endotracheal tube that passed through her mouth into her trachea. Fifteen minutes after the anterior neck incision, and during the use of electrocautery, a loud "pop" was heard followed by a fire in the surgical field. Moist towels were used to extinguish the fire, and the charred endotracheal tube that had ignited was replaced with a tracheotomy tube. Examination revealed a burn of the trachea. The patient tolerated the remainder of the procedure well but died 1 month later from underlying multiple medical problems. (1)

D.2.2.5 During a tonsillectomy on a 4-year-old boy under approximately 50 percent oxygen, 50 percent nitrous oxide, and 1 percent halothane general anesthesia, fire "blow-torched" from the mouth. The fire was extinguished by a combination of deluge with saline solution and cessation of the flow of OEA caused by occlusion of the charred PVC endotracheal tube, which was immediately replaced. The patient's burns of the tongue, pharynx, and trachea were managed in an intensive care unit, and he was discharged 5 days later. Ignition of the PVC tube occurred during electrocauterization of bleeding vessels adjacent to the tube in the oxygen- and nitrous oxide-enriched anesthetic atmosphere. (2)

D.2.2.6 A 56-year-old man with a vocal cord polyp was anesthetized with 66 percent nitrous oxide, 33 percent oxygen, and up to 1.5 percent isoflurane for surgical resection of the polyp using a CO₂ laser. The anesthetic gases were administered via an endotracheal tube, specifically manufactured for CO₂ laser surgery, consisting of a silicone rubber shaft externally coated

with a silicone rubber layer containing metal particles. After excision of the polyp and during control of vocal cord bleeding using the laser, smoke emerged from the mouth, flames emerged from the endotracheal tube, and flames were noted within the tubing of the anesthesia breathing circuit. The flames were extinguished with saline solution, and the burned endotracheal tube was replaced. The patient suffered extensive burns of the trachea and bronchi, from which he eventually recovered.

Examination of the burned endotracheal tube revealed combustion of the cuff, which had been filled with saline solution to isolate the anesthetic gases within the breathing circuit and lung, and combustion of the distal shaft. The CO₂ laser had most likely perforated the cuff and then ignited the silicone rubber in the oxygen- and nitrous oxide-enriched atmosphere. (3)

D.2.2.7 The use of a dry gauze pad in an oxygen-enriched atmosphere led to a fire in the incision site. A gauze pad was placed in the incision site during a lung resection. The dry pad was being used to blot blood from the tissues. At the time the fire occurred, an electrosurgical unit (ESU) was being used to cauterize a bleeder immediately next to the gauze. The lung lobe had already been resected, and oxygen was flowing out of the resected area, enriching the operative site. The oxygen enriched the gauze and allowed it to be easily ignited by the ESU. The burning gauze pad was thrown to the floor and extinguished without any apparent injury to the patient. (4)

D.2.2.8 The creation of an OEA, caused by an open oxygen source and a spark from the operative site, allowed this fire to occur. A patient was having several skin lesions removed from her right breast. She had been given a tranquilizer and was being given oxygen with a face mask at a flow rate of approximately 4 L/min (1.06 gal/min). The surgeon had initially removed a lesion from her neck without incident. The window in the surgical drape was then moved down toward her right breast. This area was prepped in the usual fashion with an iodine solution, and the incision site was anesthetized with a local anesthetic. During use of the ESU, the surgeon stated that a spark flew from the operative site toward the edge of the surgical drape.

The method of flame propagation in this case is not absolutely clear, but surface-fiber flame propagation was involved. The following two possibilities are likely:

- (1) The nap fibers on the reusable drape burned.
- (2) The patient's fine body hair burned and rapidly spread the fire under the surface of the drape toward the patient's face.

The fire then ignited the oxygen mask and resulted in some minor burns to the patient's face and neck. (5)

D.2.2.9 An OEA, created by the presence of oxygen and nitrous oxide, allowed easy ignition of facial hair. A patient was undergoing oral surgery with general anesthesia maintained through a nose mask with a concentration of 25 percent oxygen, 75 percent nitrous oxide, and a small percentage of halogenated anesthetic. The patient had a moustache.

As the surgeon was grinding a filling with a tungsten-carbide bur, an incandescent spark flew from the bur and arced out of the patient's mouth, over his upper lip, and landed in his moustache. Because of the oxygen- and nitrous oxide-enriched atmosphere, the moustache immediately burst into flame and

ignited the nasal mask. The fire then flashed back toward the anesthesia machine along the gas delivery hoses. As soon as the fire was noticed, the nasal mask was removed from the patient's face, but not before significant burning of his nose and upper lip had occurred. (6)

D.2.2.10 Improper use of an oxygen concentrator caused the following fire. A patient requiring oxygen therapy was at home using an oxygen concentrator with a nasal cannula. While grinding metal in his shop, grinding sparks ignited the nasal cannula. He pulled the tubing from his face and was slightly burned in the incident. (7)

D.2.2.11 A 4-year-old male child (patient) and a 62-year-old female (grandmother of the patient) were placed inside a monoplace hyperbaric chamber (NFPA Class B), which was pressurized with 100% oxygen to a depth of 1.75 atm (gauge pressure of 11.01 psi). Patient and grandmother were wearing their own clothing; they did not change into garments provide by the treating facility as the facility did not provide garments. Approximately 20 minutes into the therapy session, a fire started inside the hyperbaric chamber. The grandmother expired less than 24 hours after removal from the hyperbaric chamber and the patient expired approximately 40 days after removal — both due to thermal burns from the hyperbaric chamber fire.

Attributing to the cause of the fire was electrostatic discharge inside the hyperbaric chamber and failure to follow NFPA 99, 2005 edition, as cited and described, but not limited to, the following:

- (1) 20.2.7.4.1 — Failure to properly ground the chamber
- (2) 20.3.1.3.5 — Failure to conduct routine maintenance
- (3) 20.3.1.4.4 — Failure to have an emergency procedure for an in-chamber fire
- (4) 20.3.1.4.7 — Failure of chamber staff to be physically present
- (5) 20.3.1.5.3.2 — Failure to ground patient
- (6) 20.3.1.5.7 — Failure to ensure appropriate garments
- (7) 20.2.8.2.1 — Failure to provide an intercommunication system

Reference: Broward County Complaint Affidavit. Offense Report LS09-05-10. Filing Agent BSO.

D.2.2.12 Over 30 fires were reported to the Food and Drug Administration (FDA) in the 1990s that involved aluminum-bodied medical oxygen regulators. These incidents were reported to have caused severe burns to health care workers and patients, and each fire was described as “explosion-like” when the fire erupted from the regulator body. Many of the incidents occurred during emergency medical use or during routine equipment checkouts. The incidents led to at least one fatality. Catastrophic burnout of the aluminum-bodied regulator and a release of oxygen into the surroundings, sometimes causing secondary fires, was characteristic of each of these incidents. Depending on the circumstances of the incident, the active ignition mechanisms were reported to include particle impact, contaminant-promoted ignition, and adiabatic compression. Several of the fires were believed to have been caused by particulate debris entrained in the oxygen flow stream that originated in the high-pressure cylinders. Each incident reported exhibited unique characteristics for ignition; however, the regulator design allowed aluminum to be exposed to the active ignition mechanisms, which resulted in sustained combustion of the aluminum regulator body in high-pressure oxygen. The

FDA eventually issued a safety alert on the regulator design and a mandatory recall of these medical devices was initiated.

Reference: Newton, B. E., Hull, W. C. and Stradling, J. S., "Failure Analysis of Aluminum-Bodied Medical Regulators," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Ninth Volume*, ASTM STP 1395, T. A. Steinberg, H. D. Beeson and B. E. Newton, Eds., American Society for Testing and Materials, West Conshohocken, PA, 2000.

D.2.2.13 In early 1997, eight fires were reported to the Food and Drug Administration (FDA) that involved cylinder valves installed on M6-, M7-, and M9-sized medical cylinders. The following elements were common in each of the reported incidents:

- (1) All incidents involved medical oxygen cylinders and cylinder valves
- (2) All oxygen cylinders and cylinder valves were manufactured in 1996 or 1997
- (3) All oxygen cylinders were constructed of aluminum
- (4) All cylinder valves contained polychlorotrifluoroethylene (PCTFE) plastic seats
- (5) All ignitions were understood to have occurred upon opening the cylinder valve for the first time after the cylinder was filled
- (6) The cylinder valve PCTFE plastic seat ignited in each incident
- (7) Patients who were breathing from the cylinder gas reported a strong "chlorine odor"
- (8) A regulator and/or conserver were attached at the time of each reported incident

The fires resulted in a recall of approximately 8000 cylinders that matched the dates in question. While all of the fires were understood to have initiated upon opening the cylinder valves, some of the cylinders had been filled, emptied, and refilled as many as four times prior to an incident.

The dimensional stability of PCTFE valve seats used in gas cylinder valve and regulator applications was suspected as a causative factor due to severe extrusion that was observed in exemplar valves. Therefore, the stability of the PCTFE seats was evaluated by thermomechanical analysis (TMA). The testing focused on two commercial grades of PCTFE — Kel-F 81[®] and Neoflon[®] M440H — including actual PCTFE valve seats obtained from different manufacturers. The effects of resin grade, percent crystallinity, and process history on TMA heat deflection were evaluated. The testing indicated that significant property variation within the PCTFE resin family could result from the thermal history during molding and machining operations. Such property variation could cause severe loss of the mechanical properties and lead to severe extrusion for normal valve seat loads. When exposed to high-pressure oxygen dynamics and flow transients, ignition was believed to result as the plastic seat extruded from loading that was well beyond the diminished mechanical properties. As a result of these fires, ASTM International G04 and D20 subcommittees worked jointly to develop specifications for properly molding and machining PCTFE materials to help avoid the property losses that were believed to have led to these fires (see ASTM D7211 and D7194).

Reference: Waller, J. M., Newton, B. E., Haas, J. P., Beeson, H. D., "Comparison of the Dimensional Stability of Kel-F 81 and Neoflon CTFE M400H polychlorotrifluoroethylenes used in Valve Seat Applications," *Flammability and Sensitivity of Materi-*

als in Oxygen-Enriched Atmospheres: Eighth Volume, ASTM STP 1395, T. A. Steinberg, H. Barthelemy, Beeson, H. D., Newton, B. E., Eds., American Society for Testing and Materials, West Conshohocken, PA, 2000.

D.2.3 Cutting and Welding.

D.2.3.1 A gunsmith in a sporting goods store was loosening the connections on a used oxygen cylinder (part of a welding outfit) with greasy hands and a wrench. A mechanical spark ignited the grease in the OEA, burning the gunsmith on the hands and arms and starting a fire in the store. The loss estimate was \$100,000.

D.2.3.2 A pressure gauge, previously used to test the pressure in a hydraulic system, was installed on an oxygen system and exploded when the system was turned on. The chief mechanic received facial cuts when the gauge exploded in his face.

D.2.3.3 A construction pipe fitter/welder received severe second- and third-degree burns of the face and neck when a welding spark ignited the clothing and the oxygen-fed sandblaster's hood that he was wearing. The employee was working in a small tunnel where there was little air circulation. On his own initiative, he obtained a sandblaster's hood, fabricated of heavy plastic, and connected that air line directly to a tank of oxygen.

The employee was working in a prone position when a spark ignited his clothing and, following the stream of oxygen, the flame flared up inside the hood, igniting the hood and his clothing. His presence of mind in holding his breath until the hood was removed probably saved his life and, without question, his eyes were saved by the goggles he was wearing.

D.2.3.4 A workman was welding in an open ditch where the nature of the work required that he wear an air-line respirator. Because no respirable compressed air was readily available, an oxygen tank with a pressure-reducing and pressure-regulating valve was attached to the inlet end of his air-supply hose. A spark from the welding came in contact with the facepiece, which, of course, was surrounded with oxygen-enriched air from the exhalation valve. The facepiece virtually exploded on the workman's face, killing him immediately.

D.2.3.5 A welder and his assistant entered a 0.91 m (36 in.) diameter conduit that ran horizontally for 3 m (10 ft), then angled downward 6.1 m (20 ft), terminating in a 3 m (10 ft) horizontal section against a closed bulkhead. A standpipe from the last 3 m (10 ft) section to the surface was used to admit compressed air for ventilation. Unknown to the welders, when the compressed air supply was exhausted, a cylinder of oxygen was connected to the standpipe, and the conduit was ventilated with pure oxygen. The welder's clothing was ignited and began to burn furiously. The assistant managed to escape. The welder was found cremated in his protective suit.

D.2.3.6 An employee was performing cutting operations with an oxyacetylene torch in a sewer while wearing demand-type breathing equipment connected by a hose line to a supply cylinder of compressed air on the surface. While he was using the torch, his facepiece (of the full-face type) began to burn at the top edge. He immediately pulled the facepiece off, but the mask was burning so intensely that it burned his hands.

Although the supply cylinder was painted gray and labeled "Breathing Air," investigation disclosed that the cylinder was filled with oxygen, not air.

Apparently, there was leakage of oxygen around the periphery of the mask, and a spark ignited the upper edge of the mask, which, under the influence of escaping oxygen, began to burn intensely. When the mask was removed, the high flow of oxygen (the employee had opened the bypass valve on his regulator to provide a constant flow to the mask) caused the entire mask to burst into intense flames.

D.2.4 Industrial Processing.

D.2.4.1 Fluctuations in oxygen concentration in an ethylene-oxygen reactor feed stream were noticed. After determining that there were no obvious abnormalities in the oxygen plant operation, two successive adjustments were made by the plant operators. An explosion or detonation followed immediately, simultaneously involving the oxygen gas holder, the second-stage oxygen compressor, the oxygen-ethylene mixing nozzle, and connected piping. Ensuing fire in discharged ethylene was controlled by plant personnel with hose streams. Automatic deluge sprinkler protection was effective in controlling damage to equipment not in the immediate fire area. Production interruption of 5 weeks cost \$300,000, and damage was estimated at \$350,000.

D.2.4.2 An electrical failure caused a reducing valve to open in an oxygen plant, permitting oxygen to enter a nitrogen stream that led to an ammonia plant. While the valve was being repaired, compressors were allowed to idle, maintaining pressure against a closed valve in the contaminated nitrogen stream. After 3½ hours, the piping ruptured when oxygen reacted with hot lubricating oil. The explosion caused damage to condensers, coolers, and piping, while fire damage to the refrigeration equipment, nitrogen scrubbing unit, pipe trestle, and other equipment was extensive. The loss estimate was \$485,000.

D.2.4.3 A small explosion and fire occurred in a 152 mm (6 in.) liquid nitrogen fill and bypass line that was insulated with 127 mm (5 in.) of polyurethane foam. The reaction originated at an elbow and ran lengthwise in the insulation along the piping on either side. The fire extinguished itself. This particular section of piping had been in a cool-down condition followed by a warm-up.

The subsequent investigation concluded that a breakdown of the vapor barrier permitted air to penetrate the insulation, and the oxygen in the air was liquefied inside at cryogenic temperatures. A localized OEA was created within the insulation when this liquid oxygen evaporated. The actual cause of ignition was not established.

D.2.4.4 Oxygen Pipeline Over the last 20 years, a number of fires were experienced in oxygen-enriched atmospheres where long-distance oxygen pipelines were operated up to 6.4 MPa (928 psi), and some of them had a similar root cause. A pressure reducing station was present to supply oxygen to the user. Each station was equipped with a filter or a strainer upstream. Ignition occurred in the filter or the strainer while the oxygen was flowing at a velocity higher than the maximal velocity based on the current applicable “impingement” velocity curve per CGA EIGA Harmonized Document. The ignition mechanism was a “particle impact” of oxidized or non-oxidized particles and any kind of debris that travelled in the pipeline. Materials susceptible to ignition in oxygen-enriched atmospheres such as stainless steel mesh, or carbon steel filter or strainer housing were found and are capable of ignition or of propagating combustion. In addition, piping reducers were used upstream

of strainers and filters, leading to gaseous oxygen acceleration at the inlet of the strainers and filters.

The decision was made to use ignition-resistant materials such as Nickel, Monel®, or bronze to prevent ignition of the strainer mesh and to verify the piping design so that gaseous oxygen velocity would always remain within an acceptable range of the impingement velocity curve and without any acceleration.

D.2.4.5 In 2001, a fire occurred in a 6 in. ball valve being used as a pipeline isolation valve for a nickel refinery’s oxygen supply. The operator was killed in the incident when he opened the valve under a pressure differential. The valve was designed with spring-assisted seats on both the upstream and downstream sides of the ball. The valve body, bonnet, ball, stem, and hard seat were all carbon steel. The seals were primarily Buna-N throughout. The valve was equipped with two seat lubrication injection fittings located external to the upstream and downstream seat assemblies to allow the seat and ball to be lubricated during periodic maintenance cycles. The valve was tagged as “cleaned for oxygen service,” but exemplar valves also installed at the refinery revealed that hydrocarbon-based general-purpose grease had been used to relubricate the seat assemblies after cleaning.

Just prior to the fire, the valve had been closed in preparation for a system shutdown; and a leak check was performed on the valve by bleeding off pressure downstream and monitoring the pressure differential across the valve. During this leak check, system data indicated that the upstream pressure was approximately 3.8 MPa (gauge pressure of 550 psi) and the downstream pressure was approximately 3.5 MPa (gauge pressure of 510 psi), or roughly a 0.28 MPa (40 psi) differential pressure. At this point, the valve was re-opened to establish flow and provide full system pressure. As the valve was opened manually, using a hand wheel, a fire developed within the valve that consumed most of the valve internals and surrounding valve body, and burned out downstream piping and flanges. Ignition was believed to have developed from frictional heating as the spring-loaded seat assembly shifted position during the valve opening flow transient. The first material ignited was believed to be the hydrocarbon grease used to lubricate the seat assembly. The ignition of the grease initiated a strong kindling chain that promoted the thin wave spring elements, Buna N seat and eventually the carbon steel body of the valve.

Reference: Newton, B. E., and Forsyth, E. T., “Cause And Origin Analyses Of Two Large Industrial Oxygen Valve Fires,” *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Tenth Volume, ASTM STP 1454*, T. A. Steinberg, H. D. Beeson, and B. E. Newton, Eds., ASTM International, West Conshohocken, PA, 2003.

D.2.5 Laboratories.

D.2.5.1 A high-pressure oxygen valve ruptured, discharging oxygen gas and metal debris on 300 V dc power cables. The debris broke the insulation, causing arcing. The insulation then ignited in the OEA. Another account states that the cable short-circuited to the oxygen pipe, burning a hole in the pipe. In either event, the wood roof ignited, and it was necessary to summon the fire department. Steelwork and copper in the cables also burned, and the laboratory was heavily damaged. The loss estimate was \$160,000.

D.2.5.2 During a routine test on a heat exchanger in a rocket engine testing laboratory, a break occurred in a liquid oxygen line. Oxygen intermingled with fuel that had previously been disposed of into a floor drain. The resulting mixture was ignited by hot surfaces, damaging equipment and metal partitions. The loss estimate was \$65,000.

D.2.5.3 A fire occurred in a liquid-to-gaseous oxygen recharger assembly that converted low-pressure LOX to high-pressure ambient temperature gaseous oxygen. During operation of the assembly, a stainless steel rupture disk in a recharger assembly burst, and an oxygen fire ensued that destroyed large portions of the assembly. Analysis of the fire revealed that the rupture disk failed at nearly 21 MPa (absolute pressure of 3000 psi) below the design burst pressure, probably due to mechanical fatigue. It is postulated that the fire was caused by particle impact downstream of the rupture disk or by frictional heat generated from the disk fragments being extruded through the outlet fitting of the rupture disk housing.

D.2.5.4 A fire occurred in a stainless steel body regulator containing a fluoroelastomer diaphragm. The 28 MPa (absolute pressure of 4000 psi) oxygen in the dome and body was not flowing at the time of ignition. It was postulated that the ignition occurred due to a leak beyond the seal between the diaphragm and the body. The fire propagated from the diaphragm to the body, destroying the regulator and other parts of the system.

D.2.5.5 A fire occurred during the first use of a newly installed mechanical impact test system that had been cleaned for oxygen service. After a test sample had been installed in the test chamber, it was purged with oxygen at less than 0.3 MPa (absolute pressure of 50 psi). The remotely operated test chamber pressurization valve was opened, initiating the flow of 41 MPa (absolute pressure of 6000 psi) oxygen into the chamber. Immediately, the technician reported that there was a "slight explosion and sparks flying all over the test cell," and a "huge brown cloud" was observed coming from the test cell.

The investigation revealed that a manually operated metering valve located between the high-pressure oxygen pressurization valve and the test chamber had ignited and burned. The metering valve was heavily eroded internally, and the valve port nearest to the chamber was burned out. The fluid-piping line from the metering valve to the test chamber was burned. It appeared that the fire originated in the seat area of the metering valve. It was surmised that lubricant or a particle had ignited during passage through the metering valve. As a result of this fire, the practice of performing a vigorous inert gas purge was implemented to remove assembly-generated contaminants prior to pressurization of a system with oxygen.

D.2.6 Space.

D.2.6.1 A Titan missile in a silo was being defueled when a leak in the LOX line was detected. The LOX infiltrated the adjacent equipment silo through a utility tunnel. It is thought that a spark from some of the equipment ignited combustibles in the OEA, causing a fire in the equipment silo and a subsequent explosion of fuel in the missile silo. Fortunately, all workers were safely evacuated before the explosion, although some were injured by smoke inhalation. The loss estimate was \$7,186,000.

D.2.6.2 A fire in the two-man space environment simulator at Brooks Air Force Base, Texas, occurred on January 31, 1967.

An animal experiment underway in the chamber involved investigation of the hematopoietic effects of exposure to 100 percent oxygen. Environmental conditions in the chamber at the time of the fire were approximately 100 percent oxygen at 380 mm Hg [50.7 kPa (absolute pressure of 7.35 psi)]. The simulator was built and equipped with materials of low combustibility, but large quantities of paper, inorganic litter, and other highly combustible materials were brought into the chamber for use in animal experiments. The chamber occupants were wearing combustible clothing.

A portable electric light with an ordinary two-wire cord had been brought into the chamber. Shorting of this cord on the metal floor of the chamber is believed to have been the ignition source. The animals' fur caught fire, and their movement helped to spread the fire. The two airmen occupants of the chamber at the time of the fire were fatally burned, even though the chamber was repressurized with air and opened within approximately 30 seconds subsequent to initiation of the fire. The fire-extinguishing equipment in the chamber at the time of the fire consisted of two small, portable, manually operated carbon dioxide extinguishers, neither of which was used, although one overheated and discharged through the pressure-relief valve.

D.2.6.3 On January 27, 1967, three astronauts died as a result of a fire in an Apollo spacecraft command module on the launch pad at Kennedy Space Center, Florida. The atmosphere in the spacecraft was 100 percent oxygen at approximately 110 kPa (absolute pressure of 16 psi).

The origin or ignition source of the fire was not definitely determined in spite of an extremely intensive investigation. The most probable source of ignition was thought to be an anomaly associated with the spacecraft wiring. The extent of damage to the vehicle prevented final determination. The fire was propagated through the spacecraft by materials that were not considered significantly flammable in a normal air atmosphere but that were very flammable in the 100 percent oxygen, 110 kPa (absolute pressure of 16 psi) atmosphere.

The propagation rate of the fire, while quite rapid in its initial stages, was even greater after the pressure in the spacecraft built up and ruptured the vehicle wall.

Large amounts of heavy smoke seriously hindered and slowed rescue attempts. However, it was believed that the fatalities occurred during the first 30 seconds of the conflagration.

The investigative board concluded that the conditions that led to the disaster included the following:

- (1) Sealed cabin pressurized with an oxygen atmosphere
- (2) Extensive distribution of combustible materials in the cabin
- (3) Vulnerable wiring carrying spacecraft power
- (4) Vulnerable plumbing carrying a combustible and corrosive coolant
- (5) Inadequate provisions for the crew to escape
- (6) Inadequate provisions for rescue or medical assistance

D.2.6.4 During a space cabin experiment performed at an altitude of 10,058 m (33,000 ft) [26.2 kPa (absolute pressure of 3.8 psi)] with 96 percent oxygen, a power tube in the cabin TV monitor overheated. The "resin" base of the tube ignited and hot plastic dripped out of the chassis onto the coolant lines passing beneath. These coolant lines were covered with insulation. The composition of the insulation has yet to be deter-

mined. The lines did not catch on fire. Fumes from the hot resin affected the cabin crew. The mission was aborted without further damage to cabin or crew.

Instead of focusing attention on the hazards of fire, the accident provided a false sense of security. The fact that neither the molten resins nor the Ruberoid® insulation flamed violently in 100 percent oxygen gave the investigators more confidence in the safety of this potentially hazardous environment than they had prior to the incident.

D.2.6.5 The same chamber under the same atmosphere conditions described in D.2.6.4 was being used to study temperature control factors in pressure suits and cabins. Two subjects were dressed in pressure suits with closed helmet visors. One subject had both the inlet and outlet of his suit connected to the heat exchanger. The other subject had only the inlet side of the suit connected to the heat exchanger and was actually asleep when the fire broke out.

The fire was not detected by the sight or smell of smoke. The crewman saw a glow behind the instrument panel. Within several seconds, the rear of the panel was ablaze. The crewman who was asleep awoke when the fire alarm went off and, for some reason, opened the visor of his helmet. He inhaled the fumes issuing from the blazing panel. The other crewman, who had his visor closed and both inlet and outlet air hoses attached to the heat exchanger, inhaled none of the cabin fumes directly. Both subjects reportedly lost consciousness.

The crewman wearing the open visor suffered respiratory tract damage, probably from the direct inhalation of fumes. His pulmonary function later returned to normal. The crewman wearing the closed visor suffered no apparent respiratory tract damage, even though he remained in the chamber longer (2 to 3 minutes after he noticed the glow) than the crewman wearing the open visor. Neither subject experienced clothing or body burns. The fire was extinguished with difficulty by means of a carbon dioxide device.

The exact cause of the fire was not determined. The glow appeared at the back of the instrument panel where the wiring passed behind an access panel. The panel was not hinged (as first reported by rumor) but was opened by a Dzus fastener. The flexion of wires at a hinged edge of the panel was evidently not, as previously reported, responsible for the fire. The wires were in a 24 V to 26 V circuit. The circuit breaker or fuse system was operative when checked after the fire. There were apparently no obvious sites of defective circuitry. Damage by the fire, however, probably obscured any subtle defect that might have been responsible. The wire insulation was of polyvinyl plastic and was probably the major source of fuel. The Ruberoid insulation covering the coolant pipes also caught fire. The electrical insulation behind the instrument panel was totally burned.

During the experiment, the vapors in the cabin were being sampled in a cryogenic trap. The vapors and fumes generated during the fire were thus studied by both gas chromatography and infrared spectroscopy. The following compounds were new or had levels above those ordinarily present in the cabin: benzene, diazomethane, ethyl ether, formaldehyde, inorganic isocyanates, acetylene, methyl chloride, and ethyl chloride. The isocyanates were thought to come from the Ruberoid insulation on the coolant pipes. No polyurethane diisocyanate foams were reported to have been on fire, though the Ruberoid insulation might have contained this plastic as a component.

It is of interest that no burning of hydrogen chloride or phosgene was reported, because pyrolysis of polyvinyl chloride has been shown to produce these materials. It is possible, of course, that the screening tests were not able to detect these materials. It is not known how sophisticated a fire safety analysis was performed on the materials that were used in the cabin.

D.2.6.6 During the launch preparation of an Apollo spacecraft, LOX was directed through portions of the pumping system and discharged into a drainage ditch approximately 12 m (40 ft) wide and 1.5 m (5 ft) deep. The purpose of this operation was to precool the pumps and piping in the LOX storage area preparatory to vehicle LOX loading.

Shortly after precooling was completed, two security cars arrived in the area, the drivers having completed their final security check of the area. The driver of the first car drove his vehicle about 3 m (10 ft) past the gate, turned the engine off, got out, and walked back to stand beside the second car, which the driver had moved forward to the middle of the gate. The driver of the second car noted that his engine went dead when he came to a stop; he, therefore, turned off the ignition and remained in his seat.

A third security car driver arrived about 6 minutes later and parked about 3 m (10 ft) behind the second car. His engine also died as the vehicle came to a stop. He remained in the car. At that time, the driver of the second car turned his ignition on. A distinct "pop" was heard and smoke began issuing from under the hood, followed by flames shortly thereafter. The driver of the first car ran to move his vehicle away from the flames. However, on reaching it, he noted a distinct glow under the front of the car and concluded that it was already on fire (it was not fully daylight at the time). The third car burst into flames at about the same time.

Statements by the drivers indicate that when they first arrived at the gate there was little fog visible. However, by the time the fires had started, the fog had increased to a dense layer approximately 0.9 m to 1.2 m (3 ft to 4 ft) deep.

Several measurements of oxygen concentration in the area were made by safety personnel 30 minutes to an hour after the fire, using a portable oxygen analyzer. The results indicated a concentration of approximately 75 percent to 100 percent just inside the cloud. However, the concentration dropped to normal (21 percent) just outside the visible edge of the cloud.

The fog persisted for over 2 hours. Weather conditions were calm, with winds ranging from 0 to 0.1 km/sec (0 to 4 mph) at ground level. A marked temperature inversion was recorded, and some natural ground fog was noted.

The mechanisms whereby the fires were ignited were probably complex, and at least two different mechanisms appear to have been involved. Discussions with automotive engineers indicate that small quantities of gasoline vapor from the carburetors and fuel pumps are vented under the hoods of most cars. Other combustibles present included oil and grease on the external surfaces of the engines and small quantities of hydrogen from the batteries.

Vapors are continuously swept from the engine compartment and, therefore, probably do not reach hazardous concentrations while the vehicle is moving and the fan is in operation. After engine shutoff, however, vapors tend to accumulate. The amount of gasoline required to provide a combustible mixture throughout the engine compartment is approximately 0.1 L

(4 oz). However, because the vapors probably form largely at one or two points (the carburetor, the fuel pump, or both) and expand in all directions from those points, the amount required to provide a flammable mixture in the area of the exhaust manifold would be only a few grams.

Information from several sources indicates that outer surfaces of the exhaust manifold commonly reach temperatures in excess of 315°C (600°F) during operation. Sparking of relays and brushes is normal during start-up and operation. These considerations suggest that, even in a normal environment, a definite potential exists for ignition to occur. (In fact, such instances are not rare. Seven vehicle fires per month have been reported in a city of approximately 45,000.) Any increase in the oxygen concentration in this environment results in an increased potential for ignition. Thus, the minimum spark energy required for the ignition, the flash point, and the auto-ignition temperatures is decreased substantially. The fuel concentration corresponding to the upper flammability limit (UFL) is increased. However, this concentration might not be significant. The lower flammability limit (LFL) is not appreciably affected, but the flame propagation rate is increased.

In this incident, it appears that a flammable mixture of oxygen and hydrocarbons accumulated under the hoods of the three cars while they were parked with the engines off. In the case of the second car, this mixture was probably ignited by a spark that resulted from turning on the ignition key. In the case of the other two cars, ignition probably took place spontaneously when the concentration of the oxygen/hydrocarbon mixture in contact with the hot surface of the exhaust manifold reached some critical value. The fact that all three cars underwent similar phenomena rules out the possibility of a freak accident.

D.2.6.7 A space shuttle extravehicular mobility unit (space suit and life-support backpack) was destroyed in a flash fire during a functional test in the Johnson Space Center's crew systems laboratory (see Figure D.2.6.7). A technician, who was standing next to the suit, received second-degree burns over his upper body in the accident. It was determined that the fire originated in an aluminum-bodied regulator/valve assembly when 41 MPa (6000 psi) oxygen was released through the valve into the regulator. It was postulated that the fire was caused by the following:

- (1) Rupture of a thin, internal section of the aluminum body
- (2) Ignition of a silicone O-ring by compression heating of the oxygen
- (3) Particle impact

As a result of the post-fire investigation, the regulator/valve assembly was redesigned and the aluminum in this assembly was replaced with Monel®. This change and several others were implemented in the version of the suit that is in use today.

D.2.7 Aircraft Oxygen Systems.

D.2.7.1 It is thought that a short circuit in the battery of a Beech C-45 in a hangar ignited fuel leaking from the line supplying the heater in the nose of the plane. An aluminum fitting melted off the oxygen control panel, allowing oxygen to be fed into the fire. The aluminum then burned, including the top of the gasoline tank. Fire spread to five other small planes after causing nylon draw curtains separating the planes to fail. The fire department was handicapped by a shortage of hydrants. The loss estimate was \$177,000.

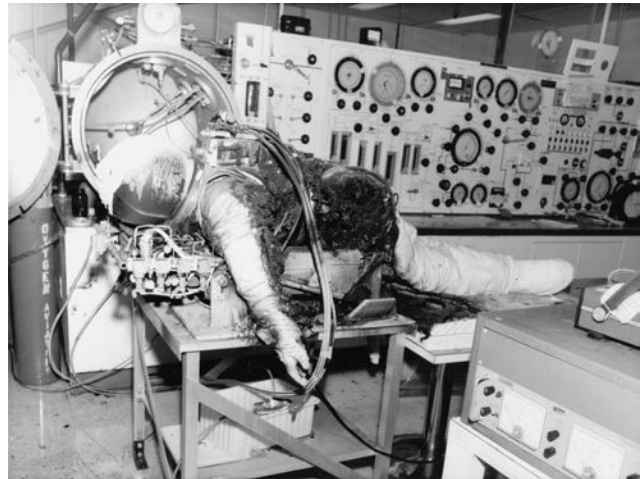


FIGURE D.2.6.7 Space Suit Destroyed in a Fire. No One Was in the Suit at the Time of the Fire. (Courtesy of NASA/Johnson Space Center.)

D.2.7.2 While an inspector was opening an oxygen valve in the cockpit of a jet transport parked in an aircraft maintenance dock, a fire of unknown cause occurred at the valve. Adiabatic compression downstream of the valve was possibly responsible for ignition of valve components, or the fire might have been caused by an impurity in the system. Escape of oxygen and burning particles resulted in a “cutting-torch-like” action that burned through the aircraft cabin soundproofing insulation and the fuselage skin directly above the valve, damaging surrounding crew compartment equipment. The hangar dock's deluge sprinkler system operated, and carbon dioxide hand extinguishers followed by dry chemical from a 2.54 cm (1 in.) hose line extinguished the interior fire.

D.2.7.3 In January 1984, the Royal Australian Air Force experienced a ground fire that destroyed a \$6 million P3B Orion aircraft. The incident occurred during removal of an onboard oxygen cylinder that was one of three that supplied the flight crew.

Examination of the aircraft's oxygen system revealed that the fire had initiated in an oxygen manifold check valve assembly. The primary cause of the incident was a leaking poppet valve, which allowed oxygen stored at 12 MPa (absolute pressure of 1800 psi) to escape to the atmosphere. Deterioration of the silicone rubber seal and galvanic corrosion are believed responsible for the valve failure. Contributory causes to the fire were system contamination and failure to bleed the oxygen system before cylinder disconnection. A thermite reaction involving the aluminum check valve housing, metal particles, and metal oxide was thought to be the most likely cause of ignition.

Investigators' findings indicate the need to consider using materials other than silicone rubber in oxygen systems. It was also determined that further investigation into the ignition of aluminum and other materials by metal particle impingement in the presence of metal oxides in a high-pressure oxygen environment is required. (8)

D.2.7.4 An aircraft burned while parked at a passenger loading gate. A preflight check was being made by the flight engineer. He turned on the aircraft oxygen system, and fire started immediately thereafter behind the coatroom. An oxygen valve

in this area apparently sustained fatigue failure, and the escaping oxygen impinged directly on glass wool insulation, resulting in ignition of the resin of the insulation. Because it was not possible to shut off the oxygen supply, the fire was accelerated by the addition of gaseous oxygen to the fire area.

Several employees tried to fight the fire from the interior of the aircraft with portable fire extinguishers but were unsuccessful. Airport fire fighters responded to the fire using a foam nozzle and 6.35 cm (2½ in.) fog lines before extinguishment could be secured, but major damage had been caused, and the aircraft was written off as a total loss.

D.2.7.5 A B-66 crew circled for more than 2 hours to reduce their fuel load. One of the crewmen removed his mask and lit a cigarette. Immediately after returning the lighter to his breast pocket, the mask and helmet ignited.

The mask and helmet were removed and flung to the deck where the fire was snuffed out using a hand extinguisher. The pilot suffered second- and third-degree burns on his face and hands. Evidence indicated that either a spark from the cigarette or momentary contact with the flame of the lighter ignited the helmet and mask, which still contained a high concentration of oxygen.

D.2.7.6 The fuselage of a Boeing 707 was gutted by fire that started while the crew's oxygen system was being checked during a ground preflight inspection. The fire spread, intensified by the oxygen escaping from service piping in the passenger compartment. The fire department used foam to good advantage through openings that the fire had made in the roof and through a cabin window. Extinguishment was achieved 1½ hours after the fire started.

D.2.7.7 An airman removed the oxygen regulator from the cockpit of an F2H-4 for a routine check. Instead of disconnecting the bottles, he removed the oxygen supply line from the regulator and capped it with a check valve and cap.

At the same time, an electrician was troubleshooting a voltage regulator discrepancy in the cockpit, and the battery was not disconnected.

Because of the small working area in the cockpit, the airman removed his bulky jacket and closed the canopy to keep warm. While the oxygen supply line was being disconnected and capped off, a quantity of oxygen apparently escaped into the closed cockpit. As the airman removed the regulator from the console structure, it contacted the terminals. The resulting arcing ignited combustible material in the cockpit, and the flash fire was supported by the high concentration of oxygen.

The airman opened the canopy, dove out, and rolled on the ground to extinguish his burning clothes and hair. He suffered first- and second-degree burns of the upper body. The airplane was damaged extensively.

D.2.7.8 At a military base, an order was issued for inerting fuel manifold lines with nitrogen. An experienced technician who had performed the same operation many times before was assigned to the job. Because he needed assistance, he selected a helper and ordered a nitrogen cart. The lines from the cart were connected to the aircraft, at which time another crew arrived to relieve the first crew for lunch.

Minutes later, a tremendous explosion rocked the aircraft. Of the four men working on the task, the only one to survive

was the man who was thrown from the cockpit by the explosion.

The cylinders on the cart were prominently stenciled "Oxygen." This marking, as well as the color of the bottles (green instead of gray), went unnoticed. The result was that oxygen under high pressure was injected into lines that had just previously been drained of combustible fuel.

D.2.7.9 A commercial aircraft fire occurred during servicing of the passenger oxygen system. Three crew members, four flight attendants, and twelve passengers were onboard the plane when the fire erupted. All passengers and crew were evacuated safely. Shortly after the preboarding of passengers had begun, a sound, described as a muffled bang or boom, came from an area near the forward galley. Within seconds, thick black smoke started to fill the cabin, and flames began to burn through the forward right side of the fuselage. Witnesses stated that they saw a 3 ft to 4 ft flame extending sideways from the fuselage on the forward right side of the airplane. A hole several feet in diameter burned through the fuselage, just behind the right side forward galley service door.

The passenger oxygen system is located in the forward right side of the airplane. The system is composed of two oxygen cylinders, each charged initially to a pressure of 12.8 MPa (absolute pressure of 1850 psi). The cylinders supply oxygen through steel tubing to the flow control unit, which reduces the pressure of the oxygen and then controls its flow to the passenger masks. During a preflight inspection of the airplane, a mechanic found that the quantity of oxygen in the cylinders was below the acceptable level and, therefore, changed the cylinders. He reported that, as he was about to leave the area, he saw a flash of white light that enveloped the oxygen system's flow control unit.

The inspection team from the National Transportation Safety Board (NTSB) concluded that the fire originated in the passenger oxygen system's flow control unit. (9)

D.2.8 Deep Sea.

D.2.8.1 An accident occurred in a chamber with an internal atmosphere of 100 percent oxygen at 34 kPa (absolute pressure of 5 psi). Four men were in the chamber taking part in experiments.

A light bulb in the ceiling fixture burned out. One man climbed up to replace the bulb. After the bulb was replaced, he heard a sound like the arcing of a short circuit. A small flame [about 12 mm (½ in.) long] was seen coming from an insulated wire in the fixture. The composition of this insulation is still unknown.

The man who replaced the bulb requested water but was told to snuff the fire out with a towel. The towel caught on fire and blazed so vigorously that it set the man's clothing on fire. An asbestos fire blanket was used to snuff out the clothing fire, but it also burst into flames. The asbestos blanket reportedly had an organic filler or coating that kept the asbestos from flaking off. The clothing of the other men who were using the blanket also caught on fire. The four men received second-degree burns. Carbon dioxide was used to extinguish the fire after evacuation of personnel from the chamber. It was believed that the blanket and towel had been saturated with oxygen for 17 days and burned much more vigorously than would be expected at sea-level conditions. It should be noted that long-term storage in oxygen does not significantly enhance

the combustibility of textile materials. (See reference [62] in Annex F.)

An interesting aspect of this case is the fact that burning insulation dripped from the light fixture onto a bunk. One crewman tried to snuff out the resulting fire, and his skin caught on fire. The burns on his hands were severe and necessitated treatment for 11 or 12 days in the hospital. The cabin was being vented continuously, and no analysis of the vapors was being performed at the time of the accident. It should be noted that laboratory experiments suggest that human skin is difficult to ignite in low-pressure oxygen. (10) It will burn readily, however, in the presence of other more easily ignitable combustibles, such as grease or molten plastics, which can act as localized ignition sources.

D.2.8.2 A fire occurred in the inner lock of a heavy steel decompression chamber, the interior surface of which was painted with a navy enamel. The electrical equipment was of ordinary types. The basic chamber wiring was in conduit. The fixed electrical equipment consisted of lights, two air conditioners, two fans, and an intercom. A portable outlet box containing four ordinary receptacles connected to an electrical supply with a heavy-duty rubber cord was provided. A portable, motor-operated, carbon dioxide scrubber was cord-connected to one of these receptacles.

The scrubber inlet was equipped with a filter containing paper elements that had been dipped in kerosene to remove dust particles from the "air."

In addition to the rubber insulation and the paint, other combustibles included a cotton mattress with a plastic cover, at least two pillows, reading matter, toilet paper, and the filter paper (possibly coated with kerosene) in the scrubber. The two men in the chamber were wearing cotton trunks and cotton terry cloth robes.

At the time of the fire, the inner-lock atmosphere consisted of approximately 28 percent oxygen, 35 percent helium, and 37 percent nitrogen by volume at a gauge pressure of 276 kPa (gauge pressure of 40 psi) and a temperature of about 26.7°C (80°F).

The chamber contained no fire extinguisher or other fire-extinguishing equipment.

The two divers had completed a 2-hour test dive at a simulated depth of 76 m (282 ft), breathing a mixture of 15 percent oxygen and 85 percent helium. During this period, the decompression chamber was prepared with an atmosphere consisting of 30 percent oxygen, 35 percent helium, and 35 percent nitrogen at 296 kPa (gauge pressure of 43 psi). It was planned to decompress the divers for 8 hours and 42 minutes, with the final hour at 100 percent oxygen at near-normal pressures.

While the men were being transferred from the tunnel to the inner lock, the inner lock oxygen concentration was decreased. After the door had been closed, the oxygen concentration was 27 percent. Additional oxygen was added in two slugs over a 2-minute or 3-minute period.

About 3 minutes after entry, a cry was heard over the intercom: "We have got a fire in here." A column of yellow-orange flame about 102 mm (4 in.) in diameter and 0.3 m to 0.6 m (1 ft to 2 ft) high was visible (through a viewing port) issuing from the carbon dioxide scrubber. Shortly thereafter, a flash

engulfed the compartment and smoke prevented further observation.

The pressure in the inner lock jumped to over 758 kPa (gauge pressure of 110 psi), which is indicative of an atmosphere temperature of about 427°C (800°F). Rescue was attempted by entering the "igloo" and raising the pressure to equalize with that of the inner lock. The pressure in the inner lock was decreasing because of heat losses and the fact that the fire had consumed enough oxygen to be reduced to a smoldering stage. The two pressures equalized at about 400 kPa (gauge pressure of 58 psi).

When the two rescuers opened the door to the inner lock, they met a blast of heat, smoke, and gases. The act of opening the door slightly caused oxygen to enter the inner lock, producing further burning.

At 10:06 a.m., the fire department received a call reporting that there had been a fire and that the department's services were needed in case the fire rekindled. The fire department completed extinguishment with a booster line and about 76 L (20 gal) of water after gaining access to the chamber.

The scrubber motor single-phased, the insulation on the electrical supply cord overheated and ignited, and flames spread to the filter. It is not known what the ignition temperature would have been under the existing atmospheric conditions.

The two divers perished, and the two rescuers were injured. Estimated physical damage to the chamber and its equipment amounted to \$20,000.

D.2.8.3 A fire in a decompression chamber, resulting in the death of a diver, was apparently caused by ignition of a cotton shirt hung around a light bulb to reduce the amount of light. The chamber pressure was at an equivalent depth of 9 m (30 ft) with 20 to 28 percent oxygen and the balance in nitrogen. Oxygen had been used during the decompression period by means of an open-loop mask system. The chamber had been ventilated during the use of oxygen, but the precise amount of oxygen enrichment was unknown.

Flammables in the chamber included cellulose, rubber, clothes, the bunk, and sneakers. All flammables were involved a few seconds after ignition.

D.2.8.4 A dive shop that filled SCUBA tanks had a series of 14 MPa (absolute pressure of 2000 psi) oxygen bottles manifolded together. The manifold had quick-opening ball valves leading from each of the oxygen tanks. After the system was allowed to bleed down to ambient pressure, a new bottle was added to the system, and the manifold quick-opening ball valve was opened. The high pressure in the bottle caused compression ignition at the first T in the line. The resultant fire did considerable damage to the dive shop equipment and injured an employee.

D.2.8.5 The Canadian Underwater Mine-countermeasures Apparatus (CUMA) is a self-contained, semi-closed-circuit underwater breathing apparatus used by Canadian Forces for underwater mine search, investigation, and disposal. On November 30, 2001, the Experimental Diving Unit staff at Defense Research and Development Canada – Toronto was preparing for an experimental dive using the CUMA version 2 (V2) in their facility's hyperbaric chamber. A fire occurred in the CUMA V2 as the team leader (the diver wearing the CUMA V2) opened the oxygen sphere valve. The fire was severe, eject-

ing fire and molten metal approximately 7 feet from the diver's back-mounted unit, and lasting for an extended duration before the diver's teammates were able to remove the backpack and extinguish the fire. No one was seriously injured in the incident. Key materials were sampled as required and chemical analyses on samples were done to obtain positive material identification. The evidence indicated that the local origin of the fire was within the first-stage regulator close to the nonmetal seat. The evidence also indicated that operationally induced ignition mechanisms developing during valve opening, and incompatible materials, were the causative factors in the ignition and propagation of the fire.

Reference: Forsyth, E. T., Eaton, D. J., and Newton, B. E., "Oxygen Fire Cause and Origin Analysis of the CUMA V2 Underwater Breathing Apparatus," *Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Tenth Volume*, ASTM STP 1454, T. A. Steinberg, H. D. Beeson, and B. E. Newton, Eds., ASTM International, West Conshohocken, PA 2003.

D.2.9 Other.

D.2.9.1 A diesel-engine shrimp boat had a compressed-air starter. The compressed air was lost through leakage. The skipper asked a boat hand to bring a cylinder of "air" to start the engine. The boat hand went to a welding shop and secured a cylinder of "air" and a regulator. Then 68 kg (150 lb) of this "air" was put into the air reserve tank and the valve was opened. The engine rotated and a blast took place that tore through the solid oak keel. The skipper, 13 m (42 ft) above in the control room, was fatally burned. The deck hand who turned on the "air" was not hurt. The cylinder actually contained oxygen.

D.2.9.2 A workman, after disconnecting the air supply and exhaust lines from his air-supplied suit and leaving the "controlled atmosphere" room, removed his helmet and lit a cigarette. He then connected what he thought was an air supply line from another room to his suit to flush and cool the suit. His underclothing caught fire, and he received severe burns to the chest, shoulders, neck, stomach, and legs from the combustion of the cotton underwear.

Investigation disclosed that the respiratory air supply to the second room (the line that the workman connected to flush out and cool the suit) actually contained 68 percent to 76 percent oxygen as a result of failure of the air-oxygen mixture control valve.

D.2.9.3 Five workers were asphyxiated in a fire that flashed through a compartment of a vessel in which they were working. Although the source of ignition is unknown, the inadvertent introduction of oxygen into the compartment obviously contributed to the fire's intensity. The air hose, which the men were using to blow out the ship's suction lines, was connected to an oxygen manifold rather than to an air compressor.

D.2.9.4 The following documented fires in piping systems associated with Navy hypobaric chamber complexes show the need for cleanliness, materials compatibility, and awareness of fires in oxygen systems:

- (1) February 26, 1974: Fire in oxygen manifold, Cherry Point, NC
- (2) July 2, 1975: Fire in oxygen manifold, device 9A9, Pensacola, FL
- (3) April 11, 1978: Fire in shutoff and check valve, device 9A1B, serial #6, Whidbey Island, WA

- (4) April 16, 1980: Explosion and fire in oxygen manifold, device 9A9, Pensacola, FL

Documented fires in the oxygen manifolds of Navy altitude chambers have been traced to contamination that was most likely introduced into the system during maintenance activities. The potential for fire and explosion in high-pressure oxygen systems is heightened by the presence of contaminants. More recent evaluation (1986, 1987, and 1993) of oxygen systems in Navy altitude chambers has uncovered unacceptable levels of contaminants, including mercury, lead, and hydrocarbons. The fire incidents and further discovery of contamination underscore a need for continuous monitoring of oxygen purity as well as ongoing training of staff assigned to operate and maintain these devices.

Three men became very sick while breathing oxygen in the altitude chamber at Marine Corps Air Station (MCAS) Cherry Point on February 26, 1974. Upon investigation, two valves were found to have been damaged by flash fires resulting from the introduction of an unapproved lubricant. The system was also highly contaminated with Freon 113. The fires in the two damaged valves were attributed to impact of the unapproved lubricant with pure oxygen. The subsequent laboratory investigation concluded that "the flash fire resulted in the partial decomposition of Teflon and Freon 113 in presence of hot metal." This could result in phosgene-like contaminants.

The July 2, 1975, fire in the oxygen manifold of device 9A9 in Pensacola, FL, was found upon investigation to be due to contamination introduced during maintenance of a ball valve. The contaminant entered the downstream check valve where it caused an explosion and fire. The investigation revealed that maintenance actions included installation of spare parts not "cleaned for oxygen use." The ultimate cause of the incident was documented as "personnel assigned to maintain and operate the oxygen supply were as a result of oversight, lack of training or experience, not knowledgeable/careful enough in the use of their equipment," and that "it must be assumed that the individuals simply had not been afforded enough proper training in the hazards of high-pressure gaseous oxygen and the handling/maintenance therefor."

The April 11, 1978, release of oxygen and acrid gas from the oxygen manifold of device 9A1B at Naval Air Station (NAS) Whidbey Island was attributed to defective parts installed in the system. As with other fires in oxygen manifolds of Navy altitude chambers, contamination of oxygen was listed as the primary suspected cause. No contamination was found in the oxygen from the bottles in use at the time of the incident. The only source of potential contamination, then, was the components of the oxygen manifold itself.

The April 16, 1980, fire in the oxygen manifold of the 9A9 altitude chamber at NAS Pensacola was caused by contamination introduced during maintenance. A ball valve not "cleaned for oxygen use" had been installed in the manifold. The contaminants were ignited, possibly due to adiabatic compression, causing a high-pressure oxygen leak and fire. One man was injured as a result of the flames. Operators and maintenance personnel interviewed after the fire had not been properly trained in use and maintenance of high-pressure oxygen systems, had not been assigned fire billets, and were unaware of previous fires in oxygen manifolds, including one on the same device 5 years prior to this incident.

D.3 References.

- (1) Bailey, M. K., M.D.; Bromley, H. R., M.D.; Allison, J. G., M.D.; Conroy, J. M., M.D.; and Krzyzaniak, W., C.R.N.A. "Electrocautery-Induced Airway Fire During Tracheostomy." *Anesthesiology*, Vol. 71, 1990, pp. 702-704.
- (2) Simpson, J. I., M.D.; and Wolf, G. L., M.D. "Endotracheal Tube Fire Ignited by Pharyngeal Electrocautery." *Anesthesiology*, Vol. 65, 1986, pp. 76-77.
- (3) Sosis, M. B., M.D., PhD. "Airway Fire during CO₂ Laser Surgery Using a Xomed Laser Endotracheal Tube." *Anesthesiology*, Vol. 72, 1990, pp. 747-749.
- (4) Incident Report, ECRI, Plymouth Meeting, PA.
- (5) Incident Report, ECRI, Plymouth Meeting, PA.
- (6) Incident Report, ECRI, Plymouth Meeting, PA.
- (7) Incident Report, ECRI, Plymouth Meeting, PA.
- (8) Grubb, J.W. "Case Study of Royal Australian Air Force P3B Orion Aircraft Ground Oxygen Fire Incident." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Second Volume*, ASTM STP 910. M. A. Benning, editor, American Society for Testing and Materials, Philadelphia, 1986, pp. 171-179.
- (9) "Pax Oxygen System Ignites Airliner Fire." *Aviation Equipment Maintenance*; An Irving-Cloud publication, January 1991, pp. 6-13.
- (10) Durfee, R. L. "The Flammability of Skin and Hair in Oxygen-Enriched Atmospheres." SAM-TR-68-130, December 1968.

Annex E Fundamentals of Ignition and Combustion in Oxygen-Enriched Atmospheres

This annex is not a part of the recommendations of this NFPA document but is included for informational purposes only.

E.1 General.

E.1.1 Although considerable technical knowledge of the ignition, flammability, and flame propagation characteristics of various combustible materials (solids, liquids, and gases) exists, this technical knowledge is inadequate in many instances. Thus, valid predictions of the probability of fire initiation or of

the consequences of such initiation, even under normal atmospheric conditions, are difficult to make. Most of the specific knowledge relates to premixed gaseous fuel-oxidant combinations because of the obvious advantages of conducting controlled experiments. Unfortunately, most unwanted fires occur under non-premixed conditions. The investigation of the ignition and combustion properties of solid and liquid combustibles is more complex due to the heterogeneity of the reaction mechanisms involved. Thus, much of the available information on the fire properties of liquid combustible materials has evolved empirically, with the specific data reported exhibiting a high degree of test method dependency.

E.1.2 The application of this knowledge to the assessment of the fire problem in OEAs currently is largely qualitative, but an OEA generally can be considered more hazardous than normal atmospheric conditions. The general properties of OEAs will be reviewed, and the fundamental aspects of the ignition and combustion properties of gaseous, liquid, and solid materials in such atmospheres will be discussed within these limitations.

E.2 Properties of Atmospheres.

E.2.1 The chemical composition of OEAs can be very different from that of air. Nitrogen makes up slightly more than 78 percent of dry air by volume. Oxygen contributes approximately 21 percent by volume. The other 1 percent is almost entirely argon with very small amounts of other gases, such as carbon dioxide, neon, helium, krypton, xenon, nitrous oxide, methane, ozone, and hydrogen. All or some of the constituents might be found in the various OEAs under consideration. The specific properties of these constituents are indicated in Table E.2.1.

E.2.2 In addition to the specific chemical composition of a particular atmosphere, pressure, temperature, and volume have a significant bearing on an environment's fire hazard. For an atmosphere of given chemical composition, pressure defines the concentration of oxygen available for initiation of flame reaction. Pressure and volume together define the total quantity of oxygen available for the support of combustion and determine the associated maximum thermal energy yield from

Table E.2.1 Properties of Standard and Oxygen-Enriched Atmosphere Constituents

Constituent	Molecular Formula	Molecular Weight (O = 16.00)	Melting Point (°C)	Boiling Point (°C)	Density (gm/L)	Thermal Conductivity X*	C _p 25°C (cal/gm)	C _p /C _v
Nitrogen	N ₂	28.016	-209.9	-195.8	1.2507	62.40	0.219	1.404
Oxygen	O ₂	32.0000	-218.8	-182.96	1.4289	63.64	0.219	1.401
Argon	Ar	39.944	-189.2	-185.9	1.7828	42.57	0.124	1.568
Carbon dioxide	CO ₂	44.010	-56.6	-78.5	1.9768	39.67	0.202	1.303
Sodium	Na			Subl.				
or neon	Ne	20.183	-248.67	-245.9	0.835	115.71	0.246	1.64
Helium	He	4.003	-272.2	-268.9	0.1785	360.36	1.24	1.660
			26 atm					
Krypton	Kr	83.80	-157.1	-152.9	3.6431	≈23	0.059	1.68
Xenon	Xe	131.30	-112	-107.1	5.897	—	0.038	1.66
Methane	CH ₄	16.04	-182.5	-161.5	0.7167	81.83	0.533	1.307
Nitrous oxide	N ₂ O	44.016	-102.4	-89.49	1.997	41.45	0.2003	1.303
Ozone	O ₃	48.0000	-192.5	-111.9	2.144	—	0.1959	—
Hydrogen	H ₂	2.0160	-257.14	-252.8	0.0898	446.32	3.41	1.410

*X = cal/(sec)(cm²)(°C/cm) × 10⁶.

the fuel. The heat capacity and thermal conductivity of the atmosphere will affect ignition, the combustion processes, and the temperature and pressure rise occurring during a fire.

E.3 Ignition Mechanisms.

E.3.1 General.

E.3.1.1 Flames involve strongly exothermic reactions between oxidants and fuels, producing combustion and pyrolysis products at high temperatures. Temperature, pressure rise, and radiation are the criteria utilized to determine whether ignition has occurred. The initiation mechanisms involved in the flame reaction are complex.

E.3.1.2 In general, if a fuel molecule and an oxygen molecule are to interact chemically, sufficient energy has to be imparted to these molecules to enable a collision between the two to result in a chemical transformation. The minimum energy that the molecules need to possess to permit chemical interaction is referred to as the activation energy. For most fuel-oxygen combinations, the activation energy is much greater than the average energy of the molecules at room temperature.

E.3.1.3 An increase in temperature increases the number of molecules with energy equal to the activation energy and increases the reaction rate. As the temperature is further increased, enough fuel and oxygen molecules eventually react with enough additional thermal energy released to enable the combustion reaction to become self-sustaining until one or both of the reactants have essentially been consumed.

E.3.1.4 The minimum ignition energy for combustion will vary with the type of ignition source, the specific chemical nature and physical character of the combustible, and the composition and pressure of the atmosphere. Though most combustion is accompanied by a gas or vapor-phase combustion reaction, certain materials, such as metals, often burn in the liquid phase or solid phase; that is, a condensed-phase reaction. (1–5) If the reaction is to continue in the vapor phase, in the case of solids or liquids, sufficient thermal energy first needs to be supplied to convert a part of the fuel to a vapor. In all cases, for the combustion to proceed, the ignition source has to impart energy to the fuel at a faster rate than the fuel loses the energy.

The ignition sources of principal concern for oxygen-enriched atmosphere application can be categorized into the following six types:

- (1) Electrical sources, such as electrostatic and break (arc) sparks
- (2) Hot surfaces, such as friction sparks and heated wires
- (3) Heated gases, independent of surfaces, generated by adiabatic compression or jets of hot gas, including pilot flames
- (4) Exothermic chemical reactions
- (5) Mechanical sources, such as frictional heating and particle impact
- (6) Laser sources

E.3.2 Effects of Atmosphere Composition and Environmental Pressure and Temperature on Ignition Energy.

E.3.2.1 Flame initiation energies cannot yet be calculated for various combustibles (solids, liquids, and gases) in environments of differing chemical composition, temperature, and pressure, but need to be determined experimentally in each case. It is possible, however, to assess qualitatively the effects of these environmental parameters on the ignition energy

requirements using typical electrical and thermal ignition sources.

E.3.2.2 Figure E.3.2.2 depicts, in an oversimplified manner, the effects of variations in oxygen concentration and environmental pressure. In general, at a given environmental pressure, the minimum ignition energy varies inversely with the concentration of oxygen. For a fixed volume percent oxygen, the minimum ignition energy varies inversely with the square of the pressure. There exists a minimum pressure below which ignition does not occur. As the temperature of a given system increases, less and less energy is required to ignite the mixture until it reaches a sufficiently high temperature to ignite spontaneously. This minimum temperature is referred to as the auto-ignition or spontaneous ignition temperature.

E.3.3 Effects of Inert Gas on Ignition, Energy, Flammability Limits, and Flame Propagation.

E.3.3.1 The likelihood of ignition and the rate of flame propagation of a combustible are influenced primarily by the oxygen content of the environment. An inert gas, such as nitrogen or helium, if present in sufficient quantities, provides an obstacle to the effective interaction of fuel and oxygen molecules. Where inert gases are present in sufficient concentrations, ignition cannot be accomplished and a flame will not propagate. Minimum oxygen concentration is also a correlating parameter for another means of preventing combustion. Thus, a minimum amount of oxygen needs to be present for a flame to propagate, regardless of the ratio of fuels and inerts present. For a given fuel gas, triatomic inert gases allow a higher minimum oxygen concentration than diatomic inert gases.

E.3.3.2 The specific effect on ignition energy requirements by the typical ignition sources will vary with the particular inert gas selected. This effect also is true for the flame propagation rate. These effects in certain instances correlate with the heat capacity and thermal conductivity properties of the different

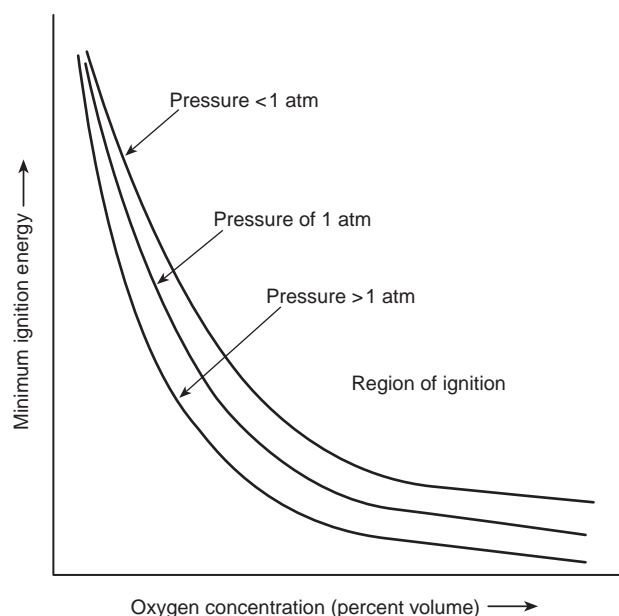


FIGURE E.3.2.2 Minimum Ignition Energy Behavior of Combustibles in Oxygen-Diluent Atmospheres at Different Pressures.

inert diluents. For example, the flame propagation rate for a given material in a particular helium-oxygen atmosphere is greater than that in a corresponding nitrogen-oxygen atmosphere because of the higher thermal conductivity and lower heat capacity per equivalent volume of helium. (6)

E.3.3.3 Once ignited, the likelihood of flame propagation and the rate of propagation of a combustible are primarily dependent on the stoichiometry of the fuel and oxygen, the concentrations of oxygen with the inert gas present, and the velocity of the gas mixture. In general, inert gases vary in their ability to render a mixture nonflammable, with triatomic gases (e.g., CO₂, H₂O) being more effective than diatomic gases (e.g., N₂), which are, in turn, more effective than monatomic gases (e.g., Ar). This trend has been correlated with the heat capacity of the gas, which increases with the structure of the inert gas molecule. Helium is an exception to this trend. Due to its very high thermal conductivity, the flame propagation rate in helium dilution is higher than would be expected by examining heat capacity ranking alone.

E.4 Combustion Mechanisms.

E.4.1 General.

E.4.1.1 Combustion is a complex sequence of chemical reactions between a fuel and an oxidant accompanied by the evolution of heat and, usually, by the emission of light. The rate of the combustion process depends on the chemical nature and physical character of the fuel and oxidant, their relative concentrations, environmental pressure and temperature, and other physical parameters, such as geometry and ventilation. A comprehensive discussion of the combustion process is beyond the scope of this recommended practice.

E.4.1.2 It is important to review the essential features of the combustion process to obtain a better appreciation of the fire hazard problem under various OEAs. For this purpose, the various combustible materials can be divided into two categories, the first consisting of combustible liquids, vapors, and gases and the second consisting of combustible solids.

E.4.2 Combustible Gases, Vapors, and Liquids.

E.4.2.1 In Section E.3, it was indicated that, for ignition to be possible, an adequate fuel concentration needs to be available in the particular oxidizing atmosphere. Once ignition occurs, the sustainment of combustion requires a continued supply of fuel and oxidant. In the case of combustible gases, vapors, and liquids, two types of mixtures, homogeneous or heterogeneous, can exist within the atmosphere.

E.4.2.2 A homogeneous mixture is one in which the components are intimately and uniformly mixed so that any small volume sample is truly representative of the whole mixture. If the mixture is not homogeneous, it is necessarily heterogeneous (i.e., nonuniformly mixed). A flammable homogeneous mixture is one whose composition lies between the limits of flammability of the combustible gas or vapor in the particular atmosphere at a specified temperature and pressure.

E.4.2.3 The limits of flammability represent the extreme concentration limits of a combustible in an oxidant through which a flame, once initiated, will continue to propagate at the specified temperature and pressure. For example, hydrogen-air mixtures will propagate flame between 4.0 and 74 volume percent hydrogen at 21°C (70°F) and atmospheric pressure. The smaller value is the lower (lean) limit and the larger value

is the upper (rich) limit of flammability. When the mixture temperature is increased, the flammability range widens. A decrease in temperature can result in a previously flammable mixture becoming nonflammable by placing it either above or below the limits of flammability for the specific environmental conditions.

E.4.2.4 Note in Figure E.4.2.4 that, for liquid fuels in equilibrium with their vapors in air (or in oxygen), a minimum temperature exists for each fuel above which sufficient vapor is released to form a flammable vapor-air (or vapor-oxygen) mixture. The experimentally determined value of this minimum temperature is commonly referred to as the flash point. The flash point temperature for a combustible liquid varies directly with environmental pressure. An increase in oxygen concentration also widens the flammability range — the upper limit being affected much more than the lower limit. For example, in an oxygen atmosphere at 21°C (70°F) and 1 atm, the upper limit for hydrogen increases to 95 volume percent compared with 74 volume percent in air, whereas the lean limit remains essentially the same. A reduction in oxygen concentration results in a narrowing of the flammability range until, at a certain oxygen concentration, the limits merge and flame propagation is no longer possible. Reduction of the oxygen content below this minimum value is one means of effecting fire control. In practice, carbon dioxide or nitrogen is often utilized for this purpose. Nitrogen pressurization provides effective fire control, and as long as the oxygen partial pressure is about 0.14 atm, the environment remains habitable.

E.4.2.5 Total environmental pressure also has an effect on the limits of flammability (see Figure E.4.2.5). For a given atmospheric composition, an increase in pressure generally broadens the flammability range, the rich limit being influenced more than the lean limit. For example, the flammability limits for natural gas-air mixtures at 34 atm are 4.45 and 44.20 volume percent compared to 4.50 and 14.20 volume percent at normal atmospheric pressure. A decrease in environmental pressure below 1 atm produces little effect on the limits of flammability until the low-pressure limit is reached, whereupon materials become nonflammable.

E.4.2.6 The low-pressure limit is dependent on the particular fuel and oxidant as well as the temperature, size, geometry, and attitude of the confining vessel. The quenching or low-pressure limits are represented in Figure E.4.2.5 by broken lines to indicate their dependency on surroundings.

E.4.2.7 Under practical application conditions, the fire problem usually involves heterogeneous mixtures rather than homogeneous combustible-oxidant mixtures. One type of heterogeneous system pertains to gaseous fuel-oxidant mixtures and is heterogeneous in view of the concentration gradients that normally exist when the combustible vapor is first introduced into the oxidizing atmosphere. The type of flame that results is a diffusion flame. A heterogeneous system also results when a liquid fuel is injected in the form of a mist into the oxygen-containing atmosphere. These systems are noted in Figure E.4.2.4.

E.4.2.8 In the case of the heterogeneous vapor system, both flammable and nonflammable mixtures can be formed at temperatures above the flash point of the liquid from which they are formed. The flammable zones exhibit ignition and burning characteristics similar to flammable homogeneous mixtures. Flammable heterogeneous vapor-mist-oxidant mixtures can be formed at temperatures below the flash point;

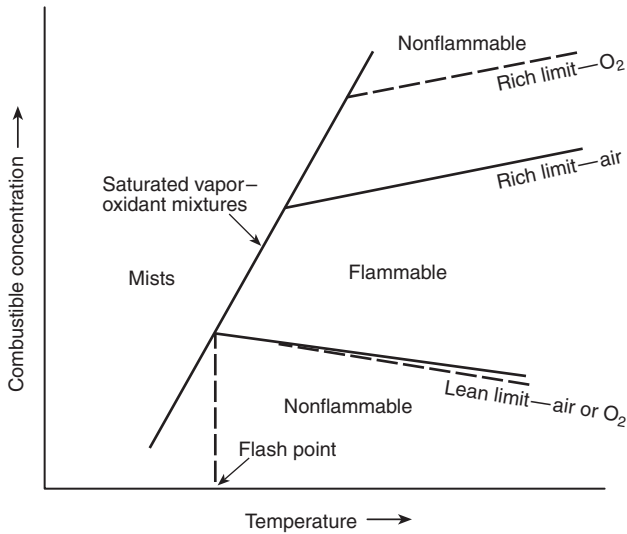


FIGURE E.4.2.4 Effects of Temperature on the Limits of Flammability of a Combustible Vapor in Air and Oxygen. (7)

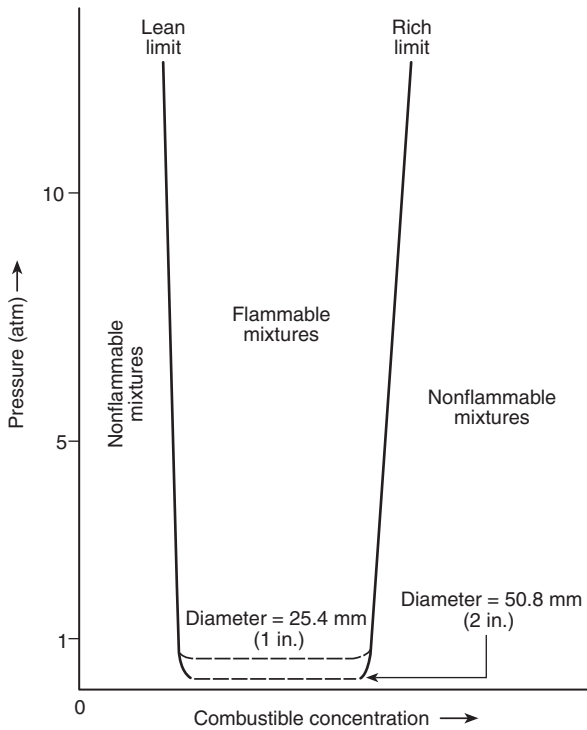


FIGURE E.4.2.5 Effects of Pressure on Limits of Flammability of a Combustible Vapor in Air and of Pressure and Composition on the Quenching Diameter. (8)

flammable sprays can be produced over a wide temperature range, both below and above the flash point. Ignition of a flammable mist or spray requires vaporization of the fuel droplets to form flammable gas mixtures. As a result, the ignition energies for these mixtures are higher than those of normal flammable gas mixtures due to the heat of vaporization.

E.4.2.9 For most practical cases, the type of flame encountered is a diffusion flame and requires the diffusion of oxidant to the combustible gas at the flame front for its combustion. The rate of burning is dependent primarily on the rate at which the fuel and oxidant are brought together, and is influenced by factors such as thermal gradients and turbulence. Increasing the oxidant content, such as in OEA applications, can result in a significant increase in burning rate.

E.4.3 Combustible Solids — Nonmetallics.

E.4.3.1 The burning of solid combustibles requires the consideration of only heterogeneous fuel-oxidant systems. As in the case of flammable liquids and gases, the flame reaction occurs in the gas phase. Once a particular solid combustible has been ignited, propagation of flame requires that a portion of the heat of combustion be fed back to the solid fuel to cause its vaporization or pyrolysis, or both, thereby making additional gaseous fuel available to mix with the oxidant. The flame process is of the diffusion type.

E.4.3.2 Although it is not possible to predict the exact burning behavior of a material in atmospheres of different composition and pressure without actual experimentation, the general effect of these parameters on flame propagation over the surface of a solid combustible, referred to as the flame spread rate, is a factor used to evaluate the fire hazard in different OEA. This rate is also dependent on direction of propagation, orientation of the combustible, scaling, and nature of the combustible surface (nap burning).

E.4.3.3 The observed effect of atmosphere composition and pressure on the flame spread rate is illustrated in Figure E.4.3.3. Note that increasing the partial pressure of oxygen at a constant environmental pressure can change the classification of a material from the nonflammable category to the flammable category. For materials already in the flammable category based on 21 percent oxygen, further increase in the oxygen partial pressure results in a higher flame spread rate.

E.4.3.4 Fire properties of some nonmetallic materials in different atmospheres have been tabulated in Annex F. Perusal of the data clearly indicates that almost all of these materials are flammable in pure oxygen environments.

E.4.4 Combustible Solids — Metals. The burning of metals can occur either in the vapor phase or in a condensed-phase reaction and, therefore, can require the consideration of both homogeneous and heterogeneous fuel-oxidant systems. Once a particular metallic combustible has been ignited, propagation of the combustion, whether burning in the vapor phase or condensed phase, requires that a portion of the heat of combustion (assuming the ignition source has been removed) be fed back to the solid fuel to cause it to heat past the ignition point.

E.5 Effects of Fire in Oxygen-Enriched Atmospheres.

E.5.1 It has been noted that OEAs usually facilitate the initiation of the combustion process and, once ignition has occurred, the flame reaction proceeds with greater rapidity. Another important consideration in the analysis of the overall fire problem is that OEAs can be encountered under closed-environment (fixed-volume) conditions (e.g., in spacecraft and hyperbaric chambers). (9)

E.5.2 In confined spaces, the combustion of a relatively small quantity of combustibles can result in the rapid generation of

extremely high temperatures and increased pressure. The high temperature can result in the ignition of other combustibles some distance from the initial reaction zone, thereby contributing to the rapid spread of the fire. The high temperatures and toxic combustion products that are generated are in themselves potentially lethal to any personnel in the environment, even if they are not engulfed in flames. The increased pressure produced in association with the flame process can also result in the explosive rupture of the chamber.

E.5.3 The effects of oxygen content and environmental pressure on the quantity of fuel that can be consumed and the

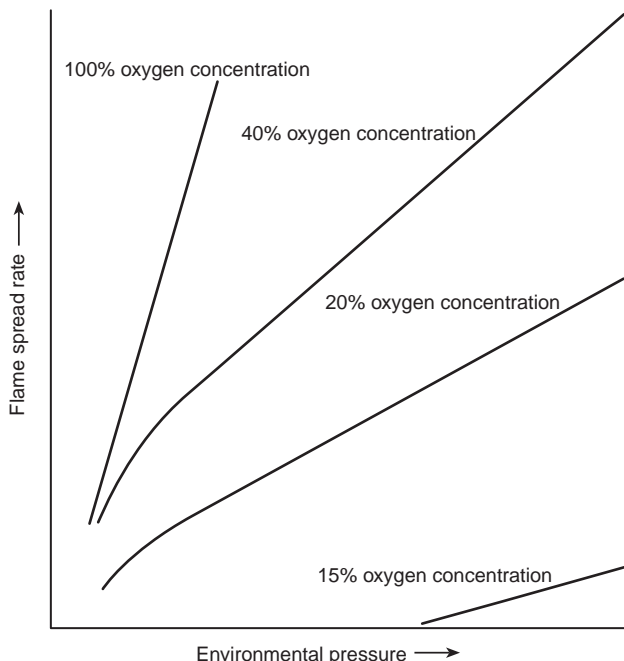


FIGURE E.4.3.3 Effects of Atmosphere Oxygen Content and Environmental Pressure on Flame Spread Rate.

Table E.5.3 Oxygen Content, Maximum Fuel Consumption, and Resulting Combustion Temperatures and Pressures in Different Atmospheres in a 10.2 m³ (360 ft³) Volume Enclosure

Atmosphere	Cellulose Fuels		Hydrocarbon Fuels	
	In Air at 103.4 kPa (absolute pressure of 15 psi)	In 100% O ₂ at 103.4 kPa (absolute pressure of 15 psi)	In Air at 103.4 kPa (absolute pressure of 15 psi)	In 100% O ₂ at 103.4 kPa (absolute pressure of 15 psi)
Oxygen content (kg)	2.9	14.5	2.9	14.5
Maximum burnable fuel ^a (kg)	1.2	11	0.36	3.3
Heat of combustion (cal/gm)	~4,000		~11,700	
Maximum heat release (kcal)	~4,924	~43,500	~4,233	~38,200
Maximum theoretical temperature (°C)	1,810	5,670	1,390	5,840
Maximum pressure ratio (P _{final} /P _{initial}) ^b	8	36	7	33
Maximum final pressure (kPa)	827	3,723	724	3,413
	(120 psia)	(540 psia)	(105 psia)	(495 psia)

^aAssumes all but 10 volume percent of available O₂ can react.

^bDoes not consider dissociation of product gases.

resulting maximum theoretical temperatures and pressures that can be attained in air and in several other typical oxygen-enriched atmospheres in a 10.2 m³ (360 ft³) chamber are indicated in Table E.5.3.

E.5.3.1 The maximum temperatures and pressures in Table E.5.3 are recognized as higher than those that would be experienced under true closed-environmental fire conditions. The specific values have been calculated on the following assumptions:

- (1) Combustion of the fuel is instantaneous.
- (2) None of the heat generated is lost to the walls of the chamber.
- (3) No dissociation of the product gases occurs.

It should be noted that assumption (3) fails significantly above 1371°C (2500°F).

E.5.3.2 Nonmetallic combustibles, such as fabric materials, burn rapidly in 100 percent oxygen, but consumption of the stoichiometric amount of material requires several seconds. This consumption allows a considerable portion of the thermal energy produced to be absorbed by the walls. Experiments conducted with cotton fabric in 34.5 kPa (absolute pressure of 5 psi), 100 percent oxygen in a 0.045 m³ (1.6 ft³) explosion test chamber, with sample dimensions and test configurations conducive to maximum flame spread, resulted in peak pressures of 241 kPa (absolute pressure of 35 psi) in 15 seconds after ignition, or approximately 20 percent of the theoretical maximum pressure for cellulose.

E.5.3.3 Solid metallic materials can burn in OEA, but their flammability depends greatly upon the material, oxygen concentration, oxygen pressure, and test sample temperature and configuration (geometry). (10–14) The consumption of the stoichiometric amount of the material requires several seconds and allows some of the energy produced to be absorbed by the walls of the containment vessel. As a result of the combustion of metals, the temperature and pressure of a containment vessel (of reasonable size) will increase. This increase in pressure occurs even though the oxygen is

combined with the metal to form liquid and solid metal oxides; that is, despite the fact that some of the gaseous oxygen is consumed.

E.6 References.

- (1) Sircar, S., Gabel, H., Stoltzfus, J., and Benz, F. "The Analysis of Metals Combustion Using a Real-Time Gravimetric Technique." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (2) Steinberg, T. A., Mulholland, G. P., Wilson D. B., and Benz F. J. "The Combustion of Iron in High-Pressure Oxygen." *Combustion and Flame*, Vol. 89, Elsevier Science Publishing Co., Inc., 1992, pp. 221–228.
- (3) Wilson, D. B., and Steinberg, T. A. "The Combustion Phase of Burning Metals." Accepted for publication in *Combustion and Flame*.
- (4) Mellor, A. M. "Heterogeneous Ignition of Metals: Model and Experiment." Final Report, NASA Grant NSG-641, Princeton University, Princeton, NJ, 1967.
- (5) Monroe, R. W., Bates, C. E., and Pears, C. D. "Metal Combustion in High-Pressure Flowing Oxygen." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812. B. L. Werley, editor, American Society for Testing and Materials, Philadelphia, 1983, pp. 126–149.
- (6) Huggett, C. M., Von Elbe, G., and Haggerty, W. "The Combustibility of Materials in Oxygen-Helium and Oxygen-Nitrogen Atmospheres." SAM-TR-66-85, Brooks Air Force Base, Texas, June 1966.
- (7) Tatem, P. A., Gann, R. G., and Carhart, H. W. "Extinguishment of Combustion in Confined Spaces with Nitrogen." *Combustion Science and Technology*, Vol. 7, 1973, p. 213.
- (8) Van Dolah, R. W., et al. "Review of Fire and Explosion Hazards of Flight Vehicle Combustibles." ASD Technical Report 61-278, October 1961.
- (9) Huggett, C. M. "Combustible Processes in the Aerospace Environment." *Aerospace Medicine*, Vol. 7, 1969, p. 1176.
- (10) Stoltzfus, J. M., Lowrie, R., and Gunaji, M. V. "Burn Propagation Behavior of Wire Mesh Made From Several Alloys." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (11) Steinberg, T. A., Rucker, M. A., and Beeson, H. D. "Promoted Combustion of Nine Structural Metals in High-Pressure Gaseous Oxygen: A Comparison of Ranking Methods." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society for Testing and Materials, Philadelphia, 1989.
- (12) Sato, J. "Fire Spread Rates Along Cylindrical Metal Rods in High Pressure Oxygen." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society for Testing and Materials, Philadelphia, 1989.
- (13) Benning, M. A., Zabrenski, J. S., and Le, N. B. "The Flammability of Aluminum Alloys and Aluminum Bronzes as Measured by Pressurized Oxygen Index." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 986. D. W. Schroll, editor, American Society for Testing and Materials, Philadelphia, 1988, pp. 54–71.
- (14) Zawierucha, R., McIlroy, K., and Mazzarella, R. B., "Promoted Ignition-Combustion Behavior of Selected Hastelloys in Oxygen Gas Mixtures." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.

Annex F Materials for Use in Oxygen-Enriched Atmospheres

This annex is not a part of the recommendations of this NFPA document but is included for informational purposes only.

F.1 General. See also Chapter 5.

F.1.1 The careful selection of materials for construction and equipment can do much to reduce the fire hazard associated with the use of an OEA. This annex describes the effect of material properties on the degree of hazard for guidance in the selection of materials that can be used with safety.

F.1.2 In Chapter 6 it was shown that the use of an OEA accentuates the hazards associated with the use or accidental presence of combustible materials in an OEA as follows:

- (1) Combustible materials are ignited more easily in an OEA than in a normal atmosphere, thus increasing the probability of the occurrence of a fire.
- (2) Combustible materials burn more rapidly in an OEA than in a normal atmosphere, thus reducing the time available for remedial action before serious damage or injury occurs. Many materials that do not support combustion in a normal atmosphere will burn vigorously in an OEA.

F.2 Combustible Gases, Vapors, and Liquids.

F.2.1 General. Evaluation of the hazard of combustible liquids and gases requires a knowledge of their ignition and flammability properties in the oxidant atmosphere of concern. In applications where these combustibles are encountered, the potential fire or explosion hazard can be defined in part by the temperatures required for the formation of flammable mixtures, the temperature and energy needed for ignition of the mixtures, and the critical fuel concentrations (limits) for flame propagation. This information is presented in Table F.2.1 for various representative liquid and gas combustibles in oxygen or air atmospheres, or both. However, the available data are less complete for oxygen than for air for many of the combustibles. In such cases, the degree of fire or explosion hazard in an oxygen environment can be estimated from the data obtained for air and from known oxygen concentration effects for the given class of combustibles.

F.2.2 Ignition Temperature and Energy.

F.2.2.1 The minimum autoignition temperatures (AIT) of most hydrocarbon fuels, solvents, and anesthetic agents fall between 204°C and 538°C (400°F and 1000°F) in air at 1 atm pressure (see Table F.2.1). Generally, the AIT of the paraffinic hydrocarbons decreases with increasing molecular weight. A few hydrocarbon-type combustibles, such as ethyl ether, n-amyl ether, and acetaldehyde, can autoignite below 204°C (400°F) in air. Carbon disulfide can also ignite at a low temperature [90°C (194°F)]. These AIT are primarily applicable to hot surface

Table F.2.1 Ignition and Flammability Properties of Combustible Liquids and Gases in Air and Oxygen at Atmospheric Pressure

Combustible	Flash Point ^a		Minimum Ignition Temperature ^b				Minimum Ignition Energy ^c		Flammability Limits ^d Vol. %				
	Air		Air		Oxygen		Air	Oxygen	Air		Oxygen		
	°C	°F	°C	°F	°C	°F	mJ	mJ	LFL	UFL	LFL	UFL	
Hydrocarbon Fuels													
Methane	Gas		630	1166	—		0.30	0.003	5.0	15	5.1	61	
Ethane	Gas		515	959	506	943	0.25	0.002	3.0	12.4	3.0	66	
n-Butane		-60	-76	288	550	278	532	0.25	0.009	1.8	8.4	1.8	49
n-Hexane		-3.9	25	225	437	218	424	0.288	0.006	1.2	7.4	1.2	52 ^c
n-Octane		13.3	56	220	428	208	406	—	—	0.8	6.5	≤0.8	—
Ethylene	Gas			490	914	485	905	0.07	0.001	2.7	36	2.9	80
Propylene	Gas			458	856	423	793	0.28	—	2.4	11	2.1	53
Acetylene	Gas			305	581	296	565	0.017	0.0002	2.5	100	≤2.5	100
Gasoline (100/130)		-45.5	-50	440	824	316	600	—	—	1.3	7.1	≤1.3	—
Kerosene		37.8	100	227	440	216	420	—	—	0.7	5	0.7	—
Anesthetic Agents													
Cyclopropane	Gas			500	932	454	849	0.18	0.001	2.4	10.4	2.5	60
Ethyl ether		-28.9	-20	193	380	182	360	0.20	0.0013	1.9	36	2.0	82
Vinyl ether		-30	<-22	360	680	166	331	—	—	1.7	27	1.8	85
Ethylene chloride	Gas			490	914	485	905	0.07	0.001	2.7	36	2.9	80
Chloroform		-50	-58	516	961	468	874	—	—	4.0	14.8	4.0	67
-----Nonflammable-----													
Enflurane		>200	93	NA		NA		NA	NA	NA	NA	9.8	NA
Isoflurane		>200	93	NA		NA		NA	NA	NA	NA	8.8	NF
Desflurane		NF		NA		NA		NA	NA	NA	NA	17.2	20.8
Nitrous oxide													
-----Nonflammable-----													
Solvents													
Methyl alcohol		12.2	54	385	725	—		0.14	—	6.7	36	≤6.7	93
Ethyl alcohol		12.8	55	365	689	—		—	—	3.3	19	≤3.3	—
n-Propyl alcohol		15	59	440	824	328	622	—	—	2.2	14	≤2.2	—
Glycol		111	232	400	752	—		—	—	3.5 ^c	—	≤3.5	—
Glycerol		160	320	370	698	320	608	—	—	—	—	—	—
Ethyl acetate		-4.4	24	427	800	—		0.48	—	2.2	11	≤2.2	—
n-Amyl acetate		24.4	76	360	680	234	453	—	—	1.0	7.1	≤1.0	—
Acetone		-17.8	0	465	869	—		1.15	0.0024	2.6	13	≤2.6	60 ^c
Benzene		-11.1	12	560	1040	—		0.22	—	1.3	7.9	≤1.3	30
Naphtha (Stoddard)		37.8	~100	232	~450	216	~420	—	—	1.0	6	≤1.0	—
Toluene		4.4	40	480	896	—		2.5	—	1.2	7.1	≤1.2	—
Butyl chloride		-6.7	20	240	464	235	455	0.332	0.007 ^c	1.8	10	1.7	52 ^c
Methylene chloride		—		615	1139	606	1123	—	0.137	15.9 ^c	19.1 ^c	11.7 ^c	68
Ethylene chloride		13.3	56	476	889	470	878	2.37	0.011 ^c	6.2	16	4.0	67.5
Trichloroethane		—		458	856	418	784	—	0.092	6.3 ^c	13 ^c	5.5 ^c	57 ^c
Trichloroethylene		32.2	90	420	788	396	745	—	18 ^c	10.5 ^c	41 ^c	7.5	91 ^c
Carbon tetrachloride													
-----Nonflammable-----													
Miscellaneous Combustible													
Acetaldehyde		-27.2	-17	175	347	159	318	0.38	—	4.0	60	4.0	93

(continues)

Table F.2.1 Continued

Combustible	Flash Point ^a		Minimum Ignition Temperature ^b				Minimum Ignition Energy ^c		Flammability Limits ^d Vol. %			
	Air		Air		Oxygen		Air	Oxygen	Air		Oxygen	
	°C	°F	°C	°F	°C	°F	mJ	mJ	LFL	UFL	LFL	UFL
Acetic acid	40	104	465	869	—	—	—	—	5.4 ^e	—	≤5.4	—
Ammonia	Gas	—	651	1204	—	—	>1000	—	15.0	28	15.0	79
Aniline	75.6	168	615	1139	—	—	—	—	1.2 ^e	8.3	≤1.2	—
Carbon monoxide	Gas	—	609	1128	588	1090	—	—	12.5	74	≤12.5	94
Carbon disulfide	-30	-22	90	194	—	—	0.015	—	1.3	50	≤1.3	—
Ethylene oxide	<17.8	<0	429	804	—	—	0.062	—	3.6	100	≤3.6	100
Propylene oxide	-37.2	-35	—	—	400	—	0.14	—	2.8	37	≤2.8	—
Hydrogen	Gas	—	520	968	400	752	0.017	0.0012	4.0	75	4.0	95
Hydrogen sulfide	Gas	—	260	500	220	428	0.077	—	4.0	44	≤4.0	—
Bromochloro- methane	—	—	450	842	368	694	—	—	NF ^f	NF	10.0	85
Bromotrifluoro- methane	Gas	—	>593	>1100	657	1215	—	—	NF	NF	NF	NF
Dibromodifluoro- methane	Gas	—	499	930	453	847	—	—	NF	NF	29.0	80

^aData from references 1 and 2 (see Section F.5); open-cup method.

^bData from references 3, 4, 5, and 6 (see Section F.5).

^cData from references 3, 7, 8, 9, and 10 (see Section F.5).

^dData from references 3, 4, 6, 11, and 12 (see Section F.5).

^eData at 93°C (200°F).

^fNF: No flammable mixtures found in Footnote ^d.

ignitions in quiescent atmospheres and where the heat source is relatively large. Vessels of Pyrex[®] or stainless steel usually have the lowest AIT. As a rule, AIT do not vary greatly with fuel concentration except at near-limiting concentrations, where they increase noticeably. Fuel injection pressure can also be important. The AIT of many lubricants decrease as much as 102°C (200°F) when the injection pressure is increased from 0 to about 6895 kPa (gauge pressure of 1000 psi).

Figure F.2.2.1 shows the noticeable effect that fluid injection pressure can have on the minimum AIT of a diester (MLO-54-581) and several silicate-type (MLO-54-856, MLO-8200, MLO-54-645, MLO-54-540) hydraulic fluids. This figure also illustrates that the AIT of a chlorinated silicone fluid (MLO-53-446) and a mineral oil (MIL-H-5606) are independent of injection pressure to 34,475 kPa (gauge pressure of 5000 psi).

F.2.2.2 Although AIT tend to be lower in oxygen than in air, such differences are not significant for many hydrocarbon combustibles. Similarly, the AIT for many combustibles do not vary greatly when the ambient pressure is increased to a few atmospheres. However, at highly reduced pressures (<1 atm) or reduced-oxygen concentrations (<21 percent), AIT tend to be noticeably higher than in air at 1 atm. Thus, the autoignition hazard is less severe in such atmospheres. The use of an inert diluent of higher thermal conductivity than nitrogen (e.g., helium) also reduces the autoignition hazard in some instances. Because AIT are normally dependent on oxygen partial pressure, the data obtained at various oxygen percentages can be used to estimate AIT at various total pressures.

In the case of lubricants and hydraulic fluids, the effect of oxygen concentration on AIT tends to be greater than observed for the neat hydrocarbon combustibles in Table F.2.1.

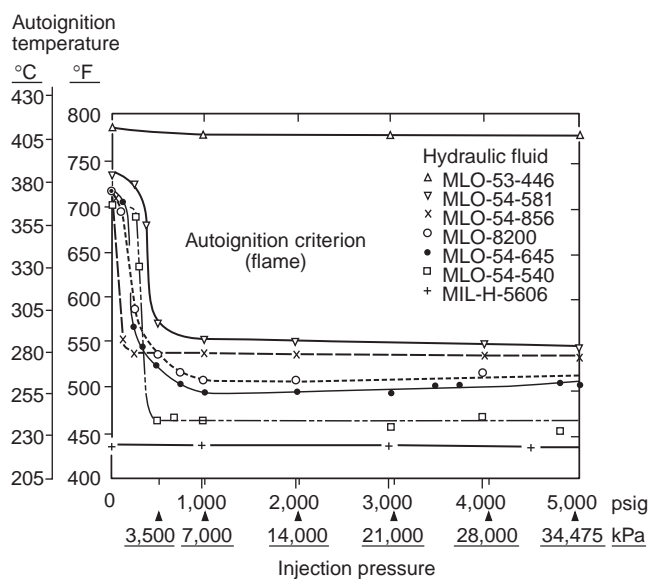


FIGURE F.2.2.1 Minimum Autoignition Temperatures of Seven Hydraulic Fluids in Air at Atmospheric Pressure and at Various Injection Pressures (200 cm³ Pyrex[®] Vessel). (13)

Figure F.2.2.2(a) shows that the AIT for five of the hydraulic fluids decrease between 93°C and 149°C (200°F and 300°F) when the oxygen content is increased from 21 percent to 100 percent. The AIT of the chlorinated silicone fluid (MLO-53-446) and the mineral oil (MIL-H-5606) are unaffected by such changes in oxygen concentration, similar to when these fluids are subjected to varying injection pressure.

A correlation of AIT with oxygen partial pressure is shown in Figure F.2.2.2(b) for several such combustible fluids at various initial pressures and oxygen concentrations. According to these data, the aromatic ether and chlorinated silicone fluids would be favored over the other fluids for protection against autoignition.

F.2.2.3 In comparison with autoignition, the spark ignition of a flammable mixture requires much higher temperatures and is governed primarily by the rate of energy input rather than by the heat source temperature. The importance of minimum spark ignition energies is evidenced by the fact that most flammable mixtures of combustibles can be ignited in air or oxygen by the energy dissipated from common electrostatic discharges. The range of ignition energy values provided in Table F.2.1 is from about 0.1 mJ to 3 mJ for most of the hydrocarbon fuels, anesthetics, and solvents with air as the oxidant. Ammonia and some of the halogenated hydrocarbons (halons) require ignition energies of much higher magnitude (>1000 mJ). In comparison, such combustibles as acetylene, hydrogen, and carbon disulfide can be ignited with spark energies of only about 0.015 mJ.

F.2.2.4 Minimum ignition energy values refer to the most ignitable composition of the given fuel vapor-air mixture and are noticeably higher for mixtures that are highly fuel-lean or fuel-rich. In addition, energy values can be expected to be higher at reduced pressures but much lower in oxygen than in air. Many ignition energy data vary inversely with the approximate square of the total pressure. For some liquids and gases, ignition values are as much as about 100 times lower in oxygen. Figure F.2.2.4 shows the variation of the minimum spark ignition energies of propane-oxygen-nitrogen mixtures with fuel concentration and oxygen concentration at 0.5 and 1 atm pressure. The substitution of helium for nitrogen results in higher ignition energies but does not eliminate the risk of spark ignitions.

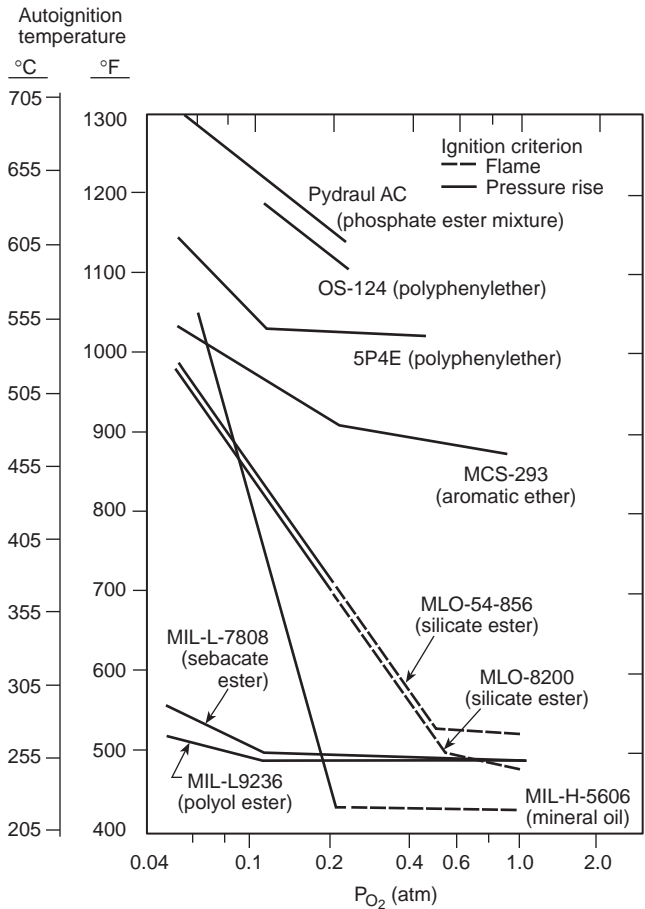


FIGURE F.2.2.2(b) Variation of Minimum Autoignition Temperatures with Oxygen Partial Pressure (P_{O_2}) for Various Lubricants. (13)

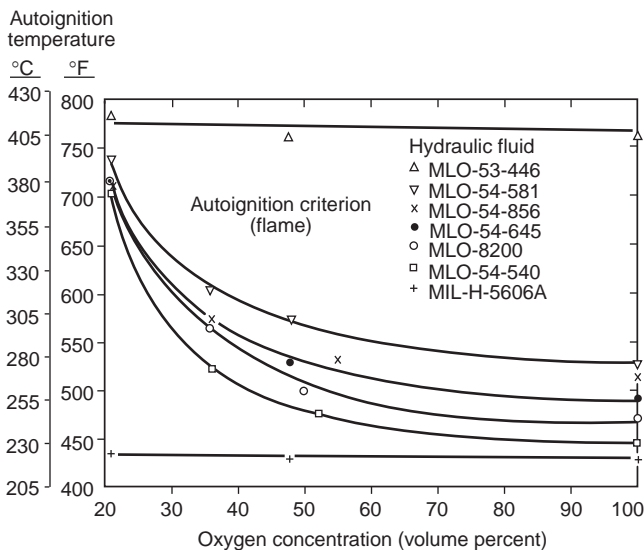


FIGURE F.2.2.2(a) Minimum Autoignition Temperatures of Seven Hydraulic Fluids at Atmospheric Pressure in Various Oxygen-Nitrogen Atmospheres (200 cm³ Pyrex[®] Vessel). (13)

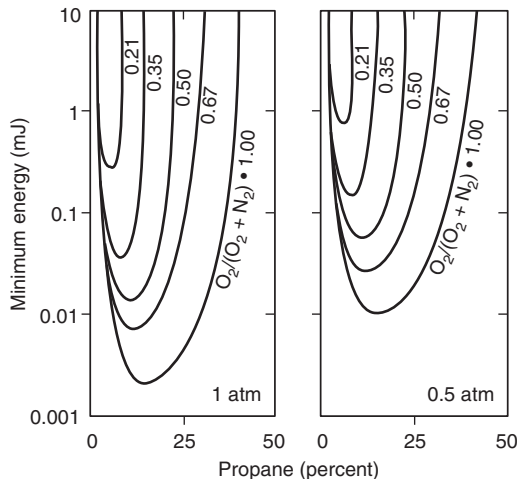


FIGURE F.2.2.4 Effect of Oxygen Index and Ambient Pressure on Minimum Ignition Energies. (9)

F.2.3 Combustion.

F.2.3.1 Nonmetallics. The extent of combustion or flame propagation depends on a number of factors, including the pressure, the temperature, and the composition of the fuel and oxidant. With near-stoichiometric mixtures of hydrocarbon vapors in air, the flames propagate at rates of at least a few feet per second at 1 atm pressure and through apertures as small as about 2.5 mm (0.1 in.) diameter. The rates of flame propagation (flame speeds) normally increase with an increase in chamber diameter.

The maximum pressure rises that are produced by the ignition of such mixtures in a large confined space are generally about 689 kPa (gauge pressure of 100 psi). The explosions are even more severe in oxygen where detonations might occur and the pressure rises and propagation rates are much higher than in air. The transit of a deflagration (subsonic) to a detonation (supersonic) can also occur in air with many fuels if the ratio of the length to the diameter of the reaction chamber is sufficiently great.

F.2.3.2 Metallics. As with nonmetals, the extent of combustion or flame propagation for metals depends on a number of factors, including the absolute pressure, ambient temperature, fuel and oxidizer composition, geometric shape and temperature of the fuel sample, and direction of combustion front. Depending on these factors, the combustion front in metals can propagate at greatly varying rates. For example, a 3.2 mm (0.13 in.) diameter 316 stainless steel rod burning upward in 6.9 MPa (1000 psia) oxygen will propagate at about 11 mm/sec (0.43 in./sec), whereas a 3.2 mm (0.13 in.) diameter 6061 aluminum rod will burn at 64 mm/sec (2.5 in./sec). (14)

Because most metals burn in the liquid phase, chamber diameter normally has little effect on the combustion front propagation rate once a minimum chamber diameter is reached [which allows adequate amounts of oxidizer to surround the fuel to ensure stoichiometric combustion without appreciable (<3 percent) reduction of oxidizer]. In general, the combustion front propagation rate increases with increasing ambient pressure, oxidizer concentration, ambient temperature, and decreasing sample dimensions. (15, 16)

F.2.4 Limits of Flammability of Nonmetallic Materials.

F.2.4.1 The lower or lean limit of flammability is of greatest interest because it defines the minimum combustible concentration required for flame propagation through the particular mixture. The minimum temperature at which a lower limit concentration can exist depends on the volatility of the combustible and corresponds approximately to the flash point of the combustible. Many flammable liquids have flash points in air of less than 38°C (100°F) (see Table F.2.1). Thus, the fuel vapor-air mixtures formed at or above the given temperatures would propagate flame if they are ignited. In oxygen, the flash points are slightly lower than those in air. Where fuel mists or foams are formed, the mixtures present can propagate flame at temperatures far below the flash points of the fuels.

F.2.4.2 The lower limits of most hydrocarbon fuels, anesthetics, and solvents are equal to or less than about 5 volume percent in air or oxygen at 1 atm. Table F.2.1 provides data obtained at ordinary temperatures [$\leq 593^{\circ}\text{C}$ ($\leq 1100^{\circ}\text{F}$)], except where otherwise noted. Vapors and gases, such as ammonia, carbon monoxide, and certain halogenated hydrocarbons, have much higher lower limits.

In comparison, the values for most lubricants are less than 1 volume percent because of the high molecular weights of such fluid. At the same time, lubricants need much higher temperatures, for example, 93°C to 371°C (200°F to 700°F), to form lower limit mixtures than do the paraffins and many other hydrocarbons. (13)

F.2.4.3 Based on weight, the lower limits of the paraffins correspond to about 45 mg (0.00158 oz) of combustible per liter of air. The upper limits for the combustibles vary over a greater range of fuel concentrations. For the paraffinic hydrocarbons, the values in air are equal to or less than 15 percent. The values are as high as 100 percent for materials such as acetylene and ethylene oxide. That is, their vapors can decompose exothermally and propagate flame in the absence of air or oxygen.

F.2.4.4 Although most lower limits in oxygen do not differ greatly from those in air, the upper limits are usually much higher in oxygen and tend to be above 50 percent for many materials. Furthermore, some combustibles, such as the "halon" agents (bromochloromethane and dibromodifluoromethane), are flammable in oxygen over a wide range of fuel compositions, whereas they do not appear to be flammable in air. Of the halogenated solvents, trichloroethylene displays the widest range of flammability in air and oxygen, although elevated temperatures are necessary.

F.2.4.5 Ordinarily, the range of flammable mixtures increases with a moderate increase in pressure or temperature. In particular, the upper limits increase, but the increase is not always noticeable where the fuel vapor pressure is not a limiting factor. The lower limits are least affected by changes in pressure or temperature or by the addition of diluents.

F.2.4.6 Diluents or inerting agents are frequently used in explosion-preventive measures. Nitrogen is a more effective diluent than helium but not as effective as carbon dioxide [see Figure F.2.4.6(a)] or water vapor. Figure F.2.4.6(a) and Figure F.2.4.6(b) show the complete range of flammable mixture compositions that might be expected with a hydrocarbon fuel, such as cyclopropane in air or oxygen, and various diluents at atmospheric pressure. The minimum oxygen percentage below which most hydrocarbon mixtures are not flammable is about 14 percent with CO₂ diluent and 10 percent to 12 percent with N₂ diluent. The corresponding values for hydrogen and carbon monoxide are 6 percent and 5 percent to 5.5 percent, respectively. In general, most combustible liquids and gases can be expected to form flammable mixtures over a wide range of oxygen or oxygen-diluent concentrations.

F.2.5 Limits of Flammability — Metals. Flammability limits, as such, do not exist for most structural metal alloys, because they burn in the liquid phase rather than the vapor phase. However, two measures of the relative flammability of metals exist that are of practical value. The measures are the minimum oxygen pressure required to support combustion of a standard sample (threshold pressure) and the minimum oxygen concentration required to support combustion of a standard sample at a given pressure (oxygen index). Data on the threshold pressures and oxygen indices of metals and alloys are provided in F.3.4.

F.3 Combustible Solids.

F.3.1 General. The combustibility data obtained by different researchers under various conditions of tests make direct comparison and interpretation of the results difficult. Very little, if any, available data seem to exist on large-scale tests of

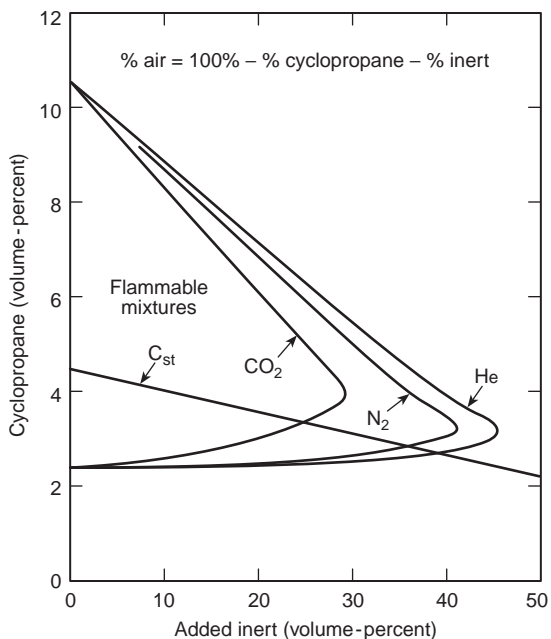


FIGURE F.2.4.6(a) Limits of Flammability of Cyclopropane-Carbon Dioxide-Air, Cyclopropane-Nitrogen-Air, and Cyclopropane-Helium-Air Mixtures at 25°C (86°F) and Atmospheric Pressure. (6) (C_{st} = stoichiometric composition = line-defining amount of combustible vapor required for complete combustion.)

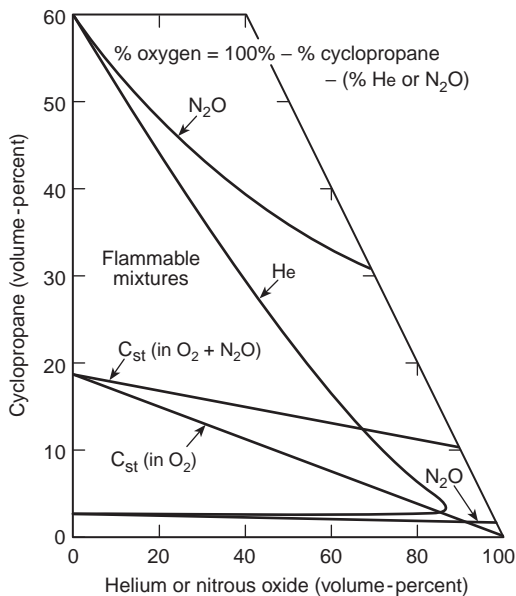


FIGURE F.2.4.6(b) Limits of Flammability of Cyclopropane-Helium-Oxygen and Cyclopropane-Nitrous Oxide-Oxygen Mixtures at 25°C (86°F) and Atmospheric Pressure. (6) (C_{st} = stoichiometric composition = line-defining amount of combustible vapor required for complete combustion.)

materials under simulated OEA conditions. For any specific material, ignition and flammability data are dependent on such factors as the following:

- (1) Specimen: Size, shape, density, color, and surface treatment
- (2) Ignition source: Heat flux rate plus time
- (3) Position of the specimen with reference to the ignition source and direction of the gravitational or convective field
- (4) Surroundings: Size of enclosure and ambient temperature
- (5) Venting: External airflow
- (6) Inerting: Oxygen deficiency and carbon dioxide buildup

F.3.2 Ignition Temperature and Energy.

F.3.2.1 Organic solid materials in the form of finely dispersed dust clouds are extremely susceptible to combustion when heated to temperatures of generally less than 538°C (1000°F) and where spark ignition energies are less than 0.1 J. The degree of this type of fire hazard has been expressed conveniently in the literature as an explosibility index with a range of 0 to 10+. According to this scale, vinyls and fluorocarbons are outstanding, with an index of less than 0.10, which agrees with other flammability data (17) on these materials.

The index of explosibility is the product of the ignition sensitivity and the explosion severity. The indices are dimensionless quantities and have a numerical value of 1 for a dust equivalent to the standard Pittsburgh Coal Dust. An explosibility index greater than 1 indicates a hazard greater than that for coal dust. The ignition sensitivity is the product of the ignition temperature multiplied by minimum energy, multiplied by minimum concentration of Pittsburgh Coal Dust, divided by the product of ignition temperature, multiplied by minimum energy, multiplied by minimum concentration of the sample dust under consideration. The explosion severity is the product of maximum explosion pressure multiplied by maximum rate of pressure rise of the sample dust under consideration, divided by the product of maximum explosion pressure, multiplied by maximum rate of pressure rise of Pittsburgh Coal Dust. (17)

F.3.2.2 Single fibers of organic material, such as those of lint, cotton tufts, and fluffy fabrics, are especially vulnerable to a localized heat source such as an electrical discharge. Single cotton fibers can be ignited by a 0.02 J static spark in 100 percent oxygen but not in 64 percent oxygen in air. Fibers contaminated with greasy substances can be ignited by much weaker sparks. (18)

F.3.2.3 Textile fabrics, such as those used in clothing, can be ignited and burned by high-energy repetitive electrical sparks. For example, both cotton and wool have been ignited with a spark energy as low as 2.3 J in 100 percent oxygen at atmospheric pressure, whereas, in normal air, a spark energy as high as 193 J was required. Silk and polyester fabrics are more difficult to ignite than cotton or wool. Oily fabrics are highly flammable and can be ignited with a spark energy as small as 1/10,000 of that for a clean sample. (19)

F.3.2.4 Frictional sparks in 100 percent oxygen can be much more incendiary than in air. For example, a grinding wheel in contact with metal that produces low-energy sparks incapable of igniting fuel vapors normally requiring only 0.0003 J spark energy in air will ignite textile fabrics in 100 percent oxygen due to increased reactivity of the abrasive particles in oxygen.

Cotton and wool fabrics can also be ignited by a spark from the impact of a hardened steel tool against a rusty steel plate.

F.3.2.5 Combustible materials, when heated, can self-ignite at relatively low temperatures that approach the SIT or AIT obtained under ideal test conditions. Limited data and theory indicate that the SIT for typical materials, such as polyethylene and polyvinyl chloride, decrease linearly with an increase in partial pressure of the oxygen. A decrease of about 93°C (200°F) in SIT is indicated for these materials with an increase in oxygen partial pressure from 155 mm [21 kPa (absolute pressure of 3.0 psi)] to 760 mm [101 kPa (absolute pressure of 14.7 psi) (1 atm)]. Temperatures much higher than those for SIT are indicated to cause hot surfaces to ignite materials by direct contact. For example, polyvinyl chloride will not ignite when exposed to a surface temperature of 649°C (1200°F) in air. However, in 100 percent oxygen at 1 atm, this material will ignite at about 393°C (740°F). (20)

Other test results show that, for cotton sheeting, the minimum hot plate temperature for ignition decreases from 465°C (869°F) in normal air to 360°C (680°F) in 100 percent oxygen at 1 atm. For this same material, decrease in the temperature with increase in the air pressure from 1 atm to 6 atm is about equal to that specified for 100 percent oxygen. No ignition for Nomex® was obtained under similar test conditions in normal air. However, ignition does occur at 520°C (968°F) in 100 percent oxygen at 1 atm and at 560°C (1040°F) in air at 6 atm. (21)

F.3.2.6 All metals, with the possible exception of the noble metals (gold and platinum), can be expected to ignite in oxygen at some elevated temperature and pressure. Metals most liable to ignition hazards are those configured with high surface-to-volume ratios such as dusts, thin sheets, wires, and wire meshes. When the bulkier structural elements of systems containing pressurized oxygen ignite and burn, the results are often catastrophic, due to the explosionlike release of high-pressure gases and ejection of burning debris. Ignition mechanisms include mechanical impact, particle impact, friction, electrical arc and spark, resonance, rupture, exposure of fresh metal surfaces, and promoted ignition. The most ignitable common metals are titanium, magnesium, and lithium; the least ignitable are nickel, copper, and cobalt. Increase in oxygen pressure and content promotes the ignition of metals at lower temperatures. (22)

F.3.2.6.1 Ignition of metals by frictional heat is a commonly recognized hazard in rotating machinery for oxygen service. (23–26) Frictional ignition is controlled by two factors: the resistance of the material to ignition and combustion due to its chemical composition (chemical kinetics) and the ability of the material to generate heat by friction. The combined effect of these factors is reflected in the product of the contact pressure [P = test specimen contact pressure at ignition (loading force divided by initial contact area)] and the velocity (v = relative velocity between the rubbing components) required for the ignition of metallic test specimens tested in standard configuration and conditions. Table F.3.2.6.1 shows the P_v product required for ignition of 2.5 cm (1 in.) diameter \times 0.25 cm (0.1 in.) wall \times 2 cm (0.8 in.) long specimens rotated axially with end rubbing in stagnant 6.9 MPa (1000 psia) oxygen. Tests were conducted by keeping v constant at 22 m/sec (72.4 ft/sec) and increasing P at a rate of 35 N/sec (7.5 lbf/sec) until ignition.

Table F.3.2.6.1 Friction Ignition Test Data for Similar Pairs of Test Specimens (23, 26–28)

Test Materials	P_v Product at Ignition	
	$W/m^2 \times 10^{-8}$	$lbf/in.^2 \times ft/min \times 10^{-6}$
Inconel MA 754	3.96-4.12*	11.30-11.75 ²⁷
Inconel MA 758	2.64-3.42	7.53-9.76
Nickel 200	2.29-3.39	6.50-9.66 ²⁶
Inconel 600	2.00-2.91	5.70-8.30 ²⁶
Inconel 625	1.63-1.73	4.65-4.94
Monel® 400	1.44-1.56	4.12-4.46 ²⁶
Monel® K-500	1.37-1.64	3.91-4.68 ²⁶
Inconel 718	1.10-1.19	3.13-3.37 ²⁷
17-4 PH (H 900)	1.00-1.21	2.87-3.45 ²⁸
304 Stainless steel	0.85-1.20	2.33-3.41 ²⁷
Brass CDA 360	0.70-1.19	1.98-3.41 ²⁶
17-4 PH (Cond. A)	0.61-1.05	1.75-2.99 ²⁸
316 Stainless steel	0.53-0.86	1.50-2.50 ²⁶
Aluminum 6061-T6	0.061	0.18 ²⁶
Ti-6Al-4V	0.0035	0.01 ²⁶

Note: The source of all unannotated data is previously unpublished frictional heating tests performed at NASA White Sands Test Facility.

*This material did not ignite at these P_v products.

F.3.2.6.1.1 When frictional ignition test specimens made from different metals are rubbed together, the metal that is least resistant to ignition by friction tends to control the ignition threshold. (28) For example, when Monel® 400 and 316 stainless steel are rubbed together, the pair ignites within the range of the P_v products required to ignite the stainless steel, thereby degrading the performance of the Monel 400. (29)

F.3.2.6.1.2 Figure F.3.2.6.1.2 provides the P_v products required for the frictional ignition of three alloys as a function of oxygen pressure. In the case of carbon steel 1015 and 316 stainless steel, there exists a pressure where increasing or decreasing pressure produces increases in the P_v products required for ignition. At the pressure where the minimum P_v product occurs, it is believed that the heat rate produced by the oxidation process is equal to the heat loss rate. The ignition process at pressures lower than this minimum are dominated by oxidation kinetics, whereas, at pressures above this minimum, the ignition process is dominated by heat loss from the material. (26)

F.3.2.6.2 The impact of high-velocity particles on surfaces has been suspected for many years to be the cause of fires in OEs. (30–33) Pressure; temperature; particle size, quantity, and type; target material and configuration; and oxygen concentration all affect the likelihood of particle impact ignition. Generally, the likelihood of particle impact ignition increases with increasing particle velocity, target temperature, and oxygen concentration. The ignition/no ignition response of five structural alloys subjected to supersonic impact of single 2000 μ m (0.08 in.) diameter aluminum particles in 27 MPa (absolute pressure of 3900 psi) oxygen is shown in Figure F.3.2.6.2. (23)

F.3.2.7 Compared with metals, organic materials ignite and burn at relatively low temperatures and energy inputs. Organics include the vast number and combinations of synthetic plastics, wood and paper products, resins, and natural and

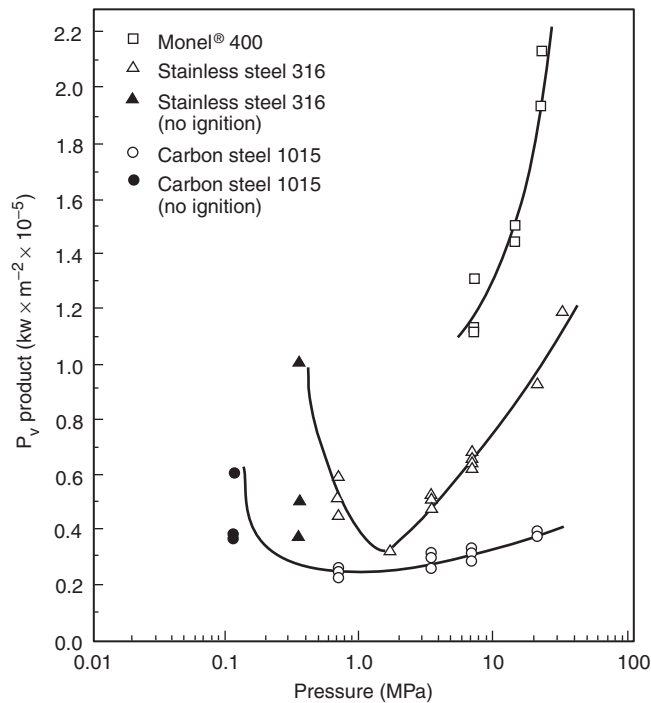


FIGURE F.3.2.6.1.2 Effect of Oxygen Pressure on the P_v Products Required for the Frictional Ignition of Monel® 400, 316 Stainless Steel, and Carbon Steel 1015. (26)

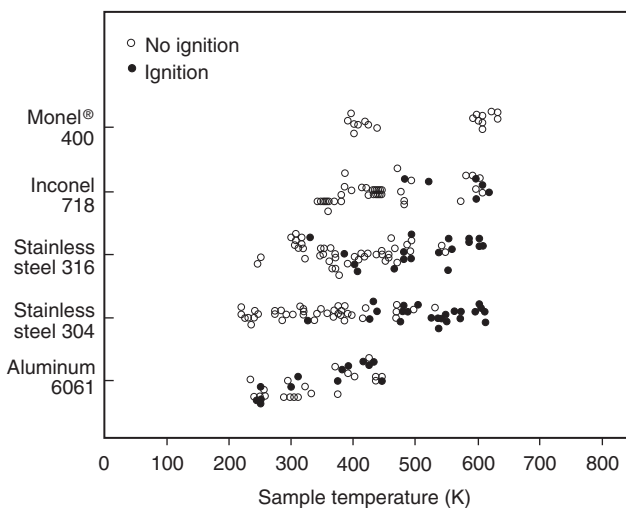


FIGURE F.3.2.6.2 Results of Supersonic Impact of Single 2000 μm (0.08 in.) Diameter Aluminum Particles Impacting Various Alloys in 27 MPa (3900 psia) Oxygen. (23)

synthetic fibers. These materials, unlike metals, are characterized by the occurrence of thermal degradation prior to ignition, whereby combustible gases are generated. This thermal degradation occurs with the more conventional plastics within a narrow range of 204°C to 316°C (400°F to 600°F) corresponding to the flash point temperature for ASTM D1929. Of special interest on the subject of ignitibility are the recent developments in heat-resistant polymers, which show promise

of extending the maximum operating safe temperature range of plastics to 538°C (1000°F). (34)

F.3.2.8 An increase in the oxygen concentration of the atmosphere at constant pressure or an increase in the total pressure at constant composition (increased partial pressure of oxygen) results in a significant lowering of the ignition temperature as shown by the data in Table F.3.2.8. (21)

Fire-retardant treatments commonly applied to fabrics for use in a normal atmosphere do not prevent ignition in OEA and might even lower the ignition temperature.

F.3.2.9 Experiments in which samples of polyethylene and polyvinyl chloride were heated in an oxygen atmosphere in a furnace at a temperature slightly below the standard ignition temperature resulted in ignition after delays of an hour or more. The temperature of the sample was observed to rise as much as 38°C (100°F) above the furnace temperature just prior to ignition, indicating the occurrence of an oxidation reaction taking place in the solid sample. (20) The slow oxidation of organic materials subjected to slightly elevated temperatures in an OEA can be an easily overlooked source of ignition in such systems.

F.3.2.10 The ignitibility of nonmetallic materials is also affected by the thermal conductivity of the diluent gas used with oxygen. An appreciable increase in energy input is required for ignition where nitrogen is replaced with helium. This increase can be of some benefit in reducing the possibility of ignition from electrically overheated wiring by greater cooling from exposed hot surfaces in helium. (35) (As a cautionary note, see F.3.3.6.)

F.3.3 Combustion — Nonmetallic Materials.

F.3.3.1 There is general agreement that nonmetallic materials are made more flammable by increasing the partial pressure of the oxygen in an air mixture rather than by increasing the total pressure of air. Thus, a mixture of 42 percent O_2 and 58 percent N_2 at 1 atm pressure is more hazardous than a 21 percent oxygen normal air mixture compressed to 2 atm, although the same amount by weight of oxygen is present in both mixtures. It is also recognized that materials in 100 percent oxygen at 258 mm Hg (absolute pressure of 5 psi) are more flammable than those in normal air at 1 atm. Small increases in oxygen concentration at atmospheric pressure have a similar effect on the flammability of many materials, (35) as is shown in Table F.3.3.1. Only glass fiber materials, Teflon, and other fully fluorinated materials, of those tested, appear to be safe for use in OEAs. However, caution is necessary. Glass fabrics (and asbestos fabrics) frequently contain an organic sizing material that burns vigorously in OEAs. Thin films of Teflon, Kel-F®, and other fluorocarbons will also sustain combustion in OEAs, but thicker sections burn only if strongly heated from an external source.

F.3.3.2 Chemical additives to solid plastics and textile fabrics, such as halogens, borax, phosphates, and various metal oxides, are effective in reducing both ignitibility and flammability. Impregnating cotton fabric with borax/phosphate compounds is effective in increasing the fire resistance of this material. However, protection is limited to atmospheres with less than 30 percent to 35 percent oxygen content. (21, 35, 36)

F.3.3.3 Ignitibility data are given for high-temperature wiring operating in 100 percent oxygen at 34 kPa (absolute pressure of 5 psi). (37) The insulation of the wires, consisting of Teflon,

Table F.3.2.8 Minimum Hot Plate Ignition Temperatures of Six Combustible Materials in Oxygen-Nitrogen Mixtures at Various Total Pressures

Material	Oxidant	Ignition Temperature (°C)			
		Total Pressure (atm)			
		1	2	3	4
Cotton sheeting	Air	465	440 (425) ^a	385	365
	42% O ₂ , 58% N ₂	390	370	355	340
	100% O ₂	360	345	340	325
Cotton sheeting, treated ^b	Air	575	520 (510) ^a	485 (350) ^a	370 (325) ^a
	42% O ₂ , 58% N ₂	390 (350) ^a	335	315	295
	100% O ₂	310	—	300	285
Conductive rubber sheeting	Air	480	395	370	375
	42% O ₂ , 58% N ₂	430	365	350	350
	100% O ₂	360	—	345	345
Paper drapes	Air	470	455	425	405
	42% O ₂ , 58% N ₂	430	—	400	370
	100% O ₂	410	—	365	340
Nomex [®] fabric	Air	>600	>600	>600	560
	42% O ₂ , 58% N ₂	550	540	510	495
	100% O ₂	520	505	490	470
Polyvinyl chloride sheet	Air	>600	—	495	490
	42% O ₂ , 58% N ₂	575	—	370	350
	100% O ₂	390	—	350	325

^aValues in parentheses indicate the temperature at which material glowed.

^bCotton sheeting treated with DuPont[®] X-12 fire retardant; amount of retardant equal to 12 percent of cotton specimen weight.

Nomex[®], Kapton[®], Kynar[®], silicone, and polyolefin, and combinations of these, was subjected to both external heat and internal heat from overloaded electrical wires. Polyolefin and silicone were flammable to the extent that these would not be suitable for use in oxygen. Teflon burns only under extreme conditions, requiring external heating and an intense electrical spark to ignite the combustion vapors. Although Kapton insulation is resistant to ignition in OEAs, it is subject to arc tracking, which might ignite adjacent material. (38, 39) Potting compounds, circuit boards, and other components of the electrical system can also contribute to the fuel supply in an OEA.

F.3.3.4 The rate of flame spread over the surface of a combustible material provides an indication of the speed at which a fire involving the combustible will develop (see Table F.3.3.4). Reported measurements of flame spread rates in an OEA show wide variations principally due to differences in experimental techniques. Flame spread rates are much greater in the upward direction, due to buoyant convection, than in the horizontal or downward direction.

F.3.3.5 The rate of flame spread increases with an increase in the oxygen concentration at constant pressure or with an increase in the total pressure at a constant percentage of oxygen (increased oxygen partial pressure). Table F.3.3.5 shows typical data for the burning rate of filter paper over a wide range of pressure and atmospheric composition. (40) In many cases, the rate of flame spread at constant atmospheric composition shows a fair correlation with the square root of the total pressure.

F.3.3.6 At high-oxygen concentrations, a flash fire can spread over the surface of fabrics having a nap of fine fibers at a very high rate [508 mm/sec (20 in./sec) or higher]. This nap fire is of short duration, but it can ignite more sustained fires at

edges, seams, and folds and, thus, spreads the fire very rapidly. (42)

F.3.3.7 The combustibility of the material is affected by the diluent gas used with oxygen. It has been shown that flame spread rate is directly related to the log function of the heat capacity of the gas mixture, which can be extrapolated to zero flammability. Appreciable increase in the flame spread rate is observed where helium replaces nitrogen in air mixtures. (40, 43)

F.3.3.8 Data from three standard test methods, as shown in Table F.3.3.8, are commonly used to evaluate the suitability of nonmetallic materials for oxygen service. The autogenous ignition temperature (AIT) determined by ASTM G72 (or equivalent) provides an indication of the sensitivity of a material to ignition in high-pressure oxygen. The AIT of a material indicates the temperature at which the material spontaneously ignites under the standard test conditions (~1500 psi). The material with the highest AIT, suitable for the application, is usually preferred.

The heat of combustion (H of C) determined by ASTM D4809 (or equivalent) provides an indication of the intrinsic heat content of the material when fully consumed in an oxygen-enriched environment. The H of C of a material provides an indication of the damage potential when a material ignites and burns in an oxygen-enriched environment. The material with the lowest H of C, suitable for the application, is usually preferred.

The oxygen index (OI) of a material determined by ASTM G125 or ASTM D2863 (or equivalent) indicates the percentage of oxygen (typically flowing in nitrogen) required for a material to self-sustain combustion after positive ignition at ambient pressure. The OI of a material provides an indication of the

Table F.3.3.1 Flame Resistance of Materials Held Vertically at One Atmosphere Pressure in O₂/N₂ Mixtures

NRL Sample Number	Material	Combustion in O ₂ /N ₂ Mixtures		
		21% O ₂	31% O ₂	41% O ₂
FM-1	Rosin-impregnated paper	Burned		
FM-3	Cotton terry cloth	Burned		
FM-28	Cotton cloth, white duck	Burned		
FM-4	Cotton terry cloth, roxel-treated	No	No	Burned
FM-5	Fleece-backed cotton cloth, roxel-treated	Surface only	Burned	Burned
FM-14	Cotton O.D. Sateen, roxel-treated	No	Burned	—
FM-15	Cotton green whipcord, roxel-treated	No	Burned	—
FM-16	Cotton white duck, roxel-treated	No	Burned	—
FM-17	Cotton King Kord, roxel-treated	No	Burned	—
FM-29	Cotton white duck, treated with 30% boric acid, 70% borax	No	Burned	Burned
FM-30	Cotton terry cloth, treated with 30% boric acid, 70% borax	No	Burned	Burned
FM-6	Fire-resistant cotton ticking	No	Burned	—
FM-7	Fire-resistant foam rubber	No	No	Burned
FM-9	Nomex temperature-resistant nylon	No	Burned	—
FM-10	Teflon fabric	No	No	No
FM-11	Teflon fabric	No	No	No
FM-12	Teflon fabric	No	No	No
FM-13	Teflon fabric	No	No	No
FM-19	Verel fabric	No	Burned	Burned
FM-22	Vinyl-backed fabric	No	Burned	Burned
FM-23	Omnicoated DuPont [®] high-temperature fabric	No	Burned ^a	Burned
FM-24	Omnicoated glass fabric	No	No	Burned ^a
FM-20	Glass fabric, fine weave	No	No	No
FM-21	Glass fabric, knit weave	No	No	No
FM-25	Glass fabric, coarse weave	No	No	No
FM-26	Glass fabric, coarse weave	No	No	No
FM-27	Aluminized asbestos fabric	No	No	Burned
FM-32	Rubber from aviator oxygen mask	Burned	Burned	Burned
FM-33	Fluorolube grade 362	No	No	No ^b
FM-34	Belco no-flame grease	No	No	No ^b

^aBurned only over igniter.^bWhite smoke only.

Table F.3.3.4 Effect of Oxygen on Flame Spread Rates over Various Materials (Edges Not Inhibited)

Material	Flame Spread Rate (mm/sec)	
	In Air	In 258 mm Hg Oxygen
Aluminized Mylar® tape	—	49.53
Aluminized vinyl tape	NI	78.74 ± 10.16
Asbestos insulating tape	NI	2.03
Butyl rubber	0.152	0.40 ± 0.04
Canvas duck	NP	6.35
Cellulose acetate	0.305	7.1
Chapstick	NI	46.23
Cotton shirt fabric	NP	38.1 ± 1.27
Electrical insulating resin	NI	6.86
Electrical terminal board	NI	1.524 ± 0.254
Fiberglass insulating tape	NI	106.68 ± 15.24
Foam cushion material	4.83	314.96
Foamed insulation	0.051	55.88 ± 5.08
Food packet, aluminized paper	NI	7.112 ± 1.27
Food packet, brown aluminum	NI	17.78 ± 7.62
Food packet, plastic	8.38	13.97
Glass wool	NI	NI
Kel-F	NI	NI
Masking tape	4.32	46.228
Natural rubber	0.254	15.49
Neoprene rubber	NI	(8.13 ± 1.0)
Nylon 101	NI	(4.83 ± 1.27)
Paint, Capon, ivory	NI	9.652 ± 1.016
Paint, Pratt & Lambert, grey	NI	15.24 ± 5.08
Plexiglas®	0.127	(8.89 ± 0.25)
Polyethylene	0.356	(6.35 ± 1.27)
Polypropylene	0.254	(8.89 ± 0.25)
Polystyrene	0.813	(20.32 ± 5.08)
Polyvinyl chloride	NI	(2.54 ± 0.25)
Pump oil	NI	122.606
Refrigeration oil	NI	20.828 ± 1.778
Rubber tubing	0.76	6.096
Silicone grease	NI	23.368
Solder, rosin core	NI	4.572
Sponge, washing	1.78	205.74 ± 2.54
Teflon pipe-sealing tape	NI	NI
Teflon tubing	NI	NI
Tygon tubing	4.57	12.7 ± 1.27
Viton A®	NI	(0.076 ± 0.051)
Wire, Mil W76B, blue	NI	—
Wire, Mil W76B, orange	NI	14.478 ± 1.27
Wire, Mil W76B, yellow	NI	—
Wire, Mil W16878, black	NI	NI
Wire, Mil W16878, green	NI	NI
Wire, Mil W16878, yellow	NI	NI
Wire, Mil 16878, white	NI	NI
Wire, misc., black, 3/16	NI	—
Wire, misc., brown, 7/32	NI	12.954 ± 1.27
Wire, misc., white, 3/32	NI	8.382
Wire, misc., yellow, 7/64	NI	22.606
Wire, misc., yellow, 5/32	NI	10.414

NP: No sustained propagation of flame. NI: No ignition of material.

minimum percentage of oxygen necessary before the material would be expected to continue burning once ignited in an oxygen-enriched atmosphere. The material with the highest OI, suitable for the application, is usually preferred.

Table F.3.3.8 provides some oxygen compatibility data for nonmetals at ambient pressure.

F.3.4 Combustion of Metals.

F.3.4.1 There is general agreement that metals are more flammable in oxygen-enriched environments than in air. For example, a 3.2 mm (0.13 in.) diameter rod of Ti-6Al-4V burned completely when ignited at the bottom in commercially pure oxygen at 0.14 MPa (absolute pressure of 20 psi), whereas it did not burn at all in air at 34.5 MPa (absolute pressure of 5000 psi), even though the partial pressure of oxygen was 7.2 MPa (absolute pressure of 1045 psi). (47) This example leads to the general conclusion that commercially pure oxygen at low pressures is more hazardous than air at relatively higher pressures. Whereas small increases in oxygen concentration at atmospheric pressure render nonmetallic materials dramatically more flammable (*see F.3.3.1*), relatively large increases in oxygen concentration and increase in total pressure are required to render most structural metals flammable. Two measures of the relative flammability of metals that are of practical value are the minimum oxygen pressure required to support complete combustion of a standard sample (threshold pressure) and the minimum oxygen concentration required to support combustion of a standard sample at a given pressure (OI).

It should be noted that combustion is considered “complete” when the sample burns up to the point where the sample holder influences the combustion process.

F.3.4.2 The threshold pressures of several alloys and pure metals configured as 3.2 mm (0.13 in.) diameter rods burning in an upward direction are shown in Table F.3.4.2(a) and Table F.3.4.2(b). (48–53) Because the results of combustion tests are highly configuration-dependent, it should be noted that these threshold pressures are not absolute flammability limits. Changing the configuration of the test samples can dramatically affect the threshold pressures. Table F.3.4.2(c) shows the threshold pressures of several metal alloys configured as 60 × 60 wire meshes with a wire diameter of 0.18 mm (0.007 in.). The wire mesh test samples were rolled into 6.4 mm (0.25 in.) diameter cylinders, mounted vertically, and ignited at the bottom. (54) By comparing the threshold pressures for 3.2 mm (0.13 in.) diameter rods and the wire meshes, the dramatic effect of configuration becomes evident.

F.3.4.3 The minimum oxygen concentration required to support combustion of a standard sample (OI) is another important measure of the flammability of metals. The OIs for C-1018 carbon steel tube [25.4 mm (1 in.) outside diameter and 4.8 mm (0.19 in.) wall] are shown in Figure F.3.4.3(a) (55). For most structural alloys, the OI decreases with increasing pressure. (51, 56–60) The OIs for several alloys configured as 3.2 mm (0.13 in.) diameter rods are shown in Figure F.3.4.3(b). (57) The OIs of several alloys configured as rods and tubes are shown in Figure F.3.4.3(c) (58).

Table F.3.3.5 Typical Measured Burning Rates for Strips of Filter Paper at 45 Degree Angle (41)

Total Pressure Gas Composition (dry basis)			Burn Rate, cm/sec					
			0.21 atm	0.53 atm	1.00 atm	4.03 atm	7.06 atm	10.09 atm
% O ₂	% N ₂ ^a	atm abs ft of seawater % He	—	—	0 ft	100 ft	200 ft	300 ft
99.6	0.4	0.0	2.32	3.13	4.19	d	d	d
50.3	49.7	0.0	1.13	1.44	2.36	3.72	5.10	6.34
20.95 ^b	79.05	0.0	1.17	0.80	1.17	3.77	4.06	3.13
			c		1.17	1.78	2.80	3.25
					1.10	2.28		
49.5	0.0	50.5	1.24	1.87	2.96	4.06	4.90	d
				1.90	2.89	4.82		
					2.89			
20.3	0.0	79.7	c	c	c	2.23	2.61	2.49
47.0	24.6	28.4	d	d	2.74	3.66	4.41	5.53
20.9	39.6	39.5	d	d	2.68	4.64	6.78	
					1.38	2.71	3.72	
					1.38	2.28	3.13	
					1.35	2.83	3.56	
					1.27	2.74	3.33	
					1.81	3.00		
					1.72			

^aIncludes any argon that was present.

^bCompressed air.

^cSample would not burn, even with brightly glowing igniter grid.

^dNo run was made under these conditions.

Table F.3.3.8 Oxygen Compatibility Data for Selected Materials (33, 46, 64–74)

Trade Name or Generic Material	Description	AIT (°C)	H of C (cal/grm)	OI (%)
Plastics				
ACLAR 22 and 23	Chlorotrifluoroethylene (PCTFE)	349–390	See PCTFE	95–100
ABS	Acrylonitrile-butadiene-styrene	243	8500	18–39
Delrin, Acetal	Poly(acetyl)	178–195	4029	14.2–16.1
Halar®	Copolymer of ethylene and chlorotrifluoroethylene	171	3254–3900	52
Hypalon Sheet 0.60 in.	Chlorosulfonated polyethylene		6800	25.1
Kel-F 81	PCTFE plastic	388	2300	DNP
Kynar	Polyvinylidene fluoride (PVDF)	268	3277	39–43.7
Lexan	Polycarbonate	286	7407	27
Mylar	Polyethylene terephthalate	181	2300	22.7
Neoflon, M400H-amorphous	PCTFE plastic (Daikin Japan)	382	1220	DNP
Neoflon, M400H-crystalline	PCTFE plastic (Daikin Japan)	377	1230	DNP
Noryl	Polyphenylene oxide blended with polystyrene	348	6615	33.3
Nylon	Nylon 66, polyamide	178–259	7400–7900	23.5–30.5
PEEK	Polyetheretherketone	305–325	7775	35
Plexiglas	Poly(methyl methacrylate)	230	6000	17–18.5
Polycarbonate, generic	Polycarbonate, generic	300–340	7400–9400	22.5–27.4
Polyester	Polyester resin		4300	41.5
Polyethylene (PE)	Polyethylene plastic	176	11100	17.5
PPS	Polyphenylene sulfide	285	6853	43
PP	Polypropylene (PP)	174	11000	17–18
PS	Polystyrene, hard plastic	250	9900	17–23
PVC	Polyvinyl chloride	239	4300	42–65
PVDC	Polyvinylidene chloride		5000	60
Rulon A, E, J, LD	Filled TFE fluorocarbon	360–427	1400–2100	DNP
Teflon FEP	Fluorinated ethylene-propylene	378	2500	77
Teflon PFA	Perfluoroalkoxy tetrafluoroethylene	424	1250	100
Teflon TFE	Polytetrafluoroethylene	427+	1700	95–100
Tefzel	ETFE, copolymer of tetrafluoroethylene and ethylene	243	3538	30
Ultem	Polyetherimide	385	7026	47
Vespel SP21	Polyimide with 15% graphite	328–347	6002–6318	53–65
Zytel	Zytel, polyamide	259	7708	36
Lubricants and Sealants				
PTFE pipe tape (clean)	TFE-fluorocarbon tape thread sealant	427+	See TFE	83–100
Bel-Ray FC1245	PCTFE oil/graphite		3709	DNP
Bel-Ray FC1260	PCTFE oil/graphite		1117	57
Braycote 667	Perfluoroalkyl polyether grease	427+		
Christo-Lube MCG111	Perfluoroalkyl polyether grease	470	1049	DNI
CYL-Seal	Thread sealant		3294	38
Everlube 6711	Colloidal graphite powder	363		
Everlube 811 (cured)	MoS ₂ in sodium silicate	427+		
Fluorolube GR362	PCTFE/filler		4994	67
Fluorolube LG160	PCTFE	382	2516	

(continues)

Table F.3.3.8 *Continued*

Trade Name or Generic Material	Description	AIT (°C)	H of C (cal/grm)	OI (%)
Fluorosilicone grease #822	FS grease			30
Fomblin RT15	Perfluoroalkyl polyether grease	427+	995	DNP
Fomblin Y25 oil	Perfluoroalkyl polyether oil	427+	706	DNI
Gore-Tex joint sealant	0.25- in. thick white			91
Halocarbon PCTFE oil	PCTFE oil (various grades)	385–410	1047–1994	75- DNP
Halocarbon PCTFE grease	PCTFE grease (various grades)	427+	1600–2366	67- DNP
Kel-F-1, 3, 10	PCTFE oil	374–385		
Key Abso-Lute	Thread sealant		5155	67
Krytox 240 AB	Perfluoroalkyl polyether grease	427+		
Krytox 240 AC	Perfluoroalkyl polyether grease	427+	900–1000	DNP
Krytox GPL 105	Perfluoroalkyl polyether grease			DNP
Krytox GPL 205	Perfluoroalkyl polyether grease			DNI
Krytox GPL 225	Perfluoroalkyl polyether grease			DNP
Loctite pipe sealant	Anaerobic sealant (cured)	170–260	4204–7600	17–20
Molykote 321	MoS ₂ fluorocarbon spray	427+	2702	
Molykote Z powder	Pure MoS ₂	260	1709	45
Nujol oil	Mineral HC		10930	
Poly(methyl phenylsiloxane)	Silicone grease, cup test			26 ± 1
Tribolube 13C	PFPE grease, cup test F			DNP
Gaskets				
Blue Gard 3000	Garlock Co., Aramid /Buna N Gasket		3047	30.5 ± 0.5
Blue Gard® 3200, 3400, 3700	Garlock Co., Aramid/Buna N Gasket			31–53
Durabla gasket	Asbestos in GRS binder		1600	28.0 ± .5
Garlock 900 gasket	Asbestos/GRS		1676–1869	23
Gore-Tex	Expanded PTFE		1431	100
Grafoil GHE, GHR	Flexible graphite with SS tang metal interlayer	400+		
Gylon Fawn	Filled PTFE		1069	
Klingersil C4400	Nonasbestos gasket		1376	
Elastomers				
Aflas	Copolymer of TFE and FKM	254–285	3600–4000	
Buna-N (nitrile rubber)	Butadiene-acrylonitrile	173–200	5400–9911	18
Butyl rubber	Copolymer of isobutylene and small quantities of isoprene	208	10789	17.1
Disogren (urethane rubber)	Polyurethane rubber	265–271		
EPR rubber (EPR/EPDM)	Ethylene-propylene rubber	153–206	8833–11287	21.9–25.5
Fluorel	FKM, copolymer of vinylidene fluoride and hexafluoropropylene	297–302	3400–3992	73.9–93.5
Hycar	Nitrile rubber copolymer	180–310	8500	
Hycar 1053	Nitrile rubber copolymer	310		
Hypalon rubber	Chlorosulfonated polyethylene	25–27	6800	
Kalrez	FPM elastomer, generic	355	1565–2089	DNP
Kalrez 1045	FPM elastomer		1565	DNP
Kalrez 4079	FPM elastomer		2090	DNP

(continues)

Table F.3.3.8 *Continued*

Trade Name or Generic Material	Description	AIT (°C)	H of C (cal/grm)	OI (%)
Neoprene GRT	Polychloroprene	166		
Neoprene	Polychloroprene	258	6532	26.3
Neoprene	Diaphragm, nylon reinforced			29.5
Nitrile rubber, generic	Butadiene and acrylonitrile	173	9911	
Nordel (EPDM)	Ethylene propylene rubber		9220	25.5
Silicone rubber (RTV 60)	Poly(methyl phenylsiloxane)		3289	28.5
Silicone rubber (RTV 102)	Poly(methyl phenylsiloxane)		4956	23
Silicone rubber, generic	Poly(methyl phenylsiloxane)	262	4156	27.9–39.2
Poly(methyl methacrylate)	Epichlorohydrin (ECO) rubber			18.5
Viton 77-545®	FKM, Fluorocarbon rubber			78
Viton A	FKM, Fluorocarbon rubber	268–322	3603	57–58
Viton B®, #V494-70	FKM, Fluorocarbon rubber		3089	DNP
Viton E-60C	FKM, Fluorocarbon rubber		3084	60.5
Viton® part #5103-32	FKM, Fluorocarbon rubber			68
Composites				
Epoxy/aramid composite	Composite	217	6223	
Epoxy/fiberglass composite	Composite	258	2495	
Epoxy/graphite composite	Composite	258	7077	
Other Materials				
Asbestos paper				DNI
Cerawool paper				DNI
Cotton	Cotton		4000	
Epoxy cement	Epibond 104	232		41
Fiberglass/cement board				DNI
Grafoil ribbon packing	Graphite	450+	7580	
Kaowool insulation	Alumina/silica fireclay		25	DNI
Nomex nylon	Cloth			27–30
Sindanyo CS51	Asbestos cement board			DNI
Transite	Asbestos cement board			DNI
Turnalite TI 150	Asbestos cement board			DNI

Note: Data for all tests are not available on some materials.

DNI: Did not ignite. DNP: Did not propagate.

F.3.4.4 The OIs for aluminum alloys are affected by the diluent gas used with oxygen. Figure F.3.4.4 shows the threshold pressures of two aluminum alloys configured as 6.4 mm (0.25 in.) diameter rods burning upward in downward-flowing gas and shown as a function of the mole percent of nitrogen and argon in oxygen. (56)

F.4 Test Methods.

F.4.1 General.

F.4.1.1 Various test methods have been used to evaluate materials for use in OEAs, but little progress has been made toward the standardization of such methods. Where possible, it is desirable to pattern such methods after the well-established procedures for the fire hazard rating of materials for use in a normal atmosphere. This use is seldom possible because of the need to make measurements over a wide range of pressure and atmospheric composition, the limitations imposed by a pressure chamber of practical size, and the difficulties in providing suitable gas supplies and ignition sources within the test chamber. Almost all testing in OEAs has been limited to small specimens using laboratory-scale apparatus. Large-scale testing under conditions that simulate actual fire conditions is only beginning.

F.4.1.2 The significance of the various properties of a material that contribute to its fire hazard depend significantly on whether the material is in the gaseous, liquid, or solid phase. It is therefore convenient to discuss test methods under these three headings.

F.4.1.3 The American Society for Testing and Materials Committee G-4 on the Compatibility/Sensitivity of Materials in Enriched-Oxygen Atmospheres is developing and promulgating standard test methods, definitions, recommended practices, classifications for determining the compatibility/sensitivity of materials, materials configurations, and applications intended for use in systems subjected to oxygen-enriched atmospheres. The committee's considerations include, but are not limited to, ignition, combustion, off-gassing, reaction products, and decomposition tendencies.

F.4.2 Gases.

F.4.2.1 Minimum ignition energies are usually determined using a capacitance spark-type discharge. Many of the apparatus are patterned after those of the Bureau of Mines (7, 9) in which flanged electrodes are used and in which quenching distances can also be obtained.

Table F.3.4.2(a) Threshold Pressures^a in Oxygen of 3.2 mm (0.13 in.) Diameter Rods Ignited at the Bottom (48–53)

Material	Threshold Pressure ^a		Next Lower Pressure Tested	
	MPa	psia	MPa	psia
Monel K-500	>68.9	>10,000	—	—
Inconel MA754	>68.9	>10,000	—	—
Monel 400	>68.9	>10,000	—	—
Brass 360 CDA	>68.9	>10,000	—	—
Nickel 200	>55.2	>8,000	—	—
Copper 102	>55.2	>8,000	—	—
Hastelloy C276	20.7	3,000	6.9	1,000
Inconel 600	17.2	2,500	6.9	1,000
Inconel 625	17.2	2,500	6.9	1,000
Hastelloy C22	13.8	2,000	6.9	1,000
Inconel 718	6.9	1,000	5.2	750
440C SS	6.9	2,500	6.9	1,000
316 SS	6.9	500	0.7	100
304 SS	6.9	1,000	3.4	500
17-4 PH SS	6.9	1,000	3.4	500
Weldalite 049	2.1	300	1.7	250
Aluminum 2219	0.17	25	1.4	20
HSLA steel ^b	0.17	25	None	None
Ti-6Al-4V	0.007	1	None	None

^aThreshold pressure is the minimum test pressure required to support complete combustion of the test sample. (See last paragraph of F.3.4.1.)

^bDenotes high-strength low-alloy steel.

F.4.2.2 Flammability limits can be determined under quiescent conditions by the partial pressure method or under flow conditions. The reaction vessel diameter should be at least 51 mm (2 in.) for determinations at 1 atm. Where wall effects are great (e.g., at reduced pressures), quenching distance data should be relied on to determine the suitable vessel size. Also, the ignition source should be of sufficient strength to ignite the test mixture.

F.4.3 Liquids.

F.4.3.1 Flash points of combustible liquids are ordinarily determined in air using such apparatus as the Tag Closed Tester (ASTM D56) and the Cleveland Open Tester (ASTM D92). The closed-cup method tends to give slightly lower temperature values, that is, 6°C to 12°C (10°F to 20°F), for most liquids.

F.4.3.2 Minimum AIT in air or oxygen at atmospheric pressure can be determined using the ASTM recommended apparatus (ASTM E659), which is equipped with an open 200 cm³ (12 in.³) Pyrex[®] Erlenmeyer flask. At reduced pressures or oxygen concentrations, larger test vessels are necessary to avoid possible wall effects. Modified ASTM apparatus, such as those used by the Bureau of Mines, (8) are suitable for reduced- and elevated-pressure determinations.

F.4.4 Solids.

F.4.4.1 The National Aeronautics and Space Administration (NASA) has published procedures for the evaluation of materials for use in spacecrafts. (61) These procedures include the following:

- (1) Combustion of materials
- (2) Heat release rates
- (3) Odor and off-gassing tests of nonmetallic materials

- (4) Electrical wire insulation flammability test
- (5) Mechanical and pneumatic test of materials in gaseous and liquid oxygen
- (6) Combustion of materials in high-pressure oxygen
- (7) Arc tracking of wire insulation

F.4.4.2 These NASA procedures are small-scale tests suitable for use in the evaluation of materials in OEA. The document contains criteria for the selection of materials based on these data. This NASA document also contains guidelines on conducting large-scale flammability and out-gassing tests.

F.4.4.3 Spark, (61) hot wire, (35, 40) and radiation (42, 62) ignition sources have been used to evaluate the ease of ignition of materials in OEAs. These sources are direct adaptations of methods widely used in a normal atmosphere.

F.4.4.4 An investigation of spontaneous heating in OEA was carried out using an apparatus based on the ASTM E136 noncombustibility apparatus, which is an adaptation of the BS476 apparatus. (20)

F.4.4.5 Some solid materials exist in such a finely divided form as to be ignitable by a spark discharge. These forms include combustible dusts, such as flour, teased cotton wool, and the nap of flammable fabrics. An appropriate test method is described in F.4.2.1.

F.4.4.6 The rate at which flames will spread under a given set of circumstances is the most important property of a solid material in terms of fire hazard. Unfortunately, several of the methods regarded as most reliable for flame spread determinations in a normal atmosphere are not readily applicable at elevated pressures or even in atmospheres of nonstandard composition.

Table F.3.4.2(b) Threshold Pressures^a in Oxygen of 3.2 mm (0.13 in.) Diameter, Pure Metal Rods Ignited at the Bottom (63)

Element	Threshold Pressure		Next Lower Pressure Tested	
	MPa	psia ^b	MPa	psia ^b
Li	≤Ambient air ^c		None	None
Be	4.1	600	3.4	500
C (as graphite)	0.34	50	0.17	25
Mg	≤0.007	≤1	None	None
Al	≤0.17	25	None	None
Si	27.6	4,000	20.7	3,000
Ti	≤0.007	≤1	None	None
V	1.4	200	0.7	100
Cr	4.1	600	3.4	500
Fe	0.5	≤70	None	None
Co	>69 ^c	>10,000 ^d	None	None
Ni	>69 ^c	>10,000 ^d	None	None
Cu	>69 ^c	>10,000 ^d	None	None
Zn	5.5	800	4.8	700
Sr	≤ Ambient air ^c		None	None
Zr	≤0.06	≤8	None	None
Cb	≤0.7	≤100	None	None
Mo	0.7	100	0.34	50
Ag	>69	>10,000 ^d	None	None
In	0.14	20	0.08 ^d	12.3 ^e
Sn	1.0	150	None	None
Sb	4.1	600	3.4	500
Yb	0.08 ^e	12.3 ^e	Ambient air ^b	
Hf	0.07	10	None	None
Ta	0.14	20	None	None
W	0.34	50	0.07	10
Pt	>69 ^c	>10,000 ^d	None	None
Au	>69 ^c	>10,000 ^d	None	None
Pb	5.2	750	3.4	500

^aThreshold pressure is the minimum test pressure required to support complete combustion of the test sample. (See last paragraph of F.3.4.1.)

^bPressures above 100 psi are gauge pressure of psi rather than absolute pressure of psi.

^cSamples burned completely in ambient air at an atmospheric pressure of 85 kPa (absolute pressure of 12.3 psi).

^dSamples did not support combustion in at least three tests at this pressure. The threshold pressure, if it exists, is greater than this pressure.

^eThese tests were run in 85 kPa (absolute pressure of 12.3 psi) oxygen.

Table F.3.4.2(c) Threshold Pressures* in Oxygen of 60 × 60 Wire Meshes Rolled into 6.4 mm (0.25 in.) Diameter Cylinders Ignited at the Bottom (54)

Material	Threshold Pressure*	
	MPa	psia
Nickel 200	>69	>10,000
Copper 100	0.3	47
Monel 400	≤0.085	12.4
316 SS	≤0.085	12.4
304 SS	≤0.085	12.4
Carbon steel	≤0.085	12.4

*Threshold pressure is the minimum test pressure required to support complete combustion of the test sample. (See last paragraph of F.3.4.1.)

F.4.4.7 The method applicable to building lining materials and considered to be standard in North America is ASTM E84, colloquially known as the Tunnel Test. The specimen under test is 7.62 m (25 ft) long and is ignited under controlled draft conditions by a gas flame enveloping the first 1.5 m to 1.8 m (5 ft to 6 ft) of the specimen. It would most likely be possible to supply a suitably constructed apparatus with a specified oxygen atmosphere at pressures of up to, for example, 3 atm. Specification of the igniting flame would still constitute a problem, however, because both flame dimensions and rate of gas supply could not be maintained invariant regardless of atmospheric constituency and pressure. No laboratory has yet attempted to investigate flame spread in nonstandard atmospheres using a modified ASTM E84 technique.

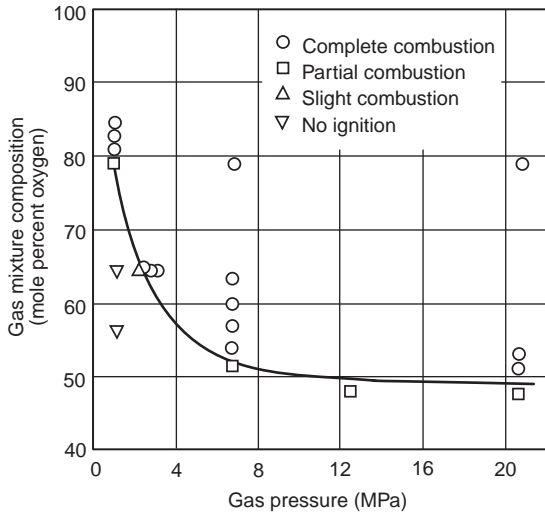


FIGURE F.3.4.3(a) Effect of Pressure on the Mole Percent of Oxygen in Nitrogen Required to Support Upward Combustion of C-1018 Carbon Steel Tubes [25.4 mm (1 in.) Outside Diameter and 4.8 mm (0.19 in.) Wall]. (55)

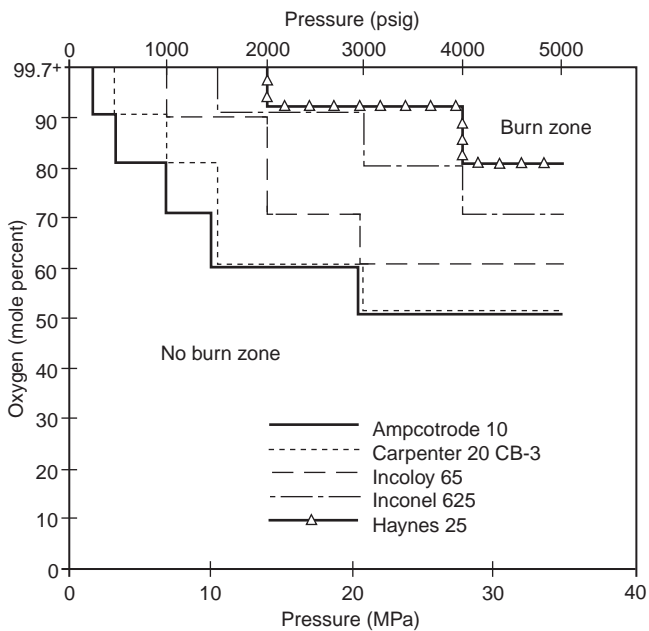


FIGURE F.3.4.3(b) Summary of Flammability Data Showing Boundaries Between Burn and No-Burn Zones for Several Engineering Alloys Configured as 3.2 mm (0.13 in.) Diameter Rods Burning in the Upward Direction. (57)

F.4.4.7.1 For building lining materials, the current thinking is that useful flame spread tests necessitate a fairly severe exposure, preferably on a large scale. Atmospheric oxygen depletion and thermal problems are then important.

F.4.4.7.2 Another popular test for assessing the flame spread characteristics of building materials is the ASTM E162. Although the specimen size is not large [457 mm × 152 mm (18 in. × 6 in.)], the test involves irradiation from a 457 mm ×

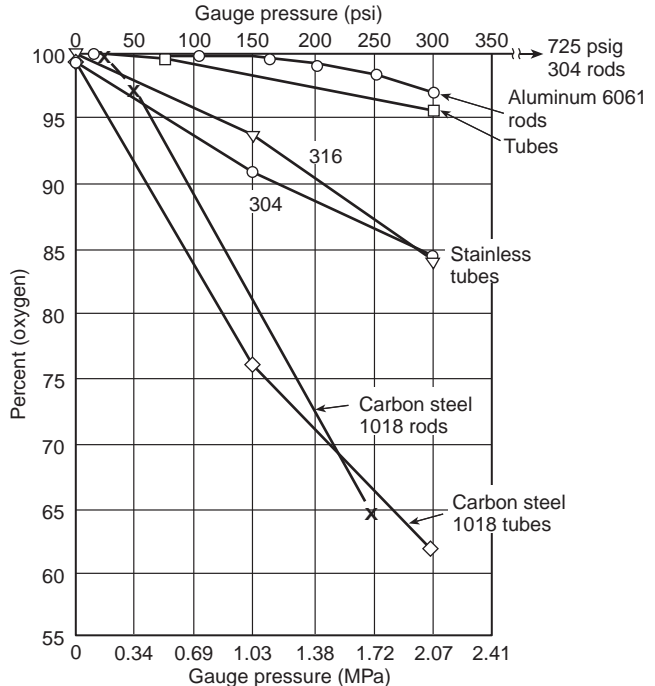


FIGURE F.3.4.3(c) Oxygen Indexes of Several Alloys in Various Configurations. (58)

305 mm (18 in. × 12 in.) gas-fired panel, and this feature complicates its application in nonstandard atmospheres.

F.4.4.8 Where a solid material is of the nature of a fabric or plastic and will not constitute part of a larger assembly when in use, it is easier to devise a test suitable for use at elevated pressures or in otherwise nonstandard atmospheres. One approach is to hang the material vertically, igniting it at the bottom. For ASTM D568, which is intended for measuring the flammability of thin plastics in a normal atmosphere, a specimen length of only 457 mm (18 in.) is specified. A British worker, investigating the effect of pressure and oxygen enrichment, used a specimen 1829 mm × 38 mm (72 in. × 1½ in.) in a cabinet of 305 mm² (1 ft²) cross-section. An atmospheric flow of 0.03 m/sec (5 linear ft/min) was maintained in an attempt to minimize the effects associated with the small dimensions of the compartment. The choice of a substantial vertical dimension minimized the effect of the variation of the atmospheric conditions on the characteristics of the igniting flame.

F.4.4.9 ASTM D1230 is potentially adaptable for use with nonstandard atmospheres. The upper surface of a 51 mm × 152 mm (2 in. × 6 in.) specimen, with the longer dimension inclined at an angle of 45 degrees to the horizontal, is exposed to ignition by a small pilot flame. Adaptation of an apparatus of this nature to nonstandard atmospheres is a more formidable task than might first be thought. The supply of air required to permit the burning of even an ounce of most combustible materials would necessitate 2.8 m³ (100 ft³) of air if serious oxygen depletion were to be avoided and substantially more if temperature rise were an important consideration. It is also difficult to establish an exposure condition that remains invariant. Thus, if a flame constitutes the exposure and its fuel supply is held constant, its dimensions and temperature will be a function of the atmospheric composition and pressure.

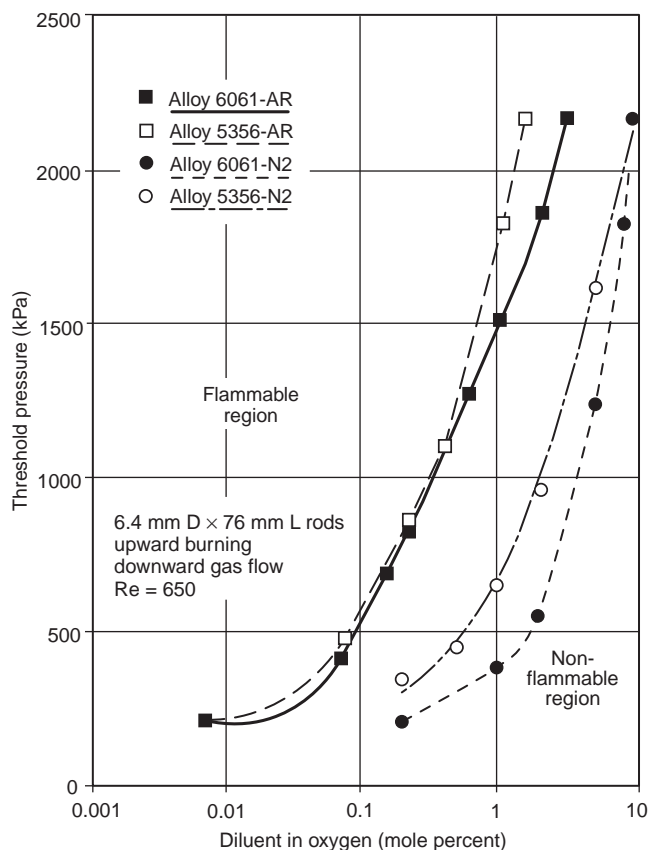


FIGURE F.3.4.4 Threshold Pressures of Two Aluminum Alloys Configured as 6.4 mm (0.25 in.) Diameter Rods Burning Upward in Downward-Flowing Gas. (56)

Even resorting to electrical heating poses similar problems. The average heating wire is of sufficiently small diameter to make convective cooling significant compared with radiative losses, even at high temperatures. Thus, the temperature attained by a wire subjected to a constant wattage or voltage is dependent on the nature of the atmosphere. Increase in pressure or change of diluent from nitrogen to helium will reduce the temperature of the wire.

Where fabrics are involved, exposure to a small ignition source is satisfactory, thus simplifying development of a test for use in nonstandard atmospheres. The nature of the test chosen is still of great importance, however. It has been found, for example, that the effect of increase in pressure on flammability, as demonstrated by a test such as that described in ASTM D1230, is dependent on the inclination of the specimen to the horizontal being greatest at an angle of 45 degrees. (40)

F.4.4.10 The oxygen index test, ASTM D2863, has come into wide use in the last few years for determining the characteristics of the flammability of solids. In this procedure, a small, vertically oriented sample is burned downward in a candle-like fashion in an oxygen-nitrogen mixture. The composition of the gas mixture is adjusted to determine the minimum percent of oxygen that will support combustion of the sample. This minimum oxygen concentration is called the oxygen index (OI).

An OI of 20.9 indicates that a material will just continue to burn downward in a normal atmosphere. Burning in an

upward direction takes place more readily, and it has been found that an OI of 26 or 27 is necessary if a material is to be noncombustible in air. Still higher values would be required for materials for use in most OEAs. The OI test provides a convenient method for comparing the flammability of similar materials. No correlation with performance under fire conditions is implied. The OI can be used as a guide in the selection of materials, which should then be tested under conditions of intended use.

F.5 References.

- (1) NFPA 325M, *Fire Hazard Properties of Flammable Liquids, Gases, and Volatile Solids*, National Fire Protection Association, Quincy, MA, 1991 edition.
- (2) Humphrey, H. B., and Margis, G. "Safety with Solvents." BuMines Information Circular 7757, 1957, 25 pp.
- (3) Litchfield, E. L., Kuchta, J. M., and Furno, A. L. "Flammability of Propellant Combinations." BuMines Explosives Research Report 3997, October 30, 1966, 69 pp. (Government Order H-76708, NASA, Huntsville, AL). *Ibid.* Explosives Research Report 3958, June 30, 1965, 83 pp.
- (4) Perlee, H. E., Martindill, G. H., and Zabetakis, M. G. "Flammability Characteristics of Selected Halogenated Hydrocarbons." BuMines Report of Investigations 6748, 1966, 12 pp.
- (5) Scott, G. S., Jones, G. W., and Scott, F. E. "Determination of Ignition Temperatures of Combustible Liquids and Gases." *Analytical Chemistry*, Vol. 20, March 1948, p. 238.
- (6) Zabetakis, M. G. "Flammability Characteristics of Combustible Gases and Vapors." BuMines Bulletin 627, 1985, 121 pp.
- (7) Lewis, B., and Von Elbe, G. "Combustion, Flames and Explosion of Gases." Academic Press, New York, 1961, pp. 323-346.
- (8) "Basic Considerations in the Combustion of Hydrocarbon Fuels with Air." NACA Report 1300, 1957.
- (9) Blanc, M. V., Guest, P. G., Von Elbe, G., and Lewis, B. J. *Chemistry Physics*, Vol. 15, 1947, p. 798. *Ibid.* Third Symposium on Combustion and Flame and Explosion Phenomena. Williams and Wilkins, Baltimore, 1949, p. 363.
- (10) Calcote, H. F., Gregory, C. A., Barnett, C. M., and Gilmer, R. B. "Spark Ignition." *Industrial and Engineering Chemicals*, Vol. 44, No. 11, November 1952, p. 2656.
- (11) Coward, H. F., and Jones, G. W. "Limits of Flammability of Gases and Vapors." BuMines Bulletin 503, 1952, 155 pp.
- (12) Fenn, J. B. "Lean Flammability Limit and Minimum Spark Ignition Energy." *Industrial and Engineering Chemicals*, Vol. 43, No. 12, December 1951, p. 2865.
- (13) Kuchta, J. M., and Cato, R. J. "Review of Ignition and Flammability Properties of Lubricants." Air Force Aero Propulsion Laboratory, Tech. Report AFAPL-TR-67-126, January 1968 (AD-665121).
- (14) Benz, F. J., Shaw, R. C., and Homa, J. M. "Burn Propagation Rates of Metals and Alloys in Gaseous Oxygen." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Second Volume*, ASTM STP 910. M. A. Benning, editor, American Society for Testing and Materials, Philadelphia, 1986, pp. 135-152.
- (15) Zawierucha, R., McIlroy, K., and Mazzarella, R. B. "Promoted Ignition Combustion Behavior of Selected Hastelloys in Oxygen Gas Mixtures." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltz-

- fus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (16) Sato, J. "Fire Spread Rates along Cylindrical Metal Rods in High Pressure Oxygen." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society for Testing and Materials, Philadelphia, 1989.
 - (17) Nagy, J., et al. "Explosibility of Dusts Used in the Plastics Industry." U.S. Bureau of Mines, RI 6516, 1964.
 - (18) Guest, P. G. "Oily Fibers May Increase Oxygen Tent Fire Hazard." *The Modern Hospital*, May 1965.
 - (19) Voigtsberger, P. "The Ignition of Oxygen-Impregnated Tissues by Electrostatic and Mechanically Produced Sparks." British Ministry of Power, SMRE Translation No. 5005, June 1964.
 - (20) Fisher, H. D., and Gerstein, M. "Investigation of Materials Combustibility and Fire and Explosion Suppression in a Variety of Atmospheres." Summary Report Nr. SN-6401 for the Air Force Aero Propulsion Laboratory, May 1966.
 - (21) Kuchta, J. M., et al. "Flammability of Materials in Hyperbaric Atmospheres." Explosive Research Center, U.S. Bureau of Mines, Final Report, August 30, 1967.
 - (22) White, E. L., and Ward, J. J. "Ignition of Metals in Oxygen." DMIC Report 224, Defense Metals Information Center, Battelle Memorial Institute, Columbus, OH, February 1966.
 - (23) Stoltzfus, J. M., and Gunaji, M. V. "Test Methods for Determining the Suitability of Metal Alloys for Use in Oxygen-Enriched Environments." Technology 2001, The Second National Technology Transfer Conference and Exposition, Conference Proceedings. NASA Conference Publication 3136, Vol. 1., National Aeronautics and Space Administration, Washington, DC, 1991.
 - (24) Jenny, R., and Wyssmann, H. "Friction-Induced Ignition in Oxygen." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812. B. L. Werley, editor, American Society for Testing and Materials, 1983, pp. 150-166.
 - (25) Monroe, R., W. Bates, E., and Pears, C. D. "Structural Materials Evaluation for Oxygen Centrifugal Compressors." SORI-EAS-78-399, Final Report. Southern Research Institute, Birmingham, AL, September 1978.
 - (26) Benz, F. J., and Stoltzfus, J. M. "Ignition of Metals and Alloys in Gaseous Oxygen by Friction Heating." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Second Volume*, ASTM STP 910. M.A. Benning, editor, American Society for Testing and Materials, Philadelphia, 1986, pp. 38-58.
 - (27) Stoltzfus, J. M., Benz F. J., and Homa, J. "The P_v Product Required for the Frictional Ignition of Alloys." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society for Testing and Materials, Philadelphia, 1989.
 - (28) Stoltzfus, J. M., Homa, J. M., William, R. E., and Benz, F. J. "ASTM Committee G-4 Metals Flammability Test Program: Data and Discussion." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Third Volume*, ASTM STP 986. D. W. Schroll, editor, American Society for Testing and Materials, Philadelphia, 1988, pp. 28-53.
 - (29) Schoenman, L., Stoltzfus, J., and Kazaroff, J. "Friction-Induced Ignition of Metals in High-Pressure Oxygen." *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Third Volume*, ASTM STP 986. D. W. Schroll, editor, American Society for Testing and Materials, Philadelphia, 1988, pp. 105-133.
 - (30) Lapin, A. *Liquid and Gaseous Oxygen Safety Review*, Vol. I-IV, NASA-CR-120922, APCI TM184. NASA Lewis Research Center, Cleveland, OH, June 1972.
 - (31) Clark, A. F., and Hust, T. G. "A Review of the Compatibility of Structural Materials with Oxygen." *AIAA Journal*, Vol. 12, No. 4, April 1974, pp. 441-454.
 - (32) Wegener, W. "Investigations on the Safe Flow Velocity To Be Admitted for Oxygen in Steel Pipe Lines." *Stahl and Eisen*, Vol. 84, No. 8, 1964, pp. 469-475.
 - (33) Schmidt, H. W., and Forney, D. F. "ASRDI Oxygen Technology Survey, Volume IX: Oxygen Systems Engineering Review." NASA SP 3090, NASA, Washington, DC, 1975.
 - (34) Dunnivant, W. "Polymers and the Thermal Barrier." *Industrial Research*, March 1965.
 - (35) Johnson, J. E., and Woods, F. J. "Flammability in Unusual Atmospheres, Part I — Preliminary Studies of Materials in Hyperbaric Atmospheres Containing Oxygen, Nitrogen, and/or Helium." Naval Research Laboratory, NRL Report 6470, October 31, 1966.
 - (36) Coleman, E. H. "Effects of Compressed and Oxygen-Enriched Air on the Flammability of Fabrics." *British Welding Journal*, September 1959.
 - (37) Mathes, K. N., and Frisco, L. J. "Flammability of Spacecraft Wire in an Oxygen Atmosphere." Research and Development Center, General Electric Company, Schenectady, NY, October 8, 1965.
 - (38) NRL Memorandum Report 5508, "Flashover Failures from Wet Wire Arcing and Tracking."
 - (39) NASA Report CR 185642, "Kapton Wire Arc Track Testing."
 - (40) Cook, G. A., Meierer, R. E., and Shields, B. M. "Combustibility Tests on Several Flame-Resistant Fabrics in Compressed Air, Oxygen-Enriched Air, and Pure Oxygen." *Textile Research Journal*, Vol. 37, No. 7, July 1967, pp. 591-599.
 - (41) Cook, G. A., Meierer, R. E., and Shields, B. M. "Screening of Flame Resistant Materials and Comparison of Helium with Nitrogen for Use in Diving Atmospheres." First Summary Report on Combustion Safety in Diving Atmospheres, Defense Documentation Center, No. AD651583, March 31, 1967.
 - (42) Denison, D., Ernsting, J., and Cresswell, A. W. "The Fire Risks to Man of Oxygen Rich Gas Environments." RAF Institute of Aviation Medicine, FPRC Memorandum 223, July 1965.
 - (43) Huggett, C. M., Von Elbe, G., and Haggerty, W. "The Combustibility of Materials in Oxygen-Helium and Oxygen-Nitrogen Atmospheres." SAM-TR-66-85, Brooks Air Force Base, Texas, June 1966.
 - (44) Simpson, J. L., Wolf, G. L., and Schiff, G. A. "The Oxidant O_2 (Helium) Index of Flammability of Endotracheal Tubes." *Symposium on Flammability and Sensitivity of Material in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society of Testing and Materials, Philadelphia, 1989.
 - (45) Wolf, G. L., and Simpson, J. I. "Oxidant O_2 and Oxidant N_2O Indices of Flammability and Their Additive Effect." *Symposium on Flammability and Sensitivity of Materials in*

- Oxygen-Enriched Atmospheres: Third Volume*, ASTM STP 986. D. W. Schroll, editor, American Society of Testing and Materials, Philadelphia, 1988, pp. 420–426.
- (46) Werley, B. L. “An Oxygen Index Update.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Third Volume*, ASTM STP 986. D. W. Schroll, editor, American Society for Testing and Materials, Philadelphia, 1988, pp. 248–261.
- (47) Steinberg, T. General Electric Metals Flammability Tests: Promoted Combustion Special Test Data Report, WSTF No. 90-24389. NASA White Sands Test Facility, Las Cruces, NM, 1991.
- (48) Stoltzfus, J. M., and Gunaji, M. V. “Test Methods for Determining the Suitability of Metal Alloys for Use in Oxygen-Enriched Environments.” Technology 2001, The Second National Technology Transfer Conference and Exposition, Conference Proceedings. NASA Conference Publication 3136, Vol. 1. National Aeronautics and Space Administration, Washington, DC, 1991.
- (49) Tack, W. T., McNamara, D. K., Stoltzfus, J. M., and Sircar, S. “Aluminum-Lithium Alloys: Mechanical Property and Composition Effects on Liquid Oxygen Compatibility.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (50) Bryan, C. J., Stoltzfus, J. M., and Gunaji, M. V. “An Assessment of the Metals Flammability Hazard in the Kennedy Space Center Oxygen Systems.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (51) Zawierucha, R., McIlroy, K., and Mazzarella, R. B. “Promoted Ignition Combustion Behavior of Selected Hastelloys in Oxygen Gas Mixtures.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (52) Gunaji, M. V. KSC Metals Flammability Tests: Promoted Combustion Special Test Data Report, WSTF No. 91-24655, NASA White Sands Test Facility, Las Cruces, NM, 1991.
- (53) Stoltzfus, J. M., Homa, J. M., William, R. E., and Benz, F. J. “ASTM Committee G-4 Metals Flammability Test Program: Data and Discussion.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Third Volume*, ASTM STP 986. D. W. Schroll, editor, American Society for Testing and Materials, Philadelphia, 1988, pp. 28–53.
- (54) Stoltzfus, J. M., Lowrie, R., and Gunaji, M. V. “Burn Propagation Behavior of Wire Mesh Made from Several Alloys.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (55) Benning, M. A., and Werley, B. L. “The Flammability of Carbon Steel as Determined by Pressurized Oxygen Index Measurements.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Second Volume*, ASTM STP 910. M. A. Benning, editor, American Society for Testing and Materials, Philadelphia, 1986, pp. 153–170.
- (56) Benning, M. A., Zabrenski, J. S., and Le, N. B. “The Flammability of Aluminum Alloys and Aluminum Bronzes as Measured by Pressurized Oxygen Index.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 986. D. W. Schroll, editor, American Society for Testing and Materials, Philadelphia, 1988, pp. 54–71.
- (57) Zawierucha, R., and McIlroy, K. “Promoted Ignition-Combustion Behavior of Selected Engineering Alloys in Oxygen Gas Mixtures.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society for Testing and Materials, Philadelphia, 1989.
- (58) Zabrenski, J. S., Werley, B. L., and Slusser, J. W. “Pressurized Flammability Limits of Metals.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society for Testing and Materials, Philadelphia, 1989.
- (59) McIlroy, K., and Zawierucha, R. “Promoted Ignition-Combustion Behavior of Precipitation Hardened Engineering Alloys.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume*, ASTM STP 1111. J. M. Stoltzfus and K. McIlroy, editors, American Society for Testing and Materials, Philadelphia, 1991.
- (60) McIlroy, K., and Zawierucha, R. “The Effects of Testing Methodology on the Promoted Ignition-Combustion Behavior of Carbon Steel and 316L Stainless Steel in Oxygen-Gas Mixtures.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume*, ASTM STP 1040. J. M. Stoltzfus, F. J. Benz, and J. S. Stradling, editors, American Society for Testing and Materials, Philadelphia, 1989.
- (61) NASA, “Flammability Odor, Off-gassing, and Compatibility Requirements and Test Procedures for Materials in Environments that Support Combustion.” Report No. NHB 8060.1C, April 1991.
- (62) Huggett, Clayton, et al. “The Effects of 100% Oxygen at Reduced Pressure on the Ignitibility and Combustibility of Materials.” SAM-TR-65-78, Brooks Air Force Base, December 1965.
- (63) Sircar, S., Stoltzfus, J., Bryan, C., and Kazaroff, J. “Promoted Combustion of Pure Metals in Oxygen-Enriched Atmospheres,” *Flammability and Sensitivity of Material in Oxygen-Enriched Atmospheres: 7th Vol.*, ASTM 1267, D. D. Janoff, W. T. Royals, and M. V. Gunaji, editors, American Society for Testing & Materials, Philadelphia, 1995.
- (64) ASTM G63, *Standard Guide for Evaluating Nonmetallic Material for Oxygen Service*, 1999.
- (65) Oxygen-Compatibility Material Database, Wendell Hull & Associates, Inc.
- (66) Beeson, H., Smith, S., and Stewart, W. *Safe Use of Oxygen and Oxygen Systems: Handbook for Oxygen System Design, Operation, and Maintenance*. West Conshohocken, PA: ASTM International, 2007.
- (67) Ikeda, G. “Oxygen Index Tests to Evaluate the Suitability of a Given Material for Oxygen Service.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812. B. L. Werley, editor, American Society for Testing and Materials, 1983, pp. 56-67.
- (68) Bryan, C., and Lowrie, R. “Comparative Results of Autogenous Ignition Temperature Measurements by ASTM

- G72 and Pressurized Scanning Calorimetry in Gaseous Oxygen.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*: Second Volume, ASTM STP 910. M.A. Benning, editor, American Society for Testing and Materials, Philadelphia, 1986, pp. 108-117.
- (69) Chou, T.C., and Fiedorowicz, A. “Oxygen Compatibility of Polymers Including TFE-Teflon®, KEL-F® 81, Vespel® SP-21, Viton® A, Viton® A-500, Fluorel®, Neoprene®, EPDM, Buna-N, and Nylon 6,6.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*: Eighth Volume, ASTM STP 1319. T.C. Chou, W.T. Royals, and T.A. Steinberg, editors, American Society for Testing and Materials, Philadelphia, 1997, pp. 319-349.
- (70) Beeson, H., Haas, J., and Waller, J. “Polymer-Oxygen Compatibility Testing: Effect of Oxygen Aging on Ignition and Combustion Properties.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*: Ninth Volume, ASTM STP 1395. T.A. Steinberg, B.E. Newton, and H.D. Beeson, editors, American Society for Testing and Materials, Philadelphia, 2000, pp. 73-87.
- (71) Union Carbide Research Report, Engineering Memorandum No. 5062-G.
- (72) Hsieh, F., Stoltzfus, J., and Beeson, H. “Note: Autoignition Temperature of Selected Polymers at Elevated Oxygen Pressure and Their Heat of Combustion.” *Fire and Materials* 20.6 (1996): 301-03.
- (73) Lowrie, R. “Heat of Combustion and Oxygen Compatibility.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*, ASTM STP 812. B. L. Werley, editor, American Society for Testing and Materials, 1983, pp. 84-96.
- (74) Hirsch, D., et.al. “Issues Related to the Flammability Assessment of Polymers for Hazard Analyses of Oxygen Systems.” *Symposium on Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres*: Tenth Volume, ASTM STP 1454. T.A. Steinberg, B.E. Newton, and H.D. Beeson, editors, American Society for Testing and Materials, Philadelphia, 2003, pp. 21-26.

Annex G Informational References

G.1 Referenced Publications. The documents or portions thereof listed in this annex are referenced within the informational sections of this recommended practice and are not part of the recommendations of this document unless also listed in Chapter 2 for other reasons.

G.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, 2013 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2014 edition.

NFPA 55, *Compressed Gases and Cryogenic Fluids Code*, 2013 edition.

NFPA 99, *Standard for Health Care Facilities*, 2005 edition.

NFPA 99, *Standard for Health Care Facilities*, 2015 edition.

NFPA 410, *Standard on Aircraft Maintenance*, 2015 edition.

G.1.2 Other Publications.

G.1.2.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM D56, *Standard Test Method for Flash Point by Tag Closed Cup Tester*, 2010.

ASTM D92, *Standard Test Method for Flash and Fire Points by Cleveland Open Cup Tester*, 2012.

ASTM D568, *Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Flexible Plastics in a Vertical Position*, 1985.

ASTM D1230, *Standard Test Method for Flammability of Apparel Textiles*, 2010.

ASTM D1929, *Standard Test Method for Determining Ignition Temperature of Plastics*, 2010.

ASTM D2863, *Standard Test Method for Measuring the Minimum Oxygen Concentration to Support Candle-Like Combustion of Plastics (Oxygen Index)*, 2013.

ASTM D4809, *Standard Test Method for Heat of Combustion of Liquid Hydrocarbon Fuels by Bomb Calorimeter (Precision Method)*, 2013.

ASTM D7194, *Standard Specification for Aerospace Parts Machined from Polychlorotrifluoroethylene (PCTFE)*, 2012.

ASTM D7211, *Standard Specification for Parts Machined from Polychlorotrifluoroethylene (PCTFE) and Intended for General Use*, 2013.

ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, 2013.

ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, 2012.

ASTM E162, *Standard Test Method for Surface Flammability of Materials Using a Radiant Heat Energy Source*, 2013.

ASTM E659, *Standard Test Method for Autoignition Temperature of Liquid Chemicals*, 2014.

ASTM G63, *Standard Guide for Evaluating Nonmetallic Material for Oxygen Service*, 2007.

ASTM G72, *Standard Test Method for Autogenous Ignition Temperature of Liquids and Solids in a High-Pressure Oxygen-Enriched Environment*, 2009.

ASTM G88, *Standard Guide for Designing Systems for Oxygen Service*, 2013.

ASTM G93, *Standard Practice for Cleaning Methods and Cleanliness Levels for Material and Equipment Used in Oxygen-Enriched Environments*, 2011.

ASTM G94, *Standard Guide for Evaluating Metals for Oxygen Service*, 2014.

ASTM G125, *Standard Test Method for Measuring Liquid and Solid Material Fire Limits in Gaseous Oxidants*, 2008.

ASTM G128, *Guide for the Control of Hazards and Risks in Oxygen-Enriched Atmospheres*, 2008.

Fire Hazards in Oxygen Systems.

G.1.2.2 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Chantilly, VA 20151-2923.

CGA E-2, *Hose Line Check Valve Standards for Welding and Cutting*, 2004.

CGA G-4, *Oxygen*, 2009.

CGA G-4.1, *Cleaning Equipment for Oxygen Service*, 2009.

CGA G-4.4, *Industrial Practices for Gaseous Oxygen Transmission and Distribution Piping Systems*, 2012.

CGA P-14, *Accident Prevention in Oxygen-Rich and Oxygen-Deficient Atmospheres*, 1992.

CGA Video AV-8, "Characteristics and Safe Handling of Cryogenic Liquid Gaseous Oxygen."

G.1.2.3 EIGA Publications. European Industrial Gases Association, Avenue des Arts 3-5, B-1210 Brussels, Belgium.

EIGA 33/06/E, *Cleaning of Equipment for Oxygen Service*.

EIGA 5/75/E, *Code of Practice for Supply Equipment and Pipeline Distributing Non-Flammable Gases and Vacuum Services for Medical Purposes*.

EIGA 6/77, *Oxygen Fuel Gas Cutting Machine Safety*.

EIGA 8/76/E, *Prevention of Accidents Arising from Enrichment or Deficiency of Oxygen in the Atmosphere*.

EIGA 12/80/E, *Pipelines Distributing Gases and Vacuum Services to Medical Laboratories*.

EIGA 10/09/E, *Reciprocating Compressors for Oxygen Service*.

EIGA 27/82/E, *Turbo Compressors for Oxygen Service, Code of Practice*.

G.1.2.4 Other Publications.

Benz, F.J., Williams, R.E., and Armstrong, D., "Ignition of Metals and Alloys by High-Velocity Particles," Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Second Volume, ASTM, 1986.

Christianson, R.C., and Plante, B.A., "Design of an Ignition-Resistant, High-Pressure, High-Temperature Oxygen Valve," Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume, ASTM, 1989.

Dees, J., and Peterson, J., "Selection of Materials for Bearing Applications in Oxygen." Proceedings of Advanced Earth-to-Orbit Propulsion Technology 1992, NASA Marshall Space Flight Center, AL, 1992.

Janoff, D., Bamford, L.J., Newton, B.E., and Bryan, C.J., "Ignition of PTFE-Lined Flexible Hoses by Rapid Pressurization With Oxygen," Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fourth Volume, ASTM, 1989.

Shelley, R.M., Christianson, R., and Stoltzfus, J.M., "Evaluation of Buna N Ignition Hazard in Gaseous Oxygen," Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Sixth Volume, ASTM, 1993.

Stoltzfus, J., Lowrie, R., and Gunaji, M.V., "Burn Propagation of Wire Mesh Made From Several Alloys," Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres: Fifth Volume, ASTM, 1991.

Topscott, R.E., Beeson, H.D., Lee, M.E., Plugge, M.A., Zallen, D.M., Walker, J.L., and Campbell, P. "Extinguishing Agent for Magnesium Fire: Phases I-IV," ESL-TR-86-17 July 1986.

Williams, R.E., Benz, F.J., and McIlroy, K., "Ignition of Steel Alloys by Impact of Low-Velocity Iron/Inert Particles in Gaseous Oxygen," Flammability and Sensitivity of Materials in Oxygen-Enriched Atmospheres, ASTM, 1988.

G.2 Informational References. The following documents or portions thereof are listed here as informational resources only. They are not a part of the recommendations of this document.

G.2.1 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Chantilly, VA 20151-2923.

CGA G-4.6, *Oxygen Compressor Installation and Operation Guide*, 2008.

CGA G-4.7, *Installation Guide for Stationary Electric Motor-Driven Centrifugal Liquid Oxygen Pumps*, 2005.

CGA G-4.8, *Safe Use of Aluminum Structured Packing for Oxygen Distillation*, 2013.

CGA G-4.9, *Safe Use of Brazed Aluminum Heat Exchangers for Producing Pressurized Oxygen*, 2009.

CGA G-4.10, *Design Considerations to Mitigate the Potential Risks of Toxicity When Using Nonmetallic Materials in High Pressure Oxygen Breathing Gas Systems*, 2008.

CGA G-4.11, *Reciprocating Compressors for Oxygen Service*, 2011.

CGA G-4.13, *Centrifugal Compressors for Oxygen Service*, 2012.

G.3 References for Extracts in Informational Sections. (Reserved)

Index

Copyright © 2015 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

- A-
 - Activation Energy**
 - Definition, 3.3.1
 - Administration, Chap. 1**
 - Application, 1.3
 - Interpretations, 1.4
 - Purpose, 1.2
 - Scope, 1.1
 - Approved**
 - Definition, 3.2.1, A.3.2.1
 - Authority Having Jurisdiction (AHJ)**
 - Definition, 3.2.2, A.3.2.2
 - Autoignition or Autogenous Ignition Temperature**
 - Definition, 3.3.2
 - C-
 - Code**
 - Definition, 3.2.3, A.3.2.3
 - Combustible Material**
 - Definition, 3.3.3
 - Combustion**
 - Definition, 3.3.4
 - Component Selection, Chap. 6**
 - Components, 6.4
 - Pressure-Relief Devices and Piping, 6.4.2
 - Flexible Piping and Tubing, 6.4.2.9
 - Valves, 6.4.1
 - General Design Recommendations, 6.2, A.6.2
 - Material Recommendations, 6.1
 - Specific Component Design Guidelines, 6.3
- Concentration**
 - Definition, 3.3.5
- Contaminant**
 - Definition, 3.3.6
- D-
- Definitions, Chap. 3**
- Deflagration**
 - Definition, 3.3.7
- Detonation**
 - Definition, 3.3.8
- Diluent**
 - Definition, 3.3.9
- E-
- Explanatory Material, Annex A**
- F-
- Fire**
 - Definition, 3.3.10
- Fire Experience, Annex D**
 - Introduction, D.1
 - References, D.3
 - Utilization of OEAs, D.2
 - Aircraft Oxygen Systems, D.2.7
 - Cutting and Welding, D.2.3
 - Deep Sea, D.2.8
 - Industrial Processing, D.2.4
 - Oxygen Pipeline, D.2.4.4
 - Laboratories, D.2.5
 - Medical, D.2.2
 - Other, D.2.9
 - Oxygen Production, Transportation, and Transfer, D.2.1
 - Space, D.2.6
- Fire Extinguishment, Chap. 8**
 - Diluents, 8.5
 - Extinguishing Systems, 8.2, A.8.2
 - Fixed Systems, 8.3
 - Instructions and Drills, 8.9
 - Limiting Fire Spread, 8.6, A.8.6
 - Nontoxic Agents, 8.7
 - Oxygen Supply, 8.1
 - Water Hose, 8.4
 - Wetting, 8.8, A.8.8
- Flame Propagation Rate**
 - Definition, 3.3.11
- Flammable**
 - Definition, 3.3.12
- Flammable Limits**
 - Definition, 3.3.13
- Flash Point**
 - Definition, 3.3.14
- Fuel**
 - Definition, 3.3.15
- Fundamentals of Ignition and Combustion in Oxygen-Enriched Atmospheres, Annex E**
 - Combustion Mechanisms, E.4
 - Combustible Gases, Vapors, and Liquids, E.4.2
 - Combustible Solids — Metals, E.4.4
 - Combustible Solids — Nonmetallics, E.4.3
 - General, E.4.1
 - Effects of Fire in Oxygen-Enriched Atmospheres, E.5
 - General, E.1
 - Ignition Mechanisms, E.3
 - Effects of Atmosphere Composition and Environmental Pressure and Temperature on Ignition Energy, E.3.2
 - Effects of Inert Gas on Ignition, Energy, Flammability Limits, and Flame Propagation, E.3.3
 - General, E.3.1
 - Properties of Atmospheres, E.2

- References, E.6
- H-**
- Hyperbaric**
Definition, 3.3.16
- Hypobaric**
Definition, 3.3.17
- I-**
- Ignition Temperature**
Definition, 3.3.18, A.3.3.18
- Informational References, Annex G**
- L-**
- Labeled**
Definition, 3.2.4
- Listed**
Definition, 3.2.5, A.3.2.5
- Lower Flammable Limit or Lower Explosive Limit**
Definition, 3.3.19
- M-**
- Materials for Use in Oxygen-Enriched Atmospheres, Annex F**
- Combustible Gases, Vapors, and Liquids, F.2
 - Combustion, F.2.3
 - Metallics, F.2.3.2
 - Nonmetallics, F.2.3.1
 - General, F.2.1
 - Ignition Temperature and Energy, F.2.2
 - Limits of Flammability of Nonmetallic Materials, F.2.4
 - Limits of Flammability — Metals, F.2.5
 - Combustible Solids, F.3
 - Combustion of Metals, F.3.4
 - Combustion — Nonmetallic Materials, F.3.3
 - General, F.3.1
 - Ignition Temperature and Energy, F.3.2
 - General, F.1
 - References, F.5
 - Test Methods, F.4
 - Gases, F.4.2
 - General, F.4.1
 - Liquids, F.4.3
 - Solids, F.4.4
- Materials Selection, Chap. 5**
- General, 5.1, A.5.1
 - Metals, 5.3
 - Nonmetals, 5.2
- Minimum Ignition Energy**
Definition, 3.3.20, A.3.3.20
- Mixture**
- Definition, 3.3.21
 - Lean Mixture
 - Definition, 3.3.21.1
 - Rich Mixture
 - Definition, 3.3.21.2
 - Stoichiometric Mixture
 - Definition, 3.3.21.3
- O-**
- Oxidant**
Definition, 3.3.22, A.3.3.22
- Oxidation**
Definition, 3.3.23
- Oxygen**
Definition, 3.3.24
- Oxygen-Enriched Atmosphere (OEA)**
Definition, 3.3.25
- P-**
- Pressure**
- Absolute Pressure
 - Definition, 3.3.26.1
 - Definition, 3.3.26, A.3.3.26
 - Gauge Pressure
 - Definition, 3.3.26.2
- R-**
- Recommended Practice**
Definition, 3.2.6
- Referenced Publications, Chap. 2**
- S-**
- Should**
Definition, 3.2.7
- Spontaneous Ignition Temperature**
Definition, 3.3.27
- Standard**
Definition, 3.2.8
- System Design, Chap. 7**
- Applicable Standards, 7.10
 - Cleaning for Oxygen Service, 7.8, A.7.8
 - Combustibles, 7.9, A.7.9
 - Design Considerations, 7.1
 - Electrical Equipment, 7.7
 - Fire-Stopping Techniques, 7.3
 - Oxygen Transmission, 7.5
 - Personnel Qualifications, 7.4, A.7.4
 - Shutoff, 7.6, A.7.6
 - Worst-Case Conditions, 7.2
- T-**
- Training and Education, Annex B**
- Education, B.2
 - Training, B.1
- Types of Systems Used in Oxygen-Enriched Atmospheres, Chap. 4**
General, 4.1
- U-**
- Upper Flammable Limit or Upper Explosive Limit**
Definition, 3.3.28
- Utilization of Oxygen-Enriched Atmospheres, Annex C**
- Caisson Work and Underwater Tunneling, C.5
 - Commercial and Military Aviation, C.7
 - General, C.1
 - Inadvertent Utilization, C.8

Industrial Applications, C.4

Medical Applications, C.3

Processing, Transport, Storage, and Dispensing of Oxygen, C.2

Reference, C.9

Space and Deep-Sea Exploration, C.6

-W-

Worst-Case

Definition, 3.3.29

Sequence of Events for the Standards Development Process

As soon as the current edition is published, a Standard is open for Public Input

Step 1: Input Stage

- Input accepted from the public or other committees for consideration to develop the First Draft
- Committee holds First Draft Meeting to revise Standard (23 weeks)
Committee(s) with Correlating Committee (10 weeks)
- Committee ballots on First Draft (12 weeks)
Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted

Step 2: Comment Stage

- Public Comments accepted on First Draft (10 weeks)
- If Standard does not receive Public Comments and the Committee does not wish to further revise the Standard, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance
- Committee holds Second Draft Meeting (21 weeks)
Committee(s) with Correlating Committee (7 weeks)
- Committee ballots on Second Draft (11 weeks)
Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (8 weeks)
- Second Draft Report posted

Step 3: Association Technical Meeting

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks)
- NITMAMs are reviewed and valid motions are certified for presentation at the Association Technical Meeting
- Consent Standard bypasses Association Technical Meeting and proceeds directly to the Standards Council for issuance
- NFPA membership meets each June at the Association Technical Meeting and acts on Standards with “Certified Amending Motions” (certified NITMAMs)
- Committee(s) and Panel(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the Association Technical Meeting

Step 4: Council Appeals and Issuance of Standard

- Notification of intent to file an appeal to the Standards Council on Association action must be filed within 20 days of the Association Technical Meeting
- Standards Council decides, based on all evidence, whether or not to issue the Standards or to take other action

Committee Membership Classifications^{1,2,3,4}

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

1. M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
2. U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
5. RT *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
6. E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
7. I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
8. C *Consumer*: A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: “Standard” connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of “Utilities” in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

Submitting Public Input / Public Comment through the Electronic Submission System (e-Submission):

As soon as the current edition is published, a Standard is open for Public Input.

Before accessing the e-Submission System, you must first sign-in at www.NFPA.org. *Note: You will be asked to sign-in or create a free online account with NFPA before using this system:*

- a. Click in the gray Sign In box on the upper left side of the page. Once signed-in, you will see a red “Welcome” message in the top right corner.
- b. Under the Codes and Standards heading, Click on the Document Information pages (List of Codes & Standards), and then select your document from the list or use one of the search features in the upper right gray box.

OR

- a. Go directly to your specific document page by typing the convenient short link of www.nfpa.org/document#, (Example: NFPA 921 would be www.nfpa.org/921) Click in the gray Sign In box on the upper left side of the page. Once signed in, you will see a red “Welcome” message in the top right corner.

To begin your Public Input, select the link The next edition of this standard is now open for Public Input (formally “proposals”) located on the Document Information tab, the Next Edition tab, or the right-hand Navigation bar. Alternatively, the Next Edition tab includes a link to Submit Public Input online

At this point, the NFPA Standards Development Site will open showing details for the document you have selected. This “Document Home” page site includes an explanatory introduction, information on the current document phase and closing date, a left-hand navigation panel that includes useful links, a document Table of Contents, and icons at the top you can click for Help when using the site. The Help icons and navigation panel will be visible except when you are actually in the process of creating a Public Input.

Once the First Draft Report becomes available there is a Public comment period during which anyone may submit a Public Comment on the First Draft. Any objections or further related changes to the content of the First Draft must be submitted at the Comment stage.

To submit a Public Comment you may access the e-Submission System utilizing the same steps as previous explained for the submission of Public Input.

For further information on submitting public input and public comments, go to: <http://www.nfpa.org/publicinput>

Other Resources available on the Doc Info Pages

Document information tab: Research current and previous edition information on a Standard

Next edition tab: Follow the committee’s progress in the processing of a Standard in its next revision cycle.

Technical committee tab: View current committee member rosters or apply to a committee

Technical questions tab: For members and Public Sector Officials/AHJs to submit questions about codes and standards to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA codes and standards relevant to your work. Responses are provided by NFPA staff on an informal basis.

Products/training tab: List of NFPA’s publications and training available for purchase.

Community tab: Information and discussions about a Standard

Information on the NFPA Standards Development Process

I. Applicable Regulations. The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the *NFPA Regulations Governing the Development of NFPA Standards (Regs)*. Other applicable rules include *NFPA Bylaws*, *NFPA Technical Meeting Convention Rules*, *NFPA Guide for the Conduct of Participants in the NFPA Standards Development Process*, and the *NFPA Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council*. Most of these rules and regulations are contained in the *NFPA Standards Directory*. For copies of the *Directory*, contact Codes and Standards Administration at NFPA Headquarters; all these documents are also available on the NFPA website at “www.nfpa.org.”

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

II. Technical Committee Report. The Technical Committee Report is defined as “the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard.” The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at 1.4)

III. Step 1: First Draft Report. The First Draft Report is defined as “Part one of the Technical Committee Report, which documents the Input Stage.” The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Input, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b)]

IV. Step 2: Second Draft Report. The Second Draft Report is defined as “Part two of the Technical Committee Report, which documents the Comment Stage.” The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at Section 4.2.5.2 and 4.4) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the Association Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b)]

V. Step 3a: Action at Association Technical Meeting. Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion. (See *Regs* at 4.5.2) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June Association Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table 1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an Association Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5.3) must be raised through an appeal to the Standards Council or it will be considered to be resolved.

VI. Step 3b: Documents Forwarded Directly to the Council. Where no Notice of Intent to Make a Motion (NITMAM) is received and certified in accordance with the Technical Meeting Convention Rules, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5)

VII. Step 4a: Council Appeals. Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the Association or on matters within the purview of the authority of the Council, as established by the *Bylaws* and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (See *Regs* at 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.

VIII. Step 4b: Document Issuance. The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an Association Technical Meeting within 75 days from the date of the recommendation from the Association Technical Meeting, unless this period is extended by the Council (See *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (See *Regs* at 4.5.2.5 and 4.7.4).

IX. Petitions to the Board of Directors. The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the Association. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in 1.7 of the *Regs*.

X. For More Information. The program for the Association Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. For copies of the First Draft Report and Second Draft Report as well as more information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website (www.nfpa.org/aboutthecodes) or contact NFPA Codes & Standards Administration at (617) 984-7246.



Are you IN? NFPA Xchange™

Our online community lets you connect with NFPA® technical staff, network with professionals worldwide, and explore content on everything from fire protection systems, electrical, building and life safety, emergency response, and more. Plus, you can:

- **SHARE ideas**
- **ASK questions**
- **POST discussions**

Have a question about the code or standard you're reading right now? NFPA Members enjoy exclusive access to the 'Members Only' section on NFPA Xchange, where you can submit technical standards questions,* as well as search questions submitted by others and view the answers!

JOIN NFPA Xchange TODAY—IT'S FREE AND EASY!

1

Go online

[NFPA.ORG/Xchange](https://www.nfpa.org/Xchange)

2

Enter

YOUR NFPA ID# OR
EMAIL ADDRESS AND
PASSWORD

3

YOU'RE IN!

INformation. INTelligence. Get INVolved.

*For the full terms of use, please visit [nfpa.org/standard_items/terms-of-use#xchange](https://www.nfpa.org/standard_items/terms-of-use#xchange). NFPA® is a registered trademark of the National Fire Protection Association, Quincy, MA 02169